


PART IV. SERVICE LIFE STATISTICS

MANITOBA HYDRO
ACCOUNT 000A - DAMS, DYKES AND WEIRS
ORIGINAL AND SMOOTH SURVIVOR CURVES

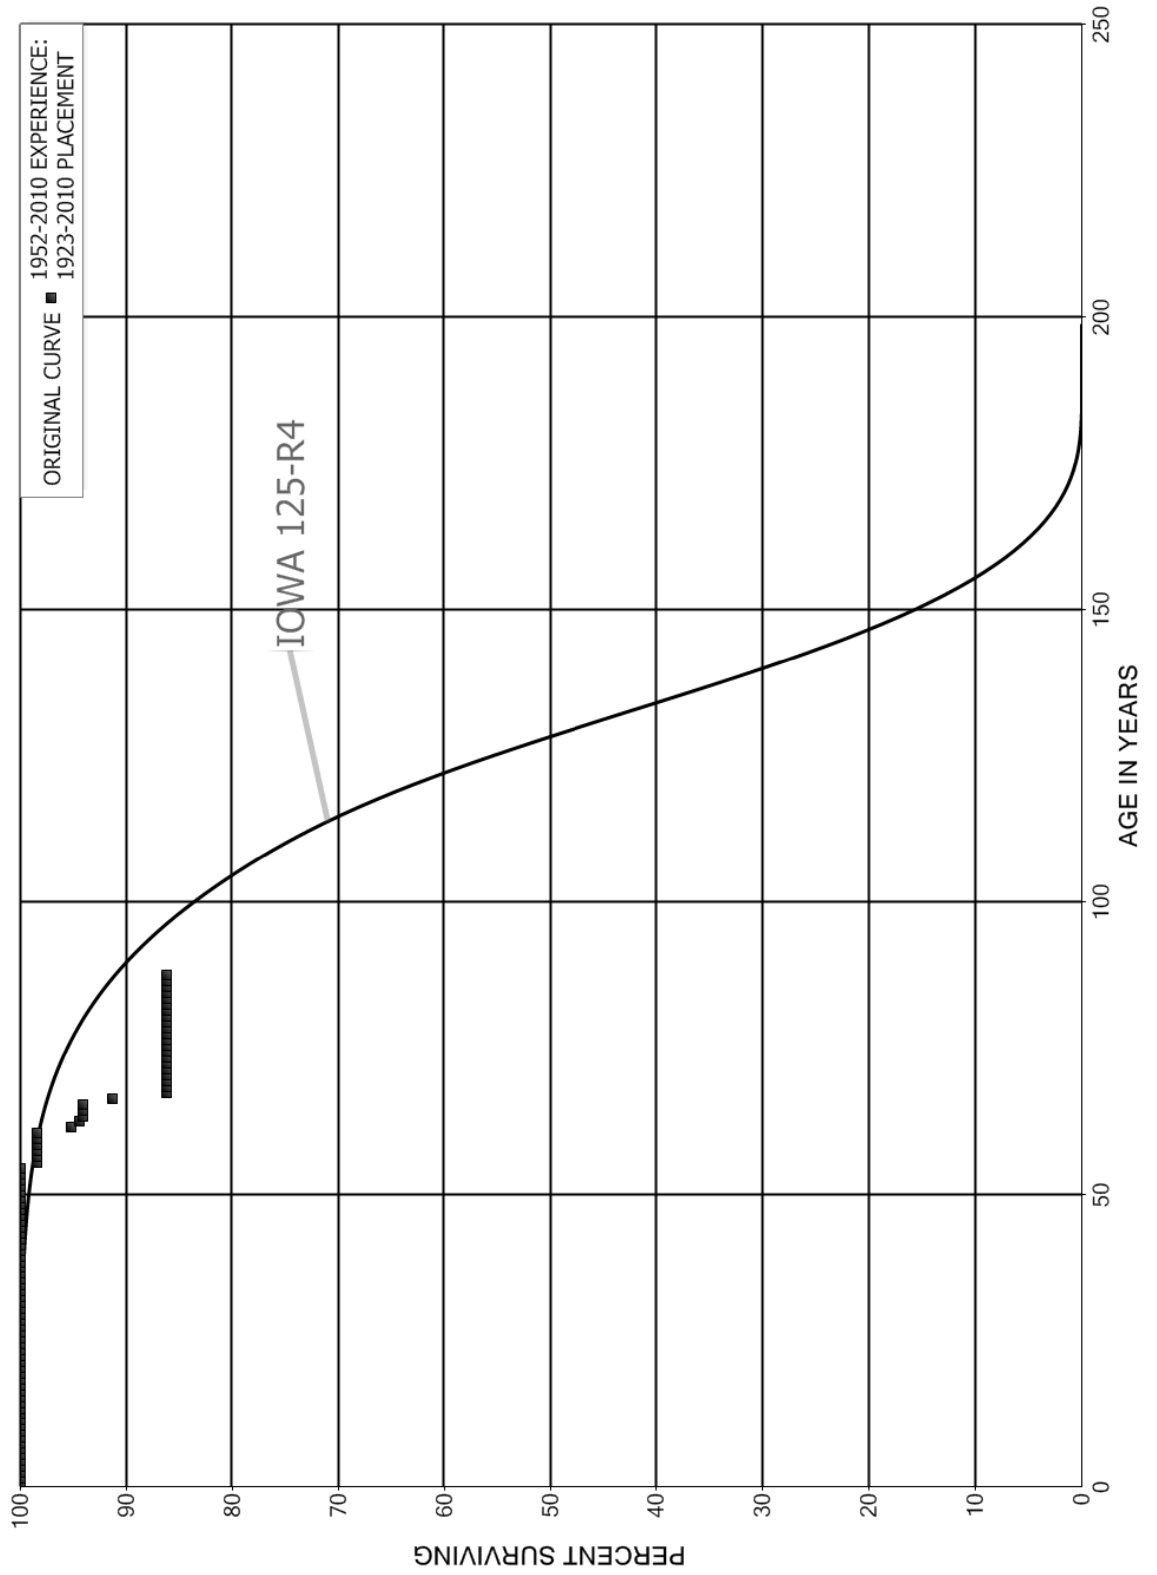

MANITOBA HYDRO

ACCOUNT 000A - DAMS, DYKES AND WEIRS

ORIGINAL LIFE TABLE

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1952-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	508,421,790		0.0000	1.0000	100.00
0.5	501,643,055		0.0000	1.0000	100.00
1.5	500,090,101		0.0000	1.0000	100.00
2.5	488,484,477		0.0000	1.0000	100.00
3.5	487,761,872		0.0000	1.0000	100.00
4.5	478,998,844		0.0000	1.0000	100.00
5.5	475,383,219		0.0000	1.0000	100.00
6.5	466,850,659		0.0000	1.0000	100.00
7.5	463,706,748		0.0000	1.0000	100.00
8.5	461,332,887		0.0000	1.0000	100.00
9.5	460,509,752		0.0000	1.0000	100.00
10.5	457,434,195		0.0000	1.0000	100.00
11.5	457,229,039		0.0000	1.0000	100.00
12.5	454,512,895		0.0000	1.0000	100.00
13.5	454,162,200		0.0000	1.0000	100.00
14.5	454,162,200		0.0000	1.0000	100.00
15.5	454,162,200		0.0000	1.0000	100.00
16.5	454,108,717		0.0000	1.0000	100.00
17.5	447,052,369		0.0000	1.0000	100.00
18.5	433,780,115		0.0000	1.0000	100.00
19.5	420,254,749		0.0000	1.0000	100.00
20.5	417,016,933	13,954	0.0000	1.0000	100.00
21.5	417,002,979		0.0000	1.0000	100.00
22.5	418,403,378		0.0000	1.0000	100.00
23.5	418,403,378		0.0000	1.0000	100.00
24.5	405,403,073		0.0000	1.0000	100.00
25.5	403,856,291		0.0000	1.0000	100.00
26.5	384,193,841		0.0000	1.0000	100.00
27.5	384,003,089		0.0000	1.0000	100.00
28.5	385,373,616		0.0000	1.0000	100.00
29.5	385,373,616		0.0000	1.0000	100.00
30.5	385,373,616		0.0000	1.0000	100.00
31.5	323,857,324		0.0000	1.0000	100.00
32.5	106,855,187		0.0000	1.0000	100.00
33.5	106,855,187		0.0000	1.0000	100.00
34.5	106,855,187		0.0000	1.0000	100.00
35.5	106,855,187		0.0000	1.0000	100.00
36.5	106,855,187		0.0000	1.0000	100.00
37.5	62,267,931		0.0000	1.0000	100.00
38.5	62,267,931		0.0000	1.0000	100.00

MANITOBA HYDRO

ACCOUNT 000A - DAMS, DYKES AND WEIRS

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1952-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
39.5	62,265,107		0.0000	1.0000	100.00
40.5	62,265,107		0.0000	1.0000	100.00
41.5	61,796,000		0.0000	1.0000	100.00
42.5	61,796,000		0.0000	1.0000	100.00
43.5	61,796,000		0.0000	1.0000	100.00
44.5	20,881,841		0.0000	1.0000	100.00
45.5	20,881,841		0.0000	1.0000	100.00
46.5	20,881,841		0.0000	1.0000	100.00
47.5	20,881,841		0.0000	1.0000	100.00
48.5	20,881,841		0.0000	1.0000	100.00
49.5	17,244,716		0.0000	1.0000	100.00
50.5	17,244,716		0.0000	1.0000	100.00
51.5	17,235,876		0.0000	1.0000	100.00
52.5	11,635,572		0.0000	1.0000	100.00
53.5	11,635,572		0.0000	1.0000	100.00
54.5	11,635,572	192,434	0.0165	0.9835	100.00
55.5	8,809,810		0.0000	1.0000	98.34
56.5	8,809,810		0.0000	1.0000	98.34
57.5	8,807,519		0.0000	1.0000	98.34
58.5	5,973,735		0.0000	1.0000	98.34
59.5	5,962,152		0.0000	1.0000	98.34
60.5	5,513,012	175,771	0.0319	0.9681	98.34
61.5	5,337,241	44,894	0.0084	0.9916	95.21
62.5	5,292,347	19,841	0.0037	0.9963	94.41
63.5	5,272,506		0.0000	1.0000	94.05
64.5	5,272,506		0.0000	1.0000	94.05
65.5	5,272,506	155,106	0.0294	0.9706	94.05
66.5	5,117,399	283,771	0.0555	0.9445	91.29
67.5	4,833,629		0.0000	1.0000	86.22
68.5	4,833,629		0.0000	1.0000	86.22
69.5	4,833,629		0.0000	1.0000	86.22
70.5	4,833,629		0.0000	1.0000	86.22
71.5	4,833,629		0.0000	1.0000	86.22
72.5	4,833,629		0.0000	1.0000	86.22
73.5	4,833,629		0.0000	1.0000	86.22
74.5	4,833,629		0.0000	1.0000	86.22
75.5	4,833,629		0.0000	1.0000	86.22
76.5	4,833,629		0.0000	1.0000	86.22
77.5	4,833,629		0.0000	1.0000	86.22
78.5	2,211,109		0.0000	1.0000	86.22


MANITOBA HYDRO

ACCOUNT 000A - DAMS, DYKES AND WEIRS

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1952-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
79.5	2,211,109		0.0000	1.0000	86.22
80.5	2,211,109		0.0000	1.0000	86.22
81.5	986,481		0.0000	1.0000	86.22
82.5	986,481		0.0000	1.0000	86.22
83.5	967,520		0.0000	1.0000	86.22
84.5	967,520		0.0000	1.0000	86.22
85.5	967,520		0.0000	1.0000	86.22
86.5	931,651		0.0000	1.0000	86.22
87.5					86.22

MANITOBA HYDRO
ACCOUNT 000B - POWERHOUSE
ORIGINAL AND SMOOTH SURVIVOR CURVES

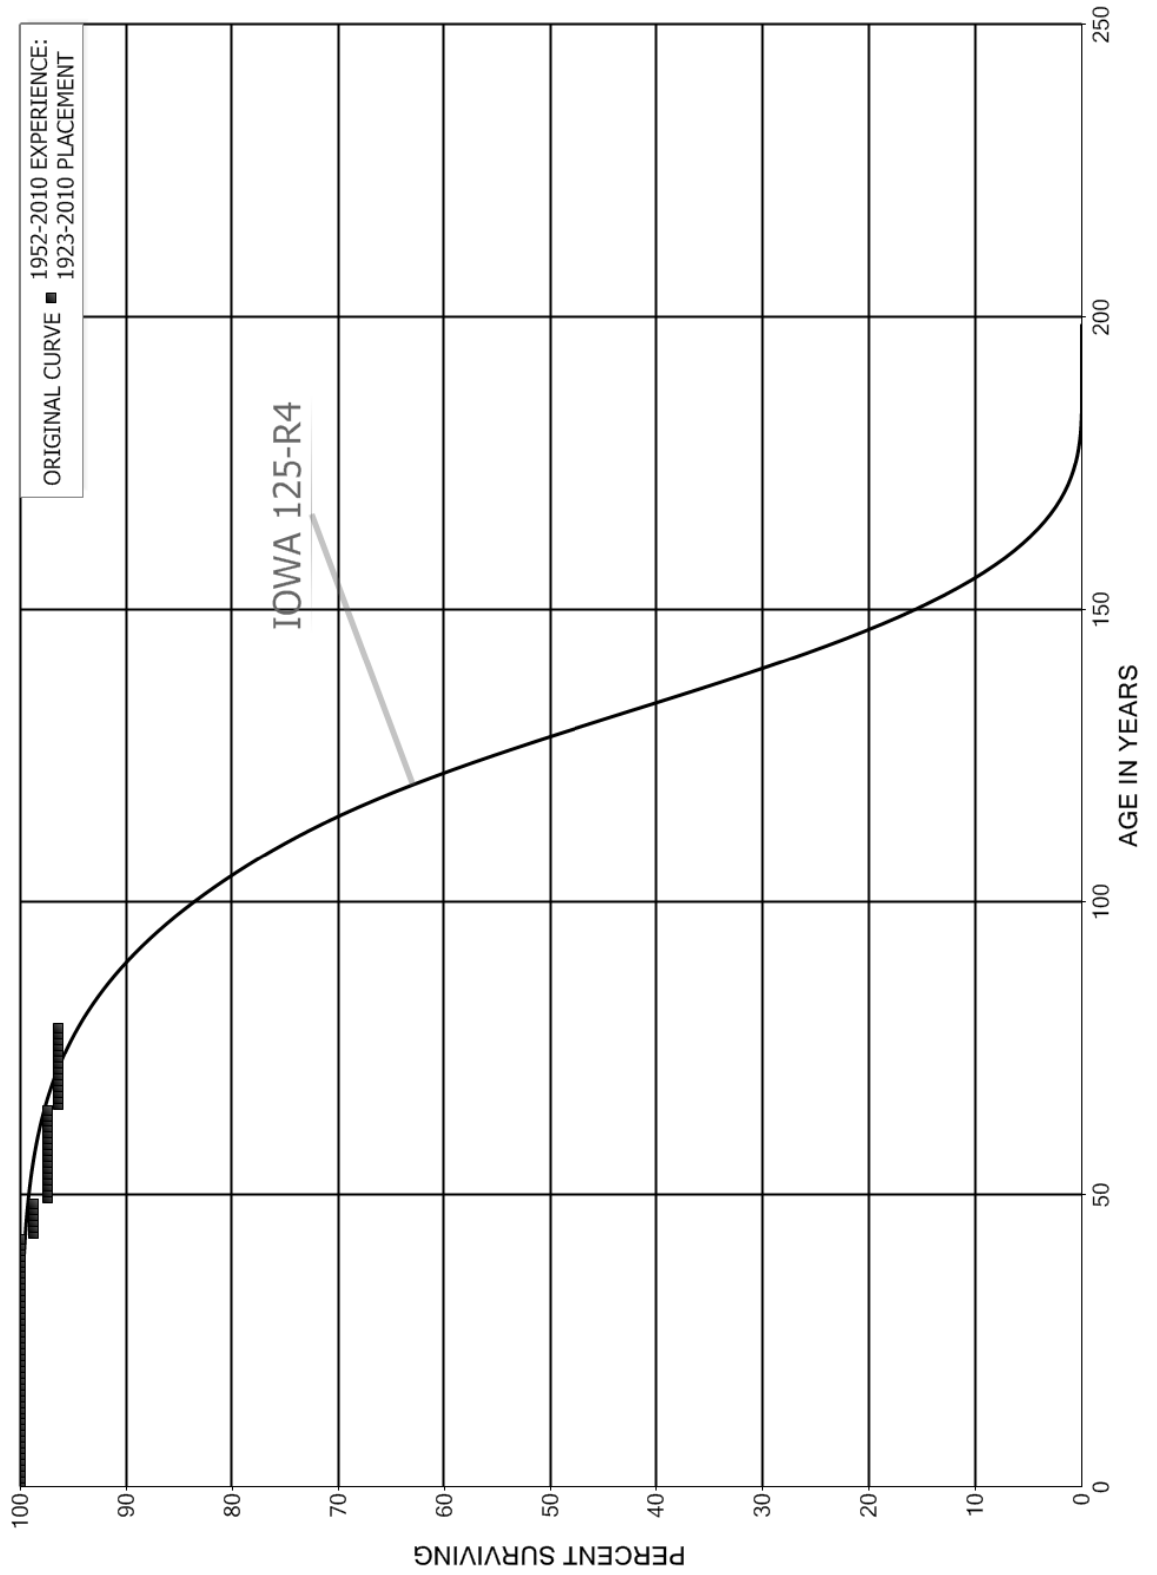

MANITOBA HYDRO

ACCOUNT 000B - POWERHOUSE

ORIGINAL LIFE TABLE

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1952-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	1,006,902,158		0.0000	1.0000	100.00
0.5	1,001,979,304		0.0000	1.0000	100.00
1.5	994,421,280		0.0000	1.0000	100.00
2.5	990,039,764	8,710	0.0000	1.0000	100.00
3.5	979,546,364		0.0000	1.0000	100.00
4.5	976,851,442	232,971	0.0002	0.9998	100.00
5.5	974,805,025	9,768	0.0000	1.0000	99.98
6.5	973,692,577		0.0000	1.0000	99.97
7.5	913,821,075		0.0000	1.0000	99.97
8.5	913,821,075		0.0000	1.0000	99.97
9.5	913,803,066	77,663	0.0001	0.9999	99.97
10.5	913,322,435	5,968	0.0000	1.0000	99.97
11.5	912,997,477		0.0000	1.0000	99.97
12.5	912,767,312	12,034	0.0000	1.0000	99.97
13.5	909,645,809		0.0000	1.0000	99.96
14.5	909,255,949		0.0000	1.0000	99.96
15.5	905,651,022		0.0000	1.0000	99.96
16.5	905,523,543		0.0000	1.0000	99.96
17.5	815,241,985		0.0000	1.0000	99.96
18.5	631,274,247		0.0000	1.0000	99.96
19.5	454,314,537		0.0000	1.0000	99.96
20.5	453,662,579		0.0000	1.0000	99.96
21.5	453,531,074		0.0000	1.0000	99.96
22.5	454,328,376		0.0000	1.0000	99.96
23.5	454,356,372		0.0000	1.0000	99.96
24.5	450,087,316		0.0000	1.0000	99.96
25.5	449,853,614	42,494	0.0001	0.9999	99.96
26.5	448,823,463		0.0000	1.0000	99.95
27.5	448,766,297		0.0000	1.0000	99.95
28.5	449,702,658		0.0000	1.0000	99.95
29.5	449,702,658		0.0000	1.0000	99.95
30.5	449,609,923		0.0000	1.0000	99.95
31.5	309,301,119		0.0000	1.0000	99.95
32.5	234,491,191		0.0000	1.0000	99.95
33.5	234,373,346		0.0000	1.0000	99.95
34.5	234,373,346	4,574	0.0000	1.0000	99.95
35.5	234,368,772		0.0000	1.0000	99.95
36.5	234,360,814		0.0000	1.0000	99.95
37.5	91,680,483		0.0000	1.0000	99.95
38.5	91,657,564	500	0.0000	1.0000	99.95

MANITOBA HYDRO

ACCOUNT 000B - POWERHOUSE

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1952-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
39.5	91,280,176		0.0000	1.0000	99.95
40.5	77,895,685		0.0000	1.0000	99.95
41.5	74,301,792		0.0000	1.0000	99.95
42.5	74,301,792	893,465	0.0120	0.9880	99.95
43.5	73,352,248		0.0000	1.0000	98.75
44.5	54,284,932		0.0000	1.0000	98.75
45.5	54,284,932		0.0000	1.0000	98.75
46.5	54,276,777		0.0000	1.0000	98.75
47.5	54,276,777		0.0000	1.0000	98.75
48.5	54,276,777	739,929	0.0136	0.9864	98.75
49.5	32,034,078		0.0000	1.0000	97.40
50.5	32,034,078		0.0000	1.0000	97.40
51.5	32,010,008		0.0000	1.0000	97.40
52.5	28,005,730		0.0000	1.0000	97.40
53.5	27,995,013		0.0000	1.0000	97.40
54.5	27,995,013		0.0000	1.0000	97.40
55.5	19,121,525		0.0000	1.0000	97.40
56.5	19,121,525		0.0000	1.0000	97.40
57.5	19,121,525		0.0000	1.0000	97.40
58.5	9,976,187		0.0000	1.0000	97.40
59.5	9,973,098		0.0000	1.0000	97.40
60.5	9,226,769		0.0000	1.0000	97.40
61.5	9,226,769		0.0000	1.0000	97.40
62.5	9,226,769		0.0000	1.0000	97.40
63.5	9,226,769		0.0000	1.0000	97.40
64.5	9,226,769	100,000	0.0108	0.9892	97.40
65.5	9,126,769		0.0000	1.0000	96.35
66.5	9,126,769		0.0000	1.0000	96.35
67.5	9,126,769		0.0000	1.0000	96.35
68.5	9,126,769		0.0000	1.0000	96.35
69.5	9,126,769		0.0000	1.0000	96.35
70.5	9,126,769		0.0000	1.0000	96.35
71.5	9,126,769		0.0000	1.0000	96.35
72.5	9,126,769		0.0000	1.0000	96.35
73.5	9,126,769		0.0000	1.0000	96.35
74.5	9,126,769		0.0000	1.0000	96.35
75.5	9,126,769		0.0000	1.0000	96.35
76.5	9,126,769		0.0000	1.0000	96.35
77.5	9,126,769		0.0000	1.0000	96.35
78.5	2,154,669		0.0000	1.0000	96.35


MANITOBA HYDRO

ACCOUNT 000B - POWERHOUSE

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1952-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
79.5	2,154,669		0.0000	1.0000	96.35
80.5	2,154,669		0.0000	1.0000	96.35
81.5	1,357,368		0.0000	1.0000	96.35
82.5	1,252,181		0.0000	1.0000	96.35
83.5	1,004,594		0.0000	1.0000	96.35
84.5	1,004,594		0.0000	1.0000	96.35
85.5	1,004,594		0.0000	1.0000	96.35
86.5	936,361		0.0000	1.0000	96.35
87.5					96.35

MANITOBA HYDRO
ACCOUNT 000D - SPILLWAY
ORIGINAL AND SMOOTH SURVIVOR CURVES

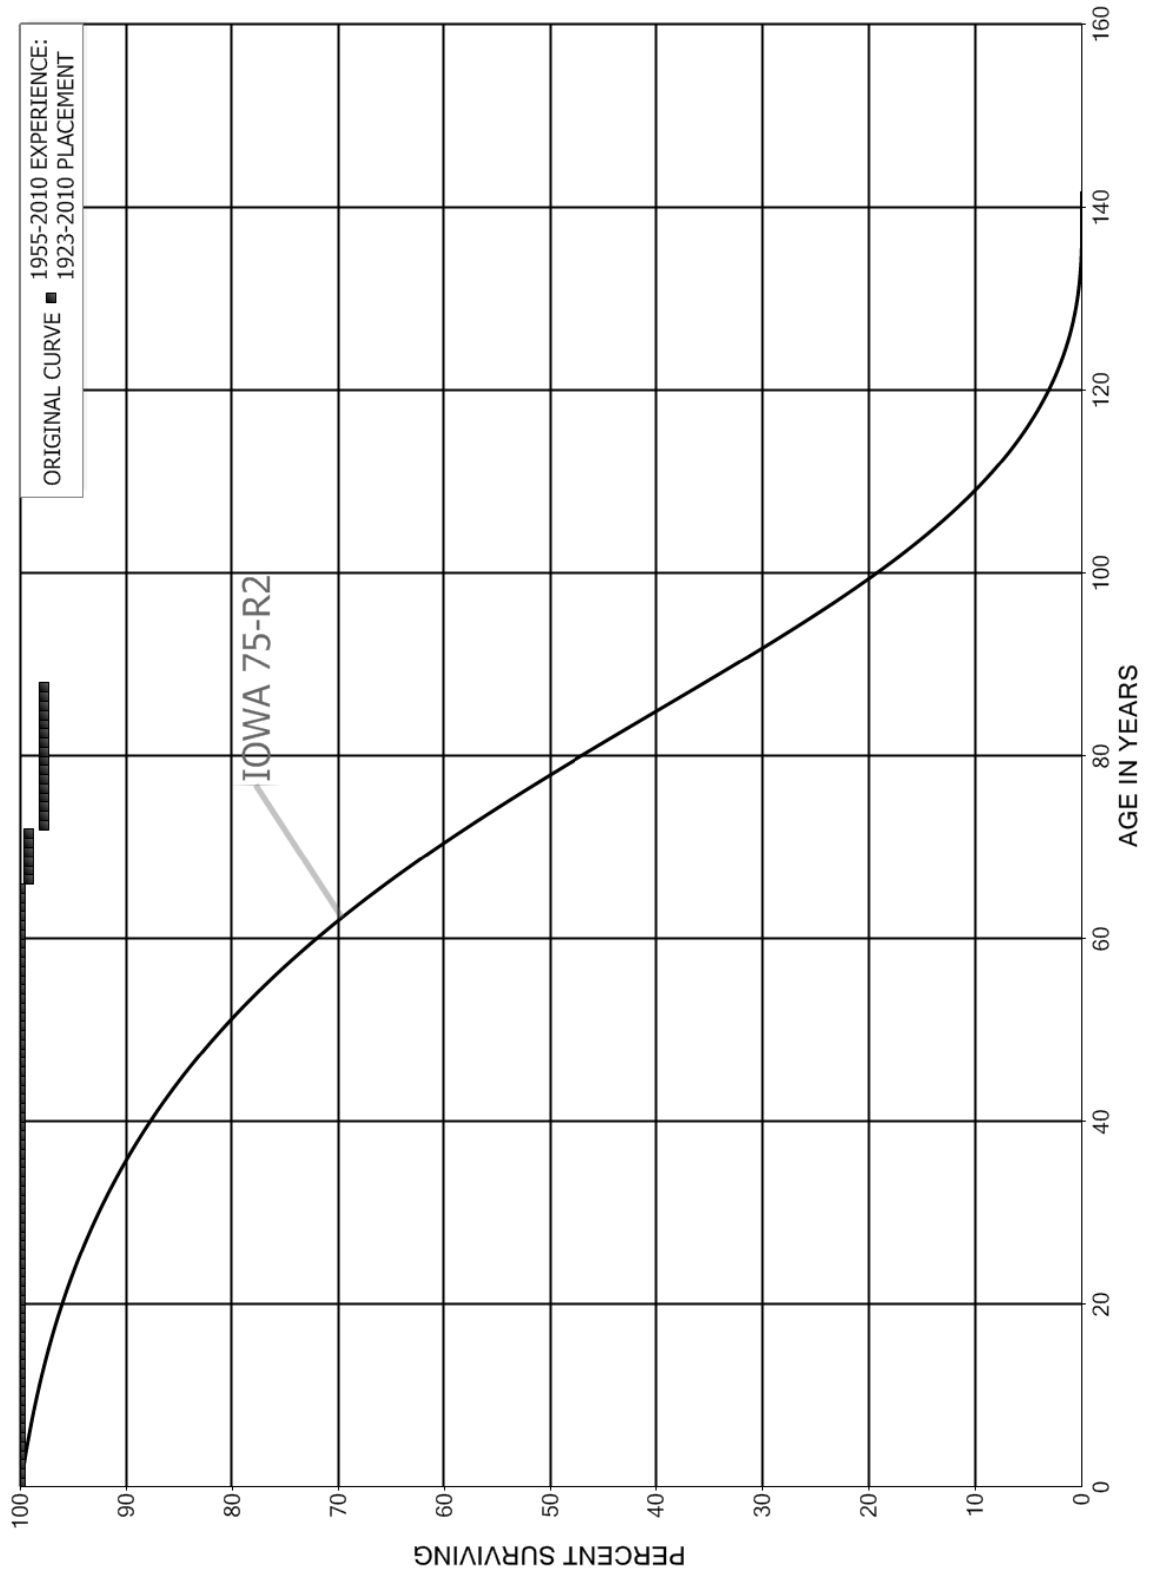

MANITOBA HYDRO

ACCOUNT 000D - SPILLWAY

ORIGINAL LIFE TABLE

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1955-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	369,552,576		0.0000	1.0000	100.00
0.5	369,506,280		0.0000	1.0000	100.00
1.5	366,978,483		0.0000	1.0000	100.00
2.5	366,762,400		0.0000	1.0000	100.00
3.5	366,644,866		0.0000	1.0000	100.00
4.5	365,995,189		0.0000	1.0000	100.00
5.5	365,386,540		0.0000	1.0000	100.00
6.5	365,386,540		0.0000	1.0000	100.00
7.5	365,386,540		0.0000	1.0000	100.00
8.5	365,386,540	1,838	0.0000	1.0000	100.00
9.5	365,384,702		0.0000	1.0000	100.00
10.5	365,384,702		0.0000	1.0000	100.00
11.5	365,384,702		0.0000	1.0000	100.00
12.5	365,355,774		0.0000	1.0000	100.00
13.5	364,377,188		0.0000	1.0000	100.00
14.5	364,377,188		0.0000	1.0000	100.00
15.5	363,467,145		0.0000	1.0000	100.00
16.5	363,207,008		0.0000	1.0000	100.00
17.5	322,517,032		0.0000	1.0000	100.00
18.5	242,086,562		0.0000	1.0000	100.00
19.5	161,656,093		0.0000	1.0000	100.00
20.5	161,656,093		0.0000	1.0000	100.00
21.5	161,656,093		0.0000	1.0000	100.00
22.5	162,728,053		0.0000	1.0000	100.00
23.5	162,728,053		0.0000	1.0000	100.00
24.5	153,113,204		0.0000	1.0000	100.00
25.5	153,130,509		0.0000	1.0000	100.00
26.5	152,492,998		0.0000	1.0000	100.00
27.5	152,492,998		0.0000	1.0000	100.00
28.5	152,492,998		0.0000	1.0000	100.00
29.5	152,492,998		0.0000	1.0000	100.00
30.5	152,492,998		0.0000	1.0000	100.00
31.5	110,724,015		0.0000	1.0000	100.00
32.5	39,517,819		0.0000	1.0000	100.00
33.5	39,517,819		0.0000	1.0000	100.00
34.5	39,517,819		0.0000	1.0000	100.00
35.5	39,517,819		0.0000	1.0000	100.00
36.5	39,517,819		0.0000	1.0000	100.00
37.5	14,110,860		0.0000	1.0000	100.00
38.5	14,110,860		0.0000	1.0000	100.00

MANITOBA HYDRO

ACCOUNT 000D - SPILLWAY

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1955-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
39.5	14,110,860		0.0000	1.0000	100.00
40.5	14,110,860		0.0000	1.0000	100.00
41.5	12,809,593		0.0000	1.0000	100.00
42.5	12,809,593		0.0000	1.0000	100.00
43.5	12,809,593		0.0000	1.0000	100.00
44.5	8,802,525		0.0000	1.0000	100.00
45.5	8,802,525		0.0000	1.0000	100.00
46.5	8,802,525		0.0000	1.0000	100.00
47.5	8,802,525		0.0000	1.0000	100.00
48.5	8,802,525		0.0000	1.0000	100.00
49.5	3,470,596		0.0000	1.0000	100.00
50.5	3,470,596		0.0000	1.0000	100.00
51.5	3,470,596		0.0000	1.0000	100.00
52.5	3,470,596		0.0000	1.0000	100.00
53.5	3,470,596		0.0000	1.0000	100.00
54.5	3,470,596		0.0000	1.0000	100.00
55.5	1,119,158		0.0000	1.0000	100.00
56.5	1,119,158		0.0000	1.0000	100.00
57.5	1,119,158		0.0000	1.0000	100.00
58.5	1,119,158		0.0000	1.0000	100.00
59.5	1,119,158		0.0000	1.0000	100.00
60.5	1,119,158		0.0000	1.0000	100.00
61.5	1,119,158		0.0000	1.0000	100.00
62.5	1,119,158		0.0000	1.0000	100.00
63.5	1,119,158		0.0000	1.0000	100.00
64.5	1,119,158		0.0000	1.0000	100.00
65.5	1,119,158	9,446	0.0084	0.9916	100.00
66.5	1,109,711		0.0000	1.0000	99.16
67.5	1,109,711		0.0000	1.0000	99.16
68.5	1,109,711		0.0000	1.0000	99.16
69.5	1,109,711		0.0000	1.0000	99.16
70.5	1,109,711		0.0000	1.0000	99.16
71.5	1,109,711	16,317	0.0147	0.9853	99.16
72.5	1,093,394		0.0000	1.0000	97.70
73.5	1,093,394		0.0000	1.0000	97.70
74.5	1,093,394		0.0000	1.0000	97.70
75.5	1,093,394		0.0000	1.0000	97.70
76.5	1,093,394		0.0000	1.0000	97.70
77.5	1,093,394		0.0000	1.0000	97.70
78.5	21,434		0.0000	1.0000	97.70


MANITOBA HYDRO

ACCOUNT 000D - SPILLWAY

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1955-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
79.5	21,434		0.0000	1.0000	97.70
80.5	21,434		0.0000	1.0000	97.70
81.5	13,575		0.0000	1.0000	97.70
82.5	13,575		0.0000	1.0000	97.70
83.5	13,575		0.0000	1.0000	97.70
84.5	13,575		0.0000	1.0000	97.70
85.5	13,575		0.0000	1.0000	97.70
86.5	13,575		0.0000	1.0000	97.70
87.5					97.70

MANITOBA HYDRO
ACCOUNT 000E - WATER CONTROL SYSTEMS
ORIGINAL AND SMOOTH SURVIVOR CURVES

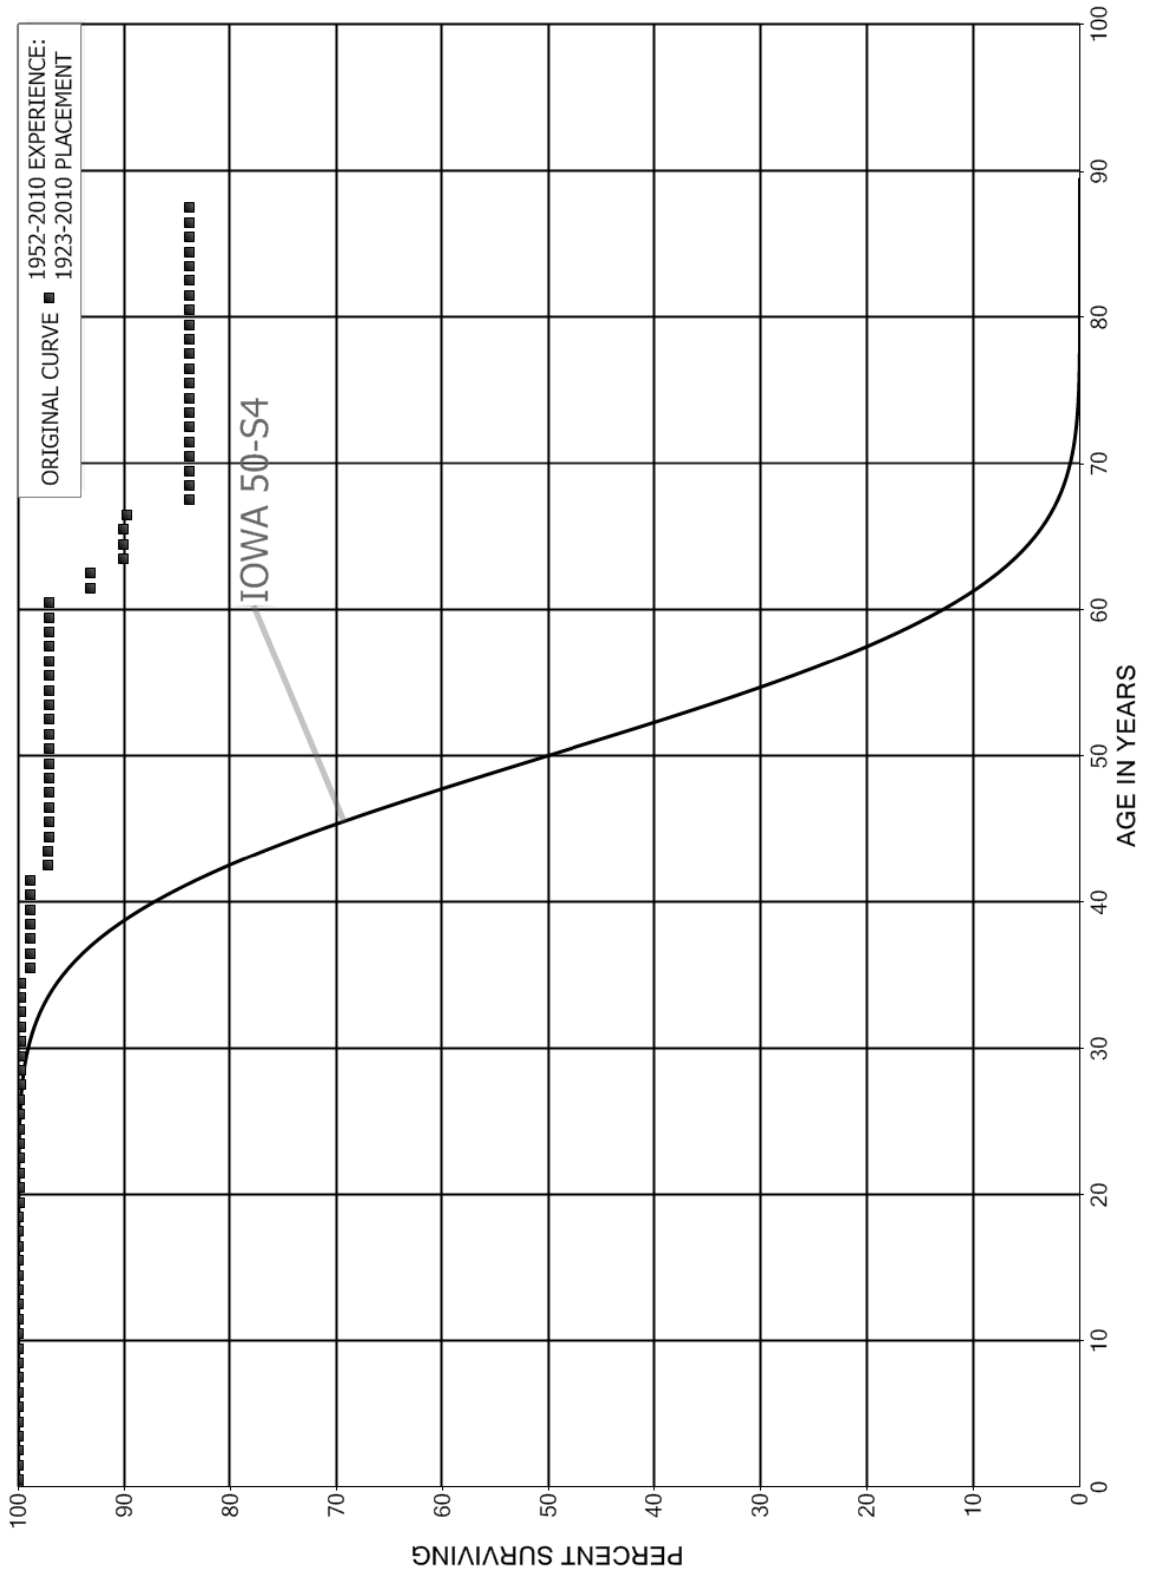

MANITOBA HYDRO

ACCOUNT 000E - WATER CONTROL SYSTEMS

ORIGINAL LIFE TABLE

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1952-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	302,547,761		0.0000	1.0000	100.00
0.5	299,441,967	312,000	0.0010	0.9990	100.00
1.5	298,993,682		0.0000	1.0000	99.90
2.5	296,326,623		0.0000	1.0000	99.90
3.5	294,173,590		0.0000	1.0000	99.90
4.5	292,201,331		0.0000	1.0000	99.90
5.5	285,893,574		0.0000	1.0000	99.90
6.5	281,469,435		0.0000	1.0000	99.90
7.5	280,642,804		0.0000	1.0000	99.90
8.5	280,161,201		0.0000	1.0000	99.90
9.5	279,565,026		0.0000	1.0000	99.90
10.5	278,586,784		0.0000	1.0000	99.90
11.5	277,229,730		0.0000	1.0000	99.90
12.5	274,353,103		0.0000	1.0000	99.90
13.5	273,679,962		0.0000	1.0000	99.90
14.5	273,479,481		0.0000	1.0000	99.90
15.5	268,126,237		0.0000	1.0000	99.90
16.5	268,126,237		0.0000	1.0000	99.90
17.5	236,942,009		0.0000	1.0000	99.90
18.5	189,419,936	108,000	0.0006	0.9994	99.90
19.5	141,889,887		0.0000	1.0000	99.84
20.5	141,704,557		0.0000	1.0000	99.84
21.5	141,704,557		0.0000	1.0000	99.84
22.5	141,911,125		0.0000	1.0000	99.84
23.5	141,986,981		0.0000	1.0000	99.84
24.5	130,087,378		0.0000	1.0000	99.84
25.5	130,087,378	6,649	0.0001	0.9999	99.84
26.5	129,797,744	132,000	0.0010	0.9990	99.83
27.5	129,701,874		0.0000	1.0000	99.73
28.5	129,899,061	22,899	0.0002	0.9998	99.73
29.5	129,859,532		0.0000	1.0000	99.71
30.5	129,859,532		0.0000	1.0000	99.71
31.5	71,979,265	1,431	0.0000	1.0000	99.71
32.5	38,874,975		0.0000	1.0000	99.71
33.5	38,874,975		0.0000	1.0000	99.71
34.5	38,825,083	322,000	0.0083	0.9917	99.71
35.5	38,313,578		0.0000	1.0000	98.89
36.5	38,313,578		0.0000	1.0000	98.89
37.5	20,539,319	673	0.0000	1.0000	98.89
38.5	20,538,647		0.0000	1.0000	98.88

MANITOBA HYDRO

ACCOUNT 000E - WATER CONTROL SYSTEMS

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1952-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
39.5	20,029,017		0.0000	1.0000	98.88
40.5	19,834,767		0.0000	1.0000	98.88
41.5	18,229,923	321,722	0.0176	0.9824	98.88
42.5	17,908,201		0.0000	1.0000	97.14
43.5	17,889,336	4,933	0.0003	0.9997	97.14
44.5	7,702,557		0.0000	1.0000	97.11
45.5	7,702,557		0.0000	1.0000	97.11
46.5	7,702,557		0.0000	1.0000	97.11
47.5	7,695,810		0.0000	1.0000	97.11
48.5	7,695,810		0.0000	1.0000	97.11
49.5	3,947,007		0.0000	1.0000	97.11
50.5	3,947,007		0.0000	1.0000	97.11
51.5	3,943,313		0.0000	1.0000	97.11
52.5	3,943,313		0.0000	1.0000	97.11
53.5	3,931,348		0.0000	1.0000	97.11
54.5	3,928,984		0.0000	1.0000	97.11
55.5	2,977,551		0.0000	1.0000	97.11
56.5	2,977,551		0.0000	1.0000	97.11
57.5	2,977,551		0.0000	1.0000	97.11
58.5	1,608,288		0.0000	1.0000	97.11
59.5	1,453,478		0.0000	1.0000	97.11
60.5	1,378,970	55,273	0.0401	0.9599	97.11
61.5	1,323,697		0.0000	1.0000	93.22
62.5	1,323,697	44,918	0.0339	0.9661	93.22
63.5	1,278,779		0.0000	1.0000	90.05
64.5	1,278,779		0.0000	1.0000	90.05
65.5	1,278,779	4,369	0.0034	0.9966	90.05
66.5	1,274,410	84,443	0.0663	0.9337	89.75
67.5	1,189,968		0.0000	1.0000	83.80
68.5	1,189,968		0.0000	1.0000	83.80
69.5	1,189,968		0.0000	1.0000	83.80
70.5	1,189,968		0.0000	1.0000	83.80
71.5	1,189,968		0.0000	1.0000	83.80
72.5	1,189,968		0.0000	1.0000	83.80
73.5	1,189,968		0.0000	1.0000	83.80
74.5	1,189,968		0.0000	1.0000	83.80
75.5	1,189,968		0.0000	1.0000	83.80
76.5	1,189,968		0.0000	1.0000	83.80
77.5	1,189,968		0.0000	1.0000	83.80
78.5	407,155		0.0000	1.0000	83.80


MANITOBA HYDRO

ACCOUNT 000E - WATER CONTROL SYSTEMS

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1952-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
79.5	407,155		0.0000	1.0000	83.80
80.5	407,155		0.0000	1.0000	83.80
81.5	255,860		0.0000	1.0000	83.80
82.5	180,004		0.0000	1.0000	83.80
83.5	138,900		0.0000	1.0000	83.80
84.5	138,900		0.0000	1.0000	83.80
85.5	138,900		0.0000	1.0000	83.80
86.5	107,139		0.0000	1.0000	83.80
87.5					83.80

MANITOBA HYDRO
ACCOUNT 000F - ROADS AND SITE IMPROVEMENTS
ORIGINAL AND SMOOTH SURVIVOR CURVES

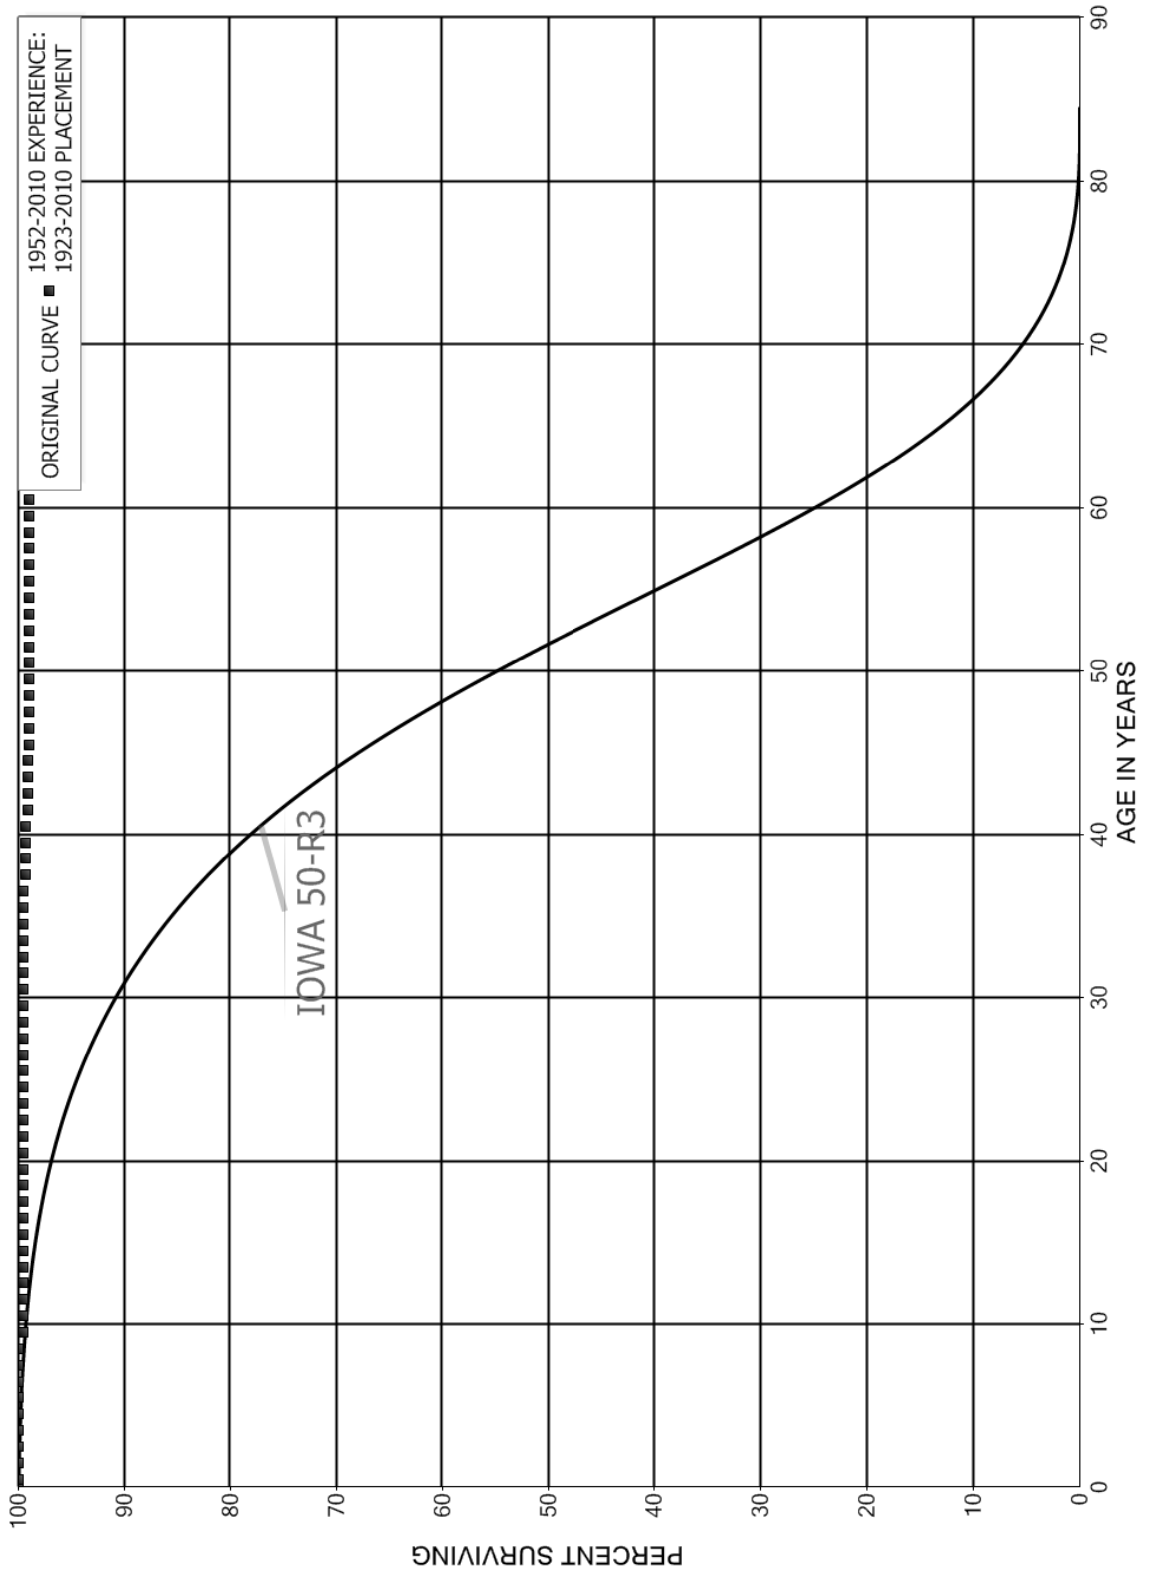

MANITOBA HYDRO

ACCOUNT 000F - ROADS AND SITE IMPROVEMENTS

ORIGINAL LIFE TABLE

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1952-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	71,116,676		0.0000	1.0000	100.00
0.5	71,034,889		0.0000	1.0000	100.00
1.5	70,687,581		0.0000	1.0000	100.00
2.5	70,345,308		0.0000	1.0000	100.00
3.5	70,277,857	9,613	0.0001	0.9999	100.00
4.5	69,069,776	10,898	0.0002	0.9998	99.99
5.5	68,781,980		0.0000	1.0000	99.97
6.5	66,932,725		0.0000	1.0000	99.97
7.5	66,926,872		0.0000	1.0000	99.97
8.5	66,816,165	331,511	0.0050	0.9950	99.97
9.5	66,432,021		0.0000	1.0000	99.47
10.5	65,970,457		0.0000	1.0000	99.47
11.5	65,801,447		0.0000	1.0000	99.47
12.5	64,352,614		0.0000	1.0000	99.47
13.5	63,154,881		0.0000	1.0000	99.47
14.5	60,837,529		0.0000	1.0000	99.47
15.5	59,623,352		0.0000	1.0000	99.47
16.5	59,459,160		0.0000	1.0000	99.47
17.5	55,639,412		0.0000	1.0000	99.47
18.5	48,623,614		0.0000	1.0000	99.47
19.5	41,682,099		0.0000	1.0000	99.47
20.5	39,799,544		0.0000	1.0000	99.47
21.5	39,799,544		0.0000	1.0000	99.47
22.5	39,361,485		0.0000	1.0000	99.47
23.5	39,308,985		0.0000	1.0000	99.47
24.5	31,435,281		0.0000	1.0000	99.47
25.5	31,435,271		0.0000	1.0000	99.47
26.5	31,435,271	301	0.0000	1.0000	99.47
27.5	31,434,969		0.0000	1.0000	99.47
28.5	27,396,804	6,288	0.0002	0.9998	99.47
29.5	27,390,517		0.0000	1.0000	99.45
30.5	27,390,517		0.0000	1.0000	99.45
31.5	16,189,766		0.0000	1.0000	99.45
32.5	8,854,770		0.0000	1.0000	99.45
33.5	8,854,770		0.0000	1.0000	99.45
34.5	8,854,770		0.0000	1.0000	99.45
35.5	8,854,770		0.0000	1.0000	99.45
36.5	8,854,770	12,926	0.0015	0.9985	99.45
37.5	7,156,730		0.0000	1.0000	99.31
38.5	7,156,730		0.0000	1.0000	99.31


MANITOBA HYDRO

ACCOUNT 000F - ROADS AND SITE IMPROVEMENTS

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1952-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
39.5	7,156,507		0.0000	1.0000	99.31
40.5	7,087,772	19,231	0.0027	0.9973	99.31
41.5	6,822,124		0.0000	1.0000	99.04
42.5	6,822,124		0.0000	1.0000	99.04
43.5	6,822,124		0.0000	1.0000	99.04
44.5	4,547,969	4,500	0.0010	0.9990	99.04
45.5	4,543,469		0.0000	1.0000	98.94
46.5	4,543,469		0.0000	1.0000	98.94
47.5	4,543,469		0.0000	1.0000	98.94
48.5	4,539,442		0.0000	1.0000	98.94
49.5	1,189,778		0.0000	1.0000	98.94
50.5	1,189,461		0.0000	1.0000	98.94
51.5	1,152,817		0.0000	1.0000	98.94
52.5	1,020,428		0.0000	1.0000	98.94
53.5	1,020,428		0.0000	1.0000	98.94
54.5	1,020,428		0.0000	1.0000	98.94
55.5	1,006,248		0.0000	1.0000	98.94
56.5	1,006,248		0.0000	1.0000	98.94
57.5	1,006,248		0.0000	1.0000	98.94
58.5	71,393		0.0000	1.0000	98.94
59.5	71,393		0.0000	1.0000	98.94
60.5	71,393		0.0000	1.0000	98.94
61.5	71,393		0.0000	1.0000	98.94
62.5	71,393		0.0000	1.0000	98.94
63.5	71,393		0.0000	1.0000	98.94
64.5	71,393		0.0000	1.0000	98.94
65.5	71,393		0.0000	1.0000	98.94
66.5	71,393		0.0000	1.0000	98.94
67.5	71,393		0.0000	1.0000	98.94
68.5	71,393		0.0000	1.0000	98.94
69.5	71,393		0.0000	1.0000	98.94
70.5	71,393		0.0000	1.0000	98.94
71.5	71,393		0.0000	1.0000	98.94
72.5	71,393		0.0000	1.0000	98.94
73.5	71,393		0.0000	1.0000	98.94
74.5	71,393		0.0000	1.0000	98.94
75.5	71,393		0.0000	1.0000	98.94
76.5	71,393		0.0000	1.0000	98.94
77.5	71,393		0.0000	1.0000	98.94
78.5					

MANITOBA HYDRO
ACCOUNT 000G - TURBINES AND GENERATORS
ORIGINAL AND SMOOTH SURVIVOR CURVES

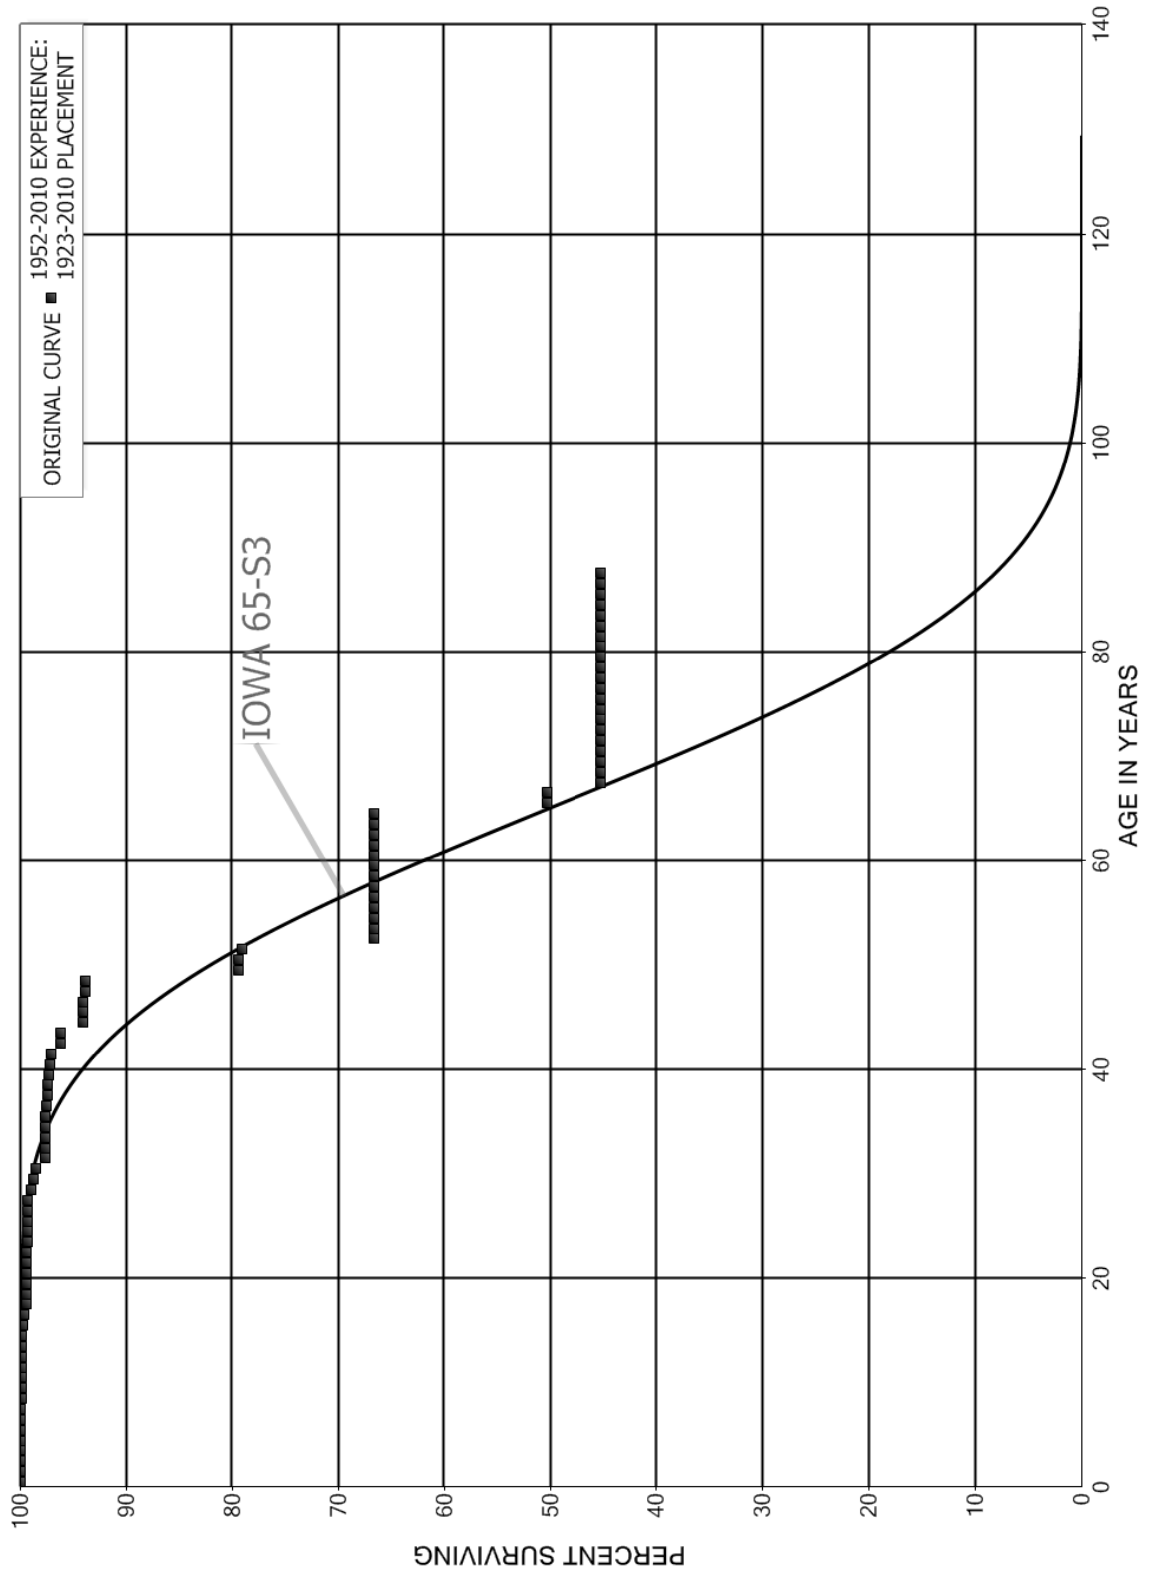

MANITOBA HYDRO

ACCOUNT 000G - TURBINES AND GENERATORS

ORIGINAL LIFE TABLE

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1952-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
0.0	1,130,388,586	133	0.0000	1.0000	100.00	
0.5	1,084,785,194		0.0000	1.0000	100.00	
1.5	1,041,407,763		0.0000	1.0000	100.00	
2.5	986,118,248		0.0000	1.0000	100.00	
3.5	974,388,173		0.0000	1.0000	100.00	
4.5	964,861,553	1,032,258	0.0011	0.9989	100.00	
5.5	941,723,419		0.0000	1.0000	99.89	
6.5	919,710,565		0.0000	1.0000	99.89	
7.5	890,264,595	38,023	0.0000	1.0000	99.89	
8.5	861,537,455	3,212	0.0000	1.0000	99.89	
9.5	860,410,095		0.0000	1.0000	99.89	
10.5	843,402,030		0.0000	1.0000	99.89	
11.5	829,786,579		0.0000	1.0000	99.89	
12.5	801,221,629	93,258	0.0001	0.9999	99.89	
13.5	799,270,959	465,678	0.0006	0.9994	99.88	
14.5	771,160,691	1,013,211	0.0013	0.9987	99.82	
15.5	764,013,247	244,117	0.0003	0.9997	99.69	
16.5	746,591,563	1,825,978	0.0024	0.9976	99.66	
17.5	661,858,674	52,620	0.0001	0.9999	99.41	
18.5	499,399,637	17,507	0.0000	1.0000	99.40	
19.5	338,695,013	65,863	0.0002	0.9998	99.40	
20.5	338,606,167	13,497	0.0000	1.0000	99.38	
21.5	338,557,980	28,938	0.0001	0.9999	99.38	
22.5	336,658,011	203,028	0.0006	0.9994	99.37	
23.5	337,100,568	76,471	0.0002	0.9998	99.31	
24.5	334,703,806		0.0000	1.0000	99.29	
25.5	334,690,404		0.0000	1.0000	99.29	
26.5	331,569,195		0.0000	1.0000	99.29	
27.5	331,571,968	1,301,220	0.0039	0.9961	99.29	
28.5	331,274,701	641,921	0.0019	0.9981	98.90	
29.5	330,632,780	622,558	0.0019	0.9981	98.70	
30.5	330,010,222	3,111,335	0.0094	0.9906	98.52	
31.5	187,440,225	316	0.0000	1.0000	97.59	
32.5	119,830,290	316	0.0000	1.0000	97.59	
33.5	119,829,716		0.0000	1.0000	97.59	
34.5	119,232,822	5,048	0.0000	1.0000	97.59	
35.5	119,184,347	117,163	0.0010	0.9990	97.59	
36.5	119,067,184	49,198	0.0004	0.9996	97.49	
37.5	53,094,379		0.0000	1.0000	97.45	
38.5	53,085,187	64,666	0.0012	0.9988	97.45	

MANITOBA HYDRO

ACCOUNT 000G - TURBINES AND GENERATORS

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1952-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
39.5	53,016,835	107,764	0.0020	0.9980	97.33
40.5	46,235,986	6,632	0.0001	0.9999	97.13
41.5	44,199,494	452,852	0.0102	0.9898	97.12
42.5	43,150,296		0.0000	1.0000	96.12
43.5	43,031,375	914,047	0.0212	0.9788	96.12
44.5	35,291,779		0.0000	1.0000	94.08
45.5	35,268,614		0.0000	1.0000	94.08
46.5	35,237,788	86,595	0.0025	0.9975	94.08
47.5	35,151,193		0.0000	1.0000	93.85
48.5	35,151,193	5,432,541	0.1545	0.8455	93.85
49.5	21,464,258		0.0000	1.0000	79.35
50.5	21,444,370	84,744	0.0040	0.9960	79.35
51.5	21,345,998	3,364,869	0.1576	0.8424	79.03
52.5	17,971,452		0.0000	1.0000	66.57
53.5	17,962,418		0.0000	1.0000	66.57
54.5	16,063,141		0.0000	1.0000	66.57
55.5	12,897,690		0.0000	1.0000	66.57
56.5	12,897,690		0.0000	1.0000	66.57
57.5	8,186,695		0.0000	1.0000	66.57
58.5	7,695,913		0.0000	1.0000	66.57
59.5	6,741,254		0.0000	1.0000	66.57
60.5	5,831,550		0.0000	1.0000	66.57
61.5	5,831,550		0.0000	1.0000	66.57
62.5	5,831,550		0.0000	1.0000	66.57
63.5	5,831,550		0.0000	1.0000	66.57
64.5	5,831,550	1,430,635	0.2453	0.7547	66.57
65.5	4,400,914		0.0000	1.0000	50.24
66.5	4,400,914	446,550	0.1015	0.8985	50.24
67.5	3,954,364		0.0000	1.0000	45.14
68.5	3,954,364		0.0000	1.0000	45.14
69.5	3,954,364		0.0000	1.0000	45.14
70.5	3,954,364		0.0000	1.0000	45.14
71.5	3,954,364		0.0000	1.0000	45.14
72.5	3,954,364		0.0000	1.0000	45.14
73.5	3,954,364		0.0000	1.0000	45.14
74.5	3,954,364		0.0000	1.0000	45.14
75.5	3,954,364		0.0000	1.0000	45.14
76.5	3,954,364		0.0000	1.0000	45.14
77.5	3,954,364		0.0000	1.0000	45.14
78.5	2,961,486		0.0000	1.0000	45.14


MANITOBA HYDRO

ACCOUNT 000G - TURBINES AND GENERATORS

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1952-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
79.5	2,961,486		0.0000	1.0000	45.14
80.5	2,961,486		0.0000	1.0000	45.14
81.5	2,088,881		0.0000	1.0000	45.14
82.5	1,448,348		0.0000	1.0000	45.14
83.5	885,533		0.0000	1.0000	45.14
84.5	885,533		0.0000	1.0000	45.14
85.5	885,533		0.0000	1.0000	45.14
86.5	882,760		0.0000	1.0000	45.14
87.5					45.14

MANITOBA HYDRO
ACCOUNT 000H - GOVERNORS AND EXCITATION SYSTEM
ORIGINAL AND SMOOTH SURVIVOR CURVES

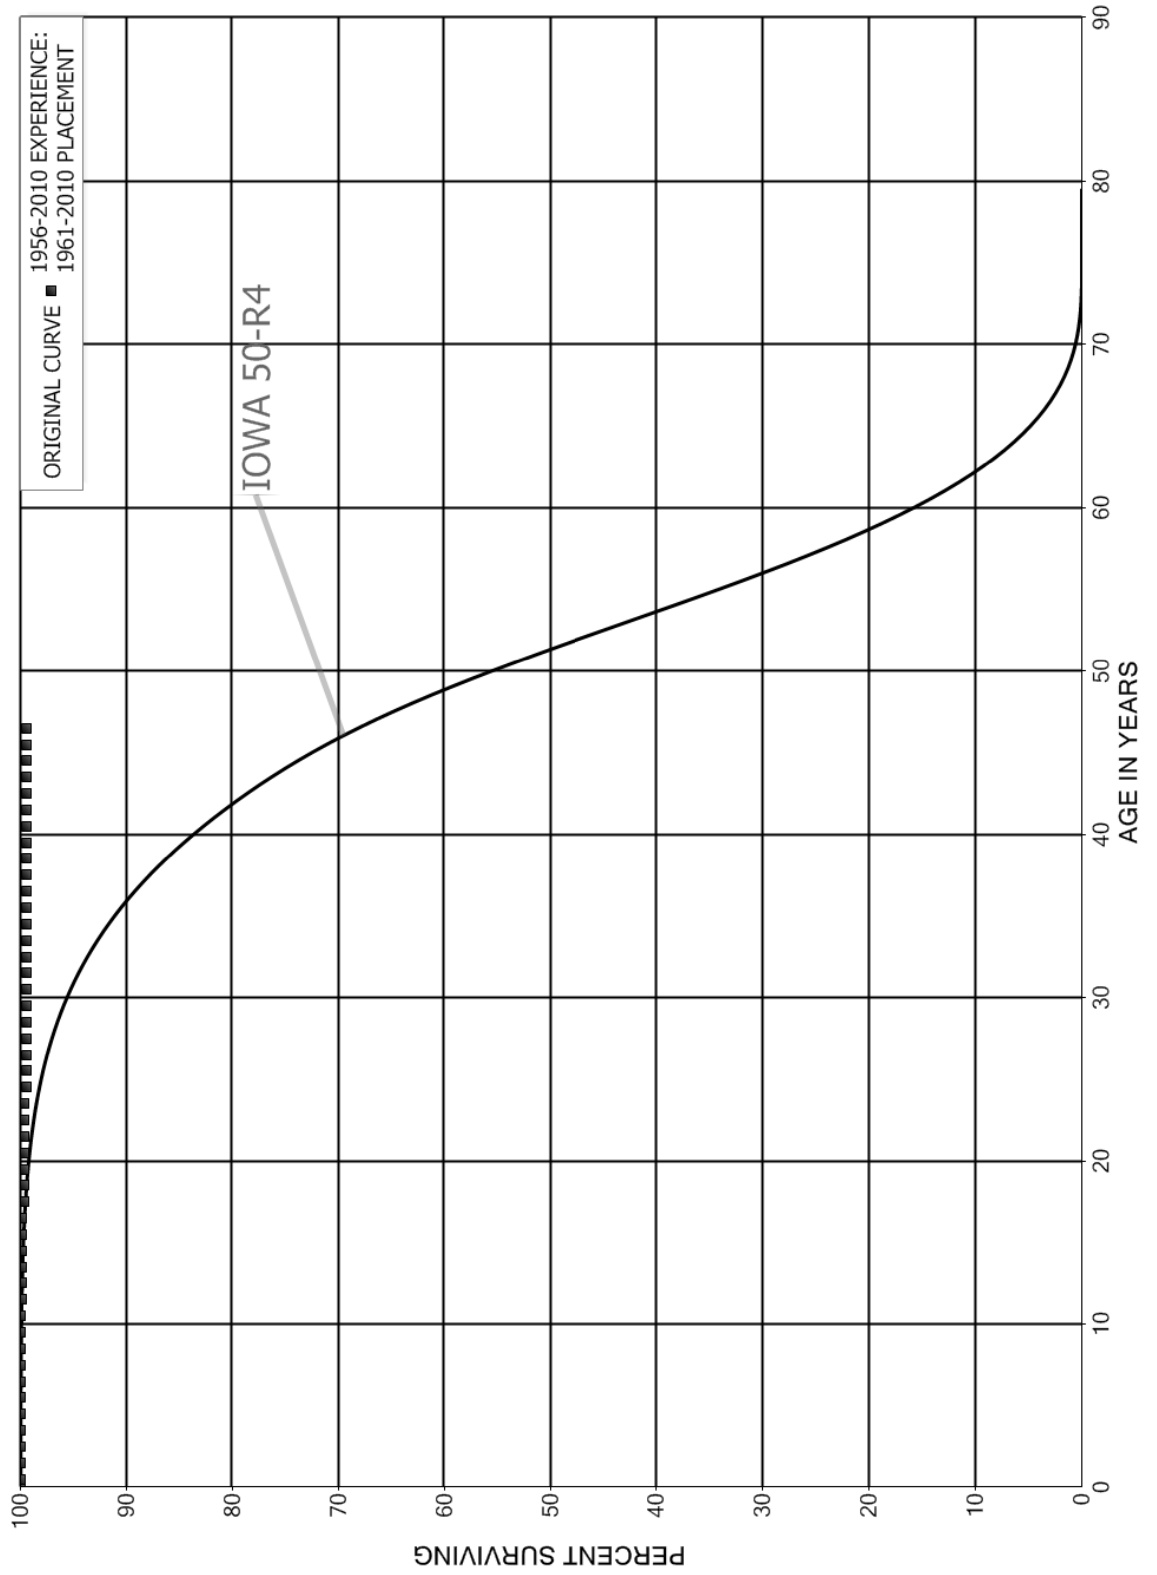

MANITOBA HYDRO

ACCOUNT 000H - GOVERNORS AND EXCITATION SYSTEM

ORIGINAL LIFE TABLE

PLACEMENT BAND 1961-2010			EXPERIENCE BAND 1956-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	24,008,785		0.0000	1.0000	100.00
0.5	24,006,360		0.0000	1.0000	100.00
1.5	23,343,940		0.0000	1.0000	100.00
2.5	23,248,742		0.0000	1.0000	100.00
3.5	23,246,742		0.0000	1.0000	100.00
4.5	23,222,481		0.0000	1.0000	100.00
5.5	23,222,481		0.0000	1.0000	100.00
6.5	22,589,932		0.0000	1.0000	100.00
7.5	22,589,932		0.0000	1.0000	100.00
8.5	22,589,932		0.0000	1.0000	100.00
9.5	22,589,932		0.0000	1.0000	100.00
10.5	20,246,071	38,908	0.0019	0.9981	100.00
11.5	19,971,141		0.0000	1.0000	99.81
12.5	19,832,512		0.0000	1.0000	99.81
13.5	19,743,861		0.0000	1.0000	99.81
14.5	19,743,861		0.0000	1.0000	99.81
15.5	19,743,861		0.0000	1.0000	99.81
16.5	19,743,861	44,433	0.0023	0.9977	99.81
17.5	16,378,470		0.0000	1.0000	99.58
18.5	9,840,837		0.0000	1.0000	99.58
19.5	3,303,204		0.0000	1.0000	99.58
20.5	3,303,204		0.0000	1.0000	99.58
21.5	3,303,204		0.0000	1.0000	99.58
22.5	3,303,204		0.0000	1.0000	99.58
23.5	3,303,204	6,685	0.0020	0.9980	99.58
24.5	3,296,520		0.0000	1.0000	99.38
25.5	3,296,520		0.0000	1.0000	99.38
26.5	2,757,139		0.0000	1.0000	99.38
27.5	2,757,139		0.0000	1.0000	99.38
28.5	2,757,139		0.0000	1.0000	99.38
29.5	2,757,139		0.0000	1.0000	99.38
30.5	2,757,139		0.0000	1.0000	99.38
31.5	2,757,139		0.0000	1.0000	99.38
32.5	2,757,139		0.0000	1.0000	99.38
33.5	2,757,139		0.0000	1.0000	99.38
34.5	2,757,139		0.0000	1.0000	99.38
35.5	2,757,139		0.0000	1.0000	99.38
36.5	2,757,139		0.0000	1.0000	99.38
37.5	27,029		0.0000	1.0000	99.38
38.5	27,029		0.0000	1.0000	99.38


MANITOBA HYDRO

ACCOUNT 000H - GOVERNORS AND EXCITATION SYSTEM

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1961-2010			EXPERIENCE BAND 1956-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
39.5	23,741		0.0000	1.0000	99.38
40.5	23,741		0.0000	1.0000	99.38
41.5	6,860		0.0000	1.0000	99.38
42.5	6,860		0.0000	1.0000	99.38
43.5	6,860		0.0000	1.0000	99.38
44.5	6,860		0.0000	1.0000	99.38
45.5	6,860		0.0000	1.0000	99.38
46.5					99.38

MANITOBA HYDRO
ACCOUNT 000J - STEAM GENERATOR AND AUXILIARIES
ORIGINAL AND SMOOTH SURVIVOR CURVES

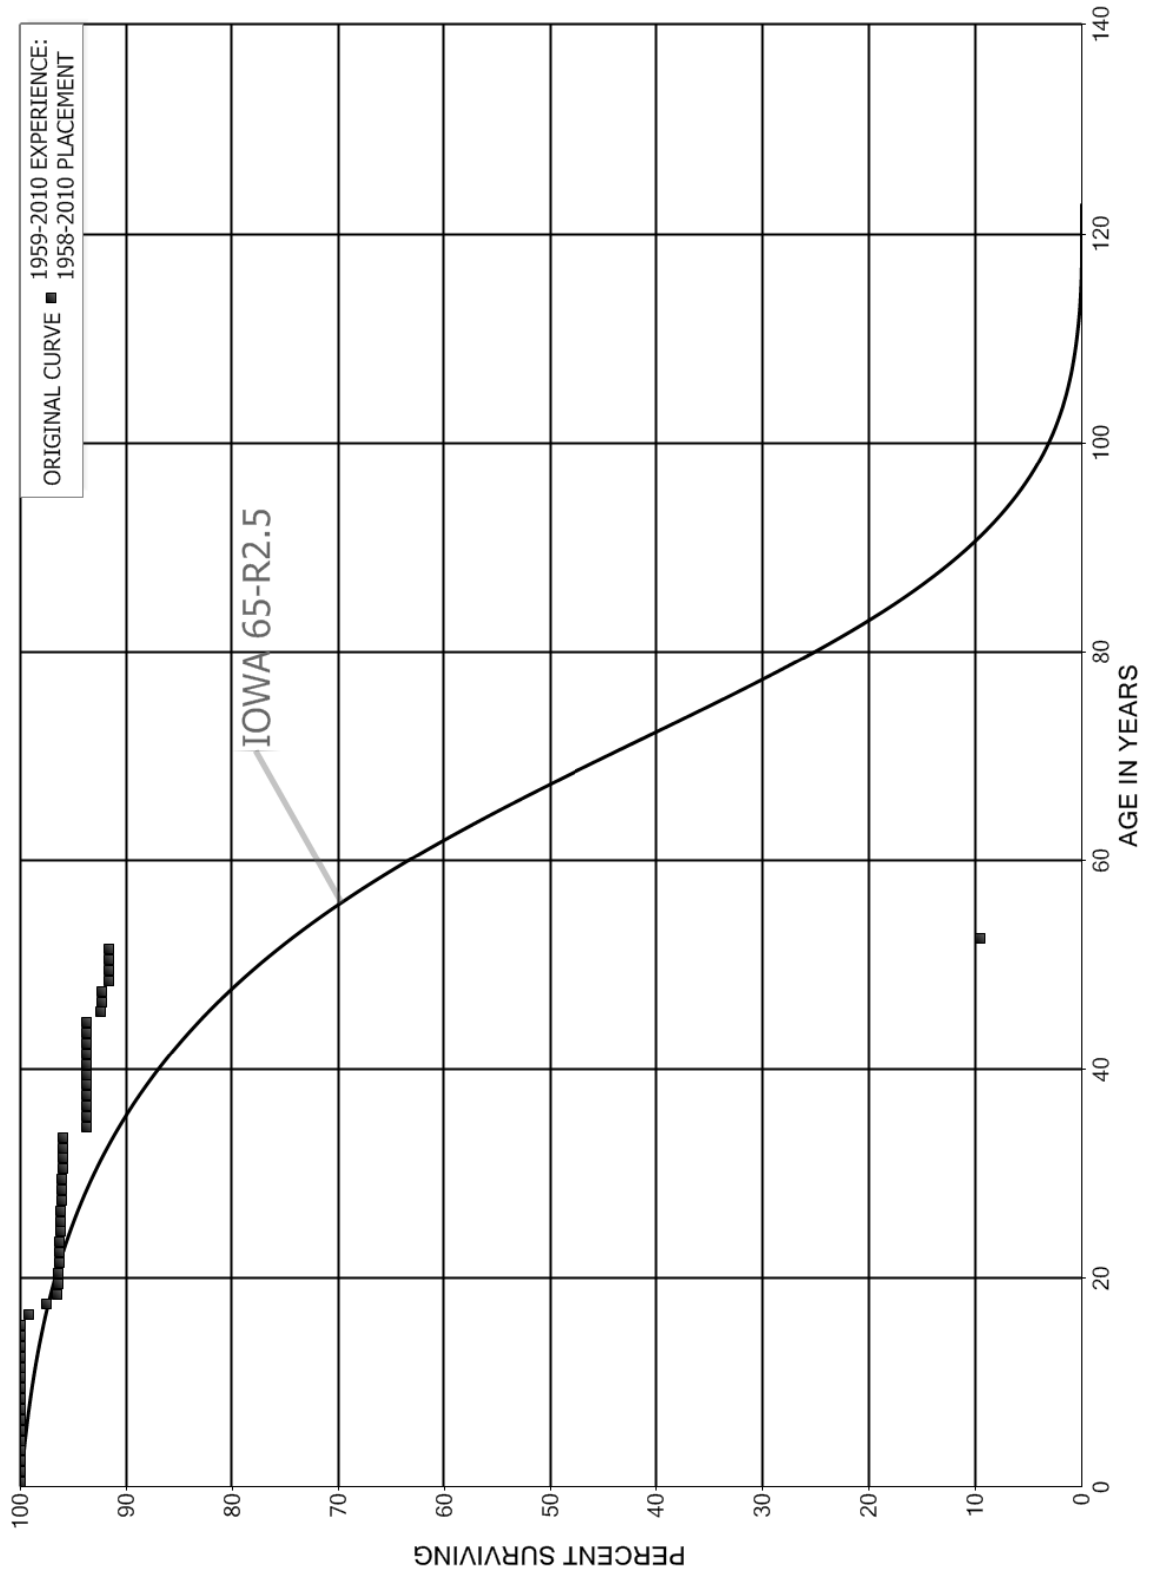

MANITOBA HYDRO

ACCOUNT 000J - STEAM GENERATOR AND AUXILIARIES

ORIGINAL LIFE TABLE

PLACEMENT BAND 1958-2010			EXPERIENCE BAND 1959-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	80,424,305	75,254	0.0009	0.9991	100.00
0.5	74,101,370		0.0000	1.0000	99.91
1.5	72,656,341		0.0000	1.0000	99.91
2.5	72,636,303		0.0000	1.0000	99.91
3.5	72,345,303		0.0000	1.0000	99.91
4.5	72,339,831	1,800	0.0000	1.0000	99.91
5.5	71,319,413		0.0000	1.0000	99.90
6.5	71,212,402		0.0000	1.0000	99.90
7.5	46,023,359		0.0000	1.0000	99.90
8.5	42,596,882		0.0000	1.0000	99.90
9.5	34,404,254		0.0000	1.0000	99.90
10.5	33,986,498		0.0000	1.0000	99.90
11.5	33,660,617		0.0000	1.0000	99.90
12.5	33,160,252	261	0.0000	1.0000	99.90
13.5	33,116,840		0.0000	1.0000	99.90
14.5	29,205,710	3,104	0.0001	0.9999	99.90
15.5	24,782,246	182,238	0.0074	0.9926	99.89
16.5	23,293,619	378,928	0.0163	0.9837	99.16
17.5	21,549,285	233,442	0.0108	0.9892	97.54
18.5	21,137,094	25,134	0.0012	0.9988	96.49
19.5	21,111,960		0.0000	1.0000	96.37
20.5	21,111,960	8,500	0.0004	0.9996	96.37
21.5	21,067,116	12,739	0.0006	0.9994	96.33
22.5	21,054,376		0.0000	1.0000	96.28
23.5	21,054,376	17,425	0.0008	0.9992	96.28
24.5	21,036,952		0.0000	1.0000	96.20
25.5	21,011,617		0.0000	1.0000	96.20
26.5	20,770,348	21,314	0.0010	0.9990	96.20
27.5	20,446,224		0.0000	1.0000	96.10
28.5	20,439,405		0.0000	1.0000	96.10
29.5	20,439,405	40,118	0.0020	0.9980	96.10
30.5	20,202,204		0.0000	1.0000	95.91
31.5	19,983,232		0.0000	1.0000	95.91
32.5	19,900,128		0.0000	1.0000	95.91
33.5	19,900,128	456,792	0.0230	0.9770	95.91
34.5	19,440,304		0.0000	1.0000	93.71
35.5	19,440,304		0.0000	1.0000	93.71
36.5	19,368,281		0.0000	1.0000	93.71
37.5	19,368,281		0.0000	1.0000	93.71
38.5	19,368,281		0.0000	1.0000	93.71


MANITOBA HYDRO

ACCOUNT 000J - STEAM GENERATOR AND AUXILIARIES

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1958-2010			EXPERIENCE BAND 1959-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
39.5	19,368,281		0.0000	1.0000	93.71
40.5	12,522,038		0.0000	1.0000	93.71
41.5	12,522,038		0.0000	1.0000	93.71
42.5	12,522,038		0.0000	1.0000	93.71
43.5	11,219,557		0.0000	1.0000	93.71
44.5	11,219,557	156,068	0.0139	0.9861	93.71
45.5	11,063,489	19,766	0.0018	0.9982	92.40
46.5	11,043,723		0.0000	1.0000	92.24
47.5	11,027,615	77,069	0.0070	0.9930	92.24
48.5	10,934,114		0.0000	1.0000	91.59
49.5	4,317,375		0.0000	1.0000	91.59
50.5	4,317,375		0.0000	1.0000	91.59
51.5	4,316,641	3,867,271	0.8959	0.1041	91.59
52.5					9.54

MANITOBA HYDRO
ACCOUNT 000K - COMBUSTION TURBINE
ORIGINAL AND SMOOTH SURVIVOR CURVES

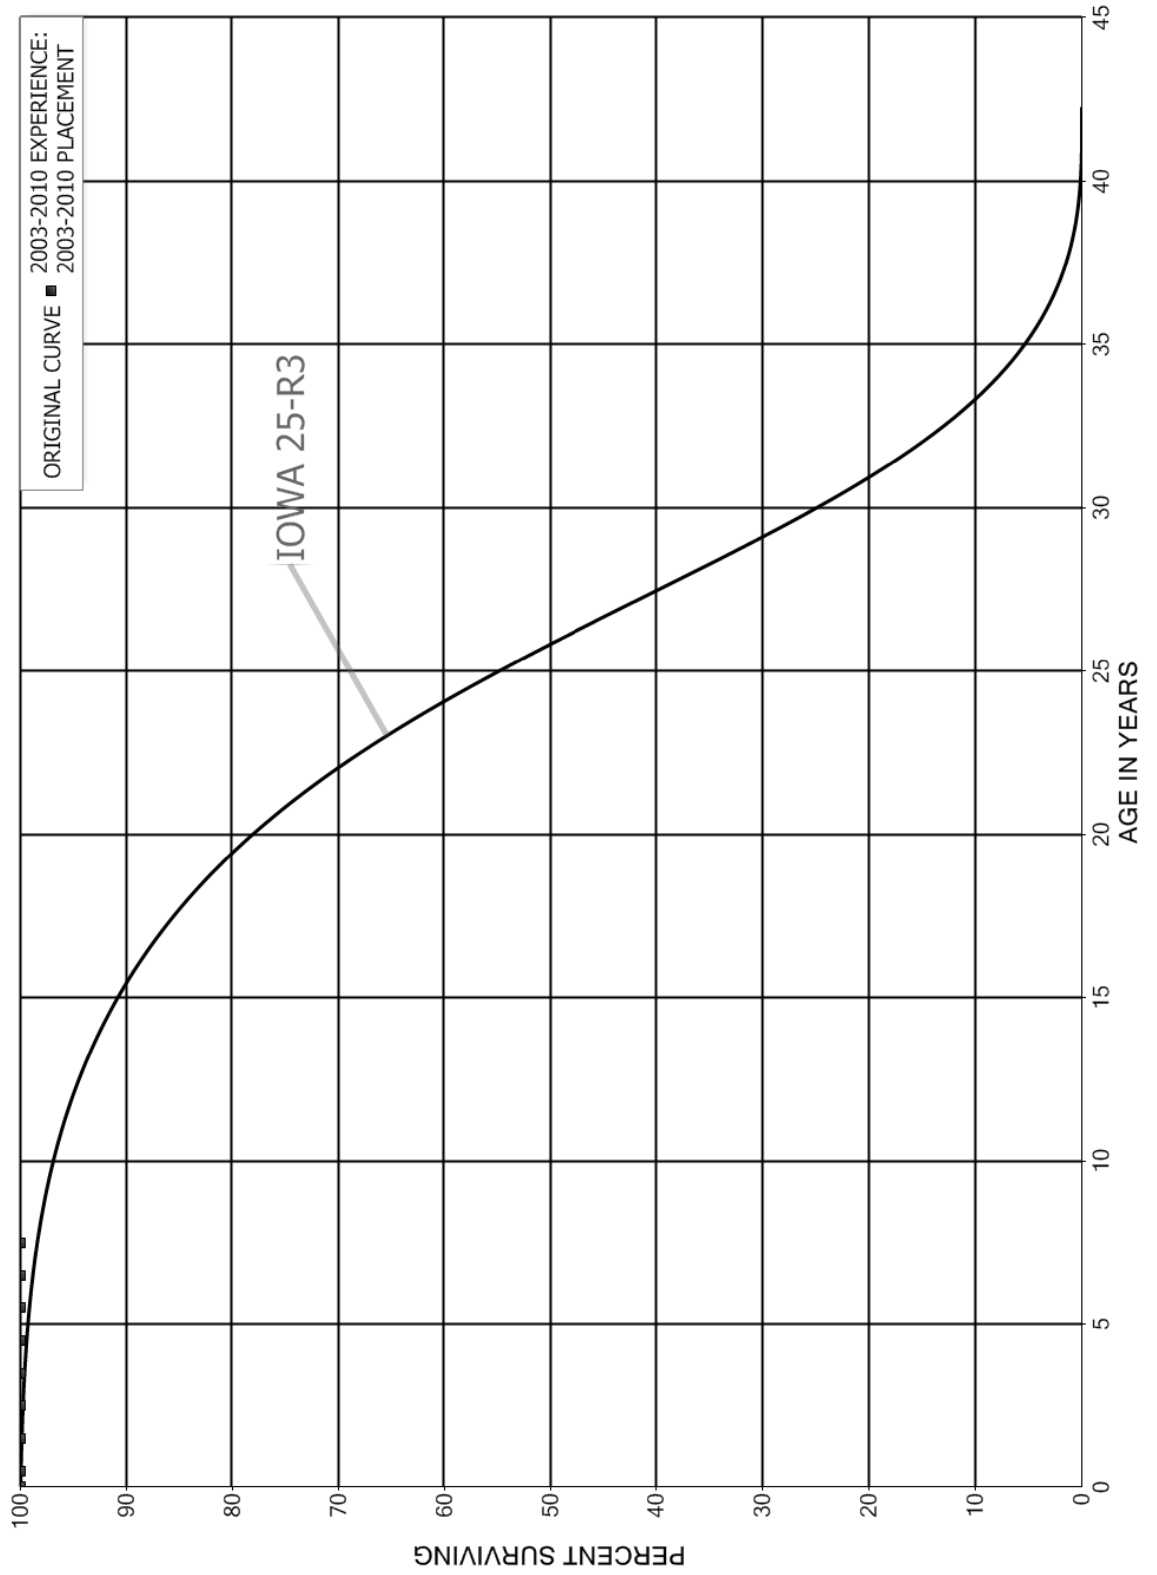


MANITOBA HYDRO

ACCOUNT 000K - COMBUSTION TURBINE

ORIGINAL LIFE TABLE

PLACEMENT BAND 2003-2010			EXPERIENCE BAND 2003-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	143,311,694		0.0000	1.0000	100.00
0.5	139,616,533	1,603	0.0000	1.0000	100.00
1.5	137,919,300		0.0000	1.0000	100.00
2.5	137,909,392		0.0000	1.0000	100.00
3.5	137,791,333		0.0000	1.0000	100.00
4.5	137,791,333		0.0000	1.0000	100.00
5.5	135,896,437		0.0000	1.0000	100.00
6.5	135,538,131		0.0000	1.0000	100.00
7.5					100.00

MANITOBA HYDRO
ACCOUNT 000P - A/C ELECTRICAL POWER SYSTEMS
ORIGINAL AND SMOOTH SURVIVOR CURVES

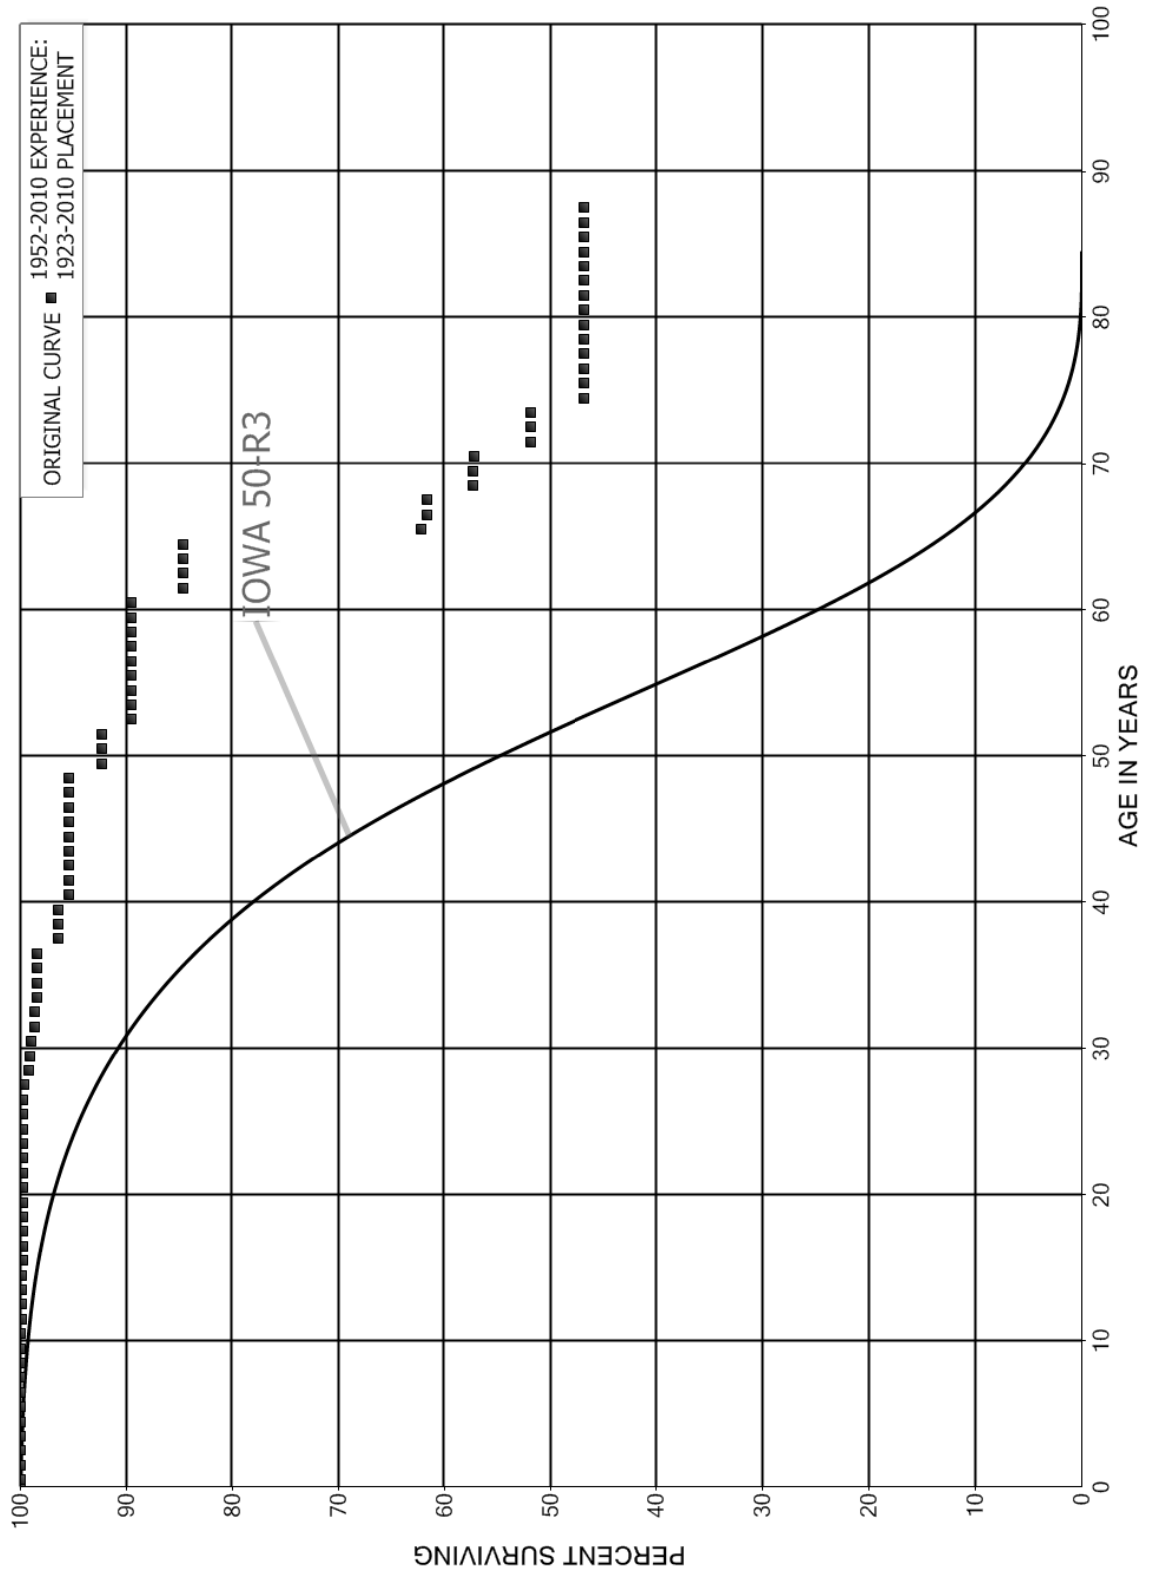

MANITOBA HYDRO

ACCOUNT 000P - A/C ELECTRICAL POWER SYSTEMS

ORIGINAL LIFE TABLE

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1952-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	292,828,017		0.0000	1.0000	100.00
0.5	279,326,442		0.0000	1.0000	100.00
1.5	273,584,241		0.0000	1.0000	100.00
2.5	271,677,214		0.0000	1.0000	100.00
3.5	268,310,640		0.0000	1.0000	100.00
4.5	267,686,749	112,433	0.0004	0.9996	100.00
5.5	266,993,314	97,287	0.0004	0.9996	99.96
6.5	263,023,462	206	0.0000	1.0000	99.92
7.5	245,914,253		0.0000	1.0000	99.92
8.5	242,613,779		0.0000	1.0000	99.92
9.5	242,605,145		0.0000	1.0000	99.92
10.5	237,699,044	329,374	0.0014	0.9986	99.92
11.5	235,826,986		0.0000	1.0000	99.78
12.5	235,041,552	7,100	0.0000	1.0000	99.78
13.5	231,458,887		0.0000	1.0000	99.78
14.5	225,608,940	12,800	0.0001	0.9999	99.78
15.5	224,400,687	285	0.0000	1.0000	99.77
16.5	222,537,137	40,796	0.0002	0.9998	99.77
17.5	191,832,695	61,737	0.0003	0.9997	99.76
18.5	133,955,376	285	0.0000	1.0000	99.72
19.5	72,642,201		0.0000	1.0000	99.72
20.5	70,844,632	3,077	0.0000	1.0000	99.72
21.5	67,781,096	885	0.0000	1.0000	99.72
22.5	67,867,072	8,000	0.0001	0.9999	99.72
23.5	67,903,403		0.0000	1.0000	99.71
24.5	67,223,580	23,574	0.0004	0.9996	99.71
25.5	67,200,006		0.0000	1.0000	99.67
26.5	67,186,048	29,851	0.0004	0.9996	99.67
27.5	66,659,848	316,183	0.0047	0.9953	99.63
28.5	65,929,853	45,026	0.0007	0.9993	99.15
29.5	65,811,137	101,082	0.0015	0.9985	99.09
30.5	65,640,081	245,972	0.0037	0.9963	98.93
31.5	37,610,914		0.0000	1.0000	98.56
32.5	16,899,839	22,875	0.0014	0.9986	98.56
33.5	16,876,963		0.0000	1.0000	98.43
34.5	16,784,200		0.0000	1.0000	98.43
35.5	16,782,064	1,390	0.0001	0.9999	98.43
36.5	16,764,510	340,345	0.0203	0.9797	98.42
37.5	12,293,464		0.0000	1.0000	96.42
38.5	12,257,937		0.0000	1.0000	96.42

MANITOBA HYDRO

ACCOUNT 000P - A/C ELECTRICAL POWER SYSTEMS

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1952-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
39.5	12,233,163	127,541	0.0104	0.9896	96.42
40.5	10,641,790	8,300	0.0008	0.9992	95.42
41.5	10,443,292		0.0000	1.0000	95.34
42.5	10,443,292		0.0000	1.0000	95.34
43.5	10,442,434		0.0000	1.0000	95.34
44.5	8,837,007		0.0000	1.0000	95.34
45.5	8,799,717		0.0000	1.0000	95.34
46.5	8,788,527		0.0000	1.0000	95.34
47.5	8,788,527		0.0000	1.0000	95.34
48.5	8,788,527	285,969	0.0325	0.9675	95.34
49.5	5,796,787		0.0000	1.0000	92.24
50.5	5,673,959		0.0000	1.0000	92.24
51.5	5,575,203	165,169	0.0296	0.9704	92.24
52.5	4,403,786		0.0000	1.0000	89.51
53.5	4,402,136		0.0000	1.0000	89.51
54.5	4,379,548		0.0000	1.0000	89.51
55.5	3,045,849		0.0000	1.0000	89.51
56.5	3,045,849		0.0000	1.0000	89.51
57.5	2,551,929		0.0000	1.0000	89.51
58.5	1,579,722		0.0000	1.0000	89.51
59.5	1,469,333		0.0000	1.0000	89.51
60.5	1,157,623	64,000	0.0553	0.9447	89.51
61.5	1,093,623		0.0000	1.0000	84.56
62.5	1,093,623		0.0000	1.0000	84.56
63.5	1,093,623		0.0000	1.0000	84.56
64.5	1,093,623	289,155	0.2644	0.7356	84.56
65.5	804,468	7,388	0.0092	0.9908	62.20
66.5	797,080		0.0000	1.0000	61.63
67.5	797,080	56,733	0.0712	0.9288	61.63
68.5	740,347		0.0000	1.0000	57.24
69.5	740,347	1,500	0.0020	0.9980	57.24
70.5	738,847	68,056	0.0921	0.9079	57.13
71.5	670,791		0.0000	1.0000	51.87
72.5	670,791		0.0000	1.0000	51.87
73.5	670,791	66,556	0.0992	0.9008	51.87
74.5	604,235		0.0000	1.0000	46.72
75.5	604,235		0.0000	1.0000	46.72
76.5	604,235		0.0000	1.0000	46.72
77.5	604,235		0.0000	1.0000	46.72
78.5	185,317		0.0000	1.0000	46.72


MANITOBA HYDRO

ACCOUNT 000P - A/C ELECTRICAL POWER SYSTEMS

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1952-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
79.5	185,317		0.0000	1.0000	46.72
80.5	185,317		0.0000	1.0000	46.72
81.5	175,686		0.0000	1.0000	46.72
82.5	99,161		0.0000	1.0000	46.72
83.5	4,479		0.0000	1.0000	46.72
84.5	4,479		0.0000	1.0000	46.72
85.5	4,479		0.0000	1.0000	46.72
86.5	3,613		0.0000	1.0000	46.72
87.5					46.72

MANITOBA HYDRO
ACCOUNT 000Q - INSTRUMENTATION, CONTROL AND D/C SYSTEMS
ORIGINAL AND SMOOTH SURVIVOR CURVES

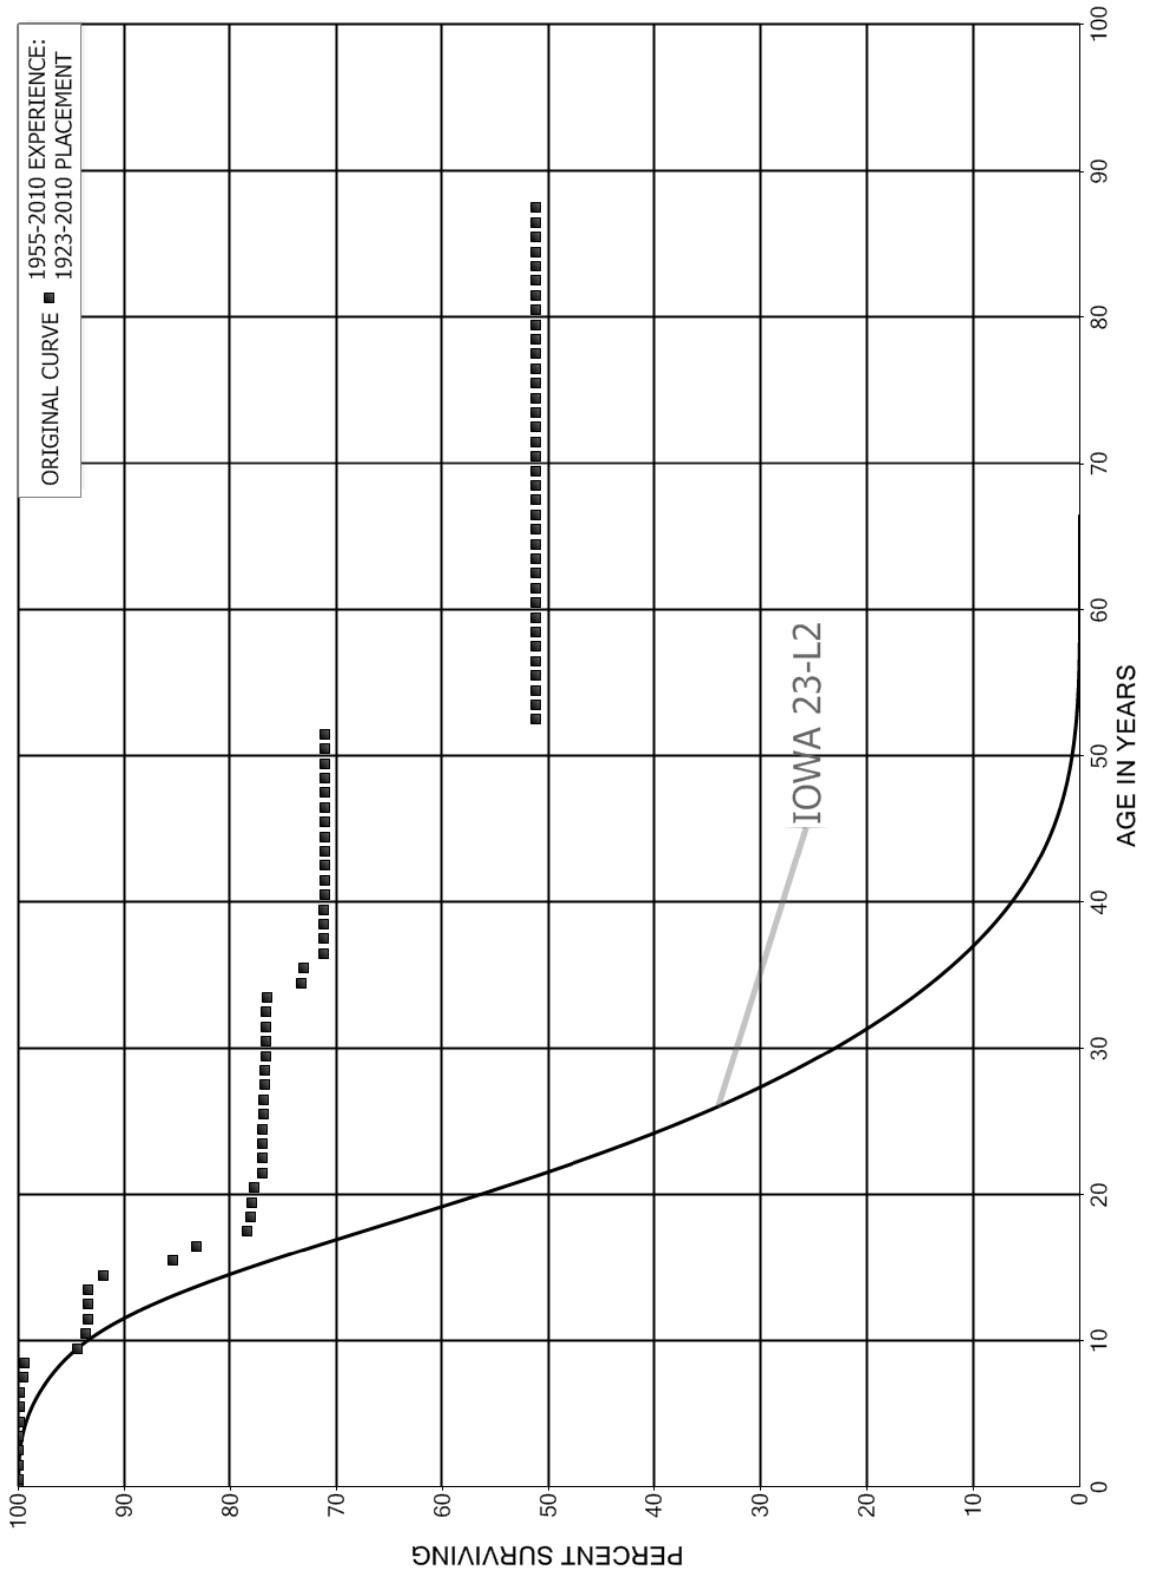

MANITOBA HYDRO

ACCOUNT 000Q - INSTRUMENTATION, CONTROL AND D/C SYSTEMS

ORIGINAL LIFE TABLE

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1955-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	113,512,197		0.0000	1.0000	100.00
0.5	110,922,819		0.0000	1.0000	100.00
1.5	108,424,973		0.0000	1.0000	100.00
2.5	107,366,926		0.0000	1.0000	100.00
3.5	105,444,621	122,120	0.0012	0.9988	100.00
4.5	101,758,727	200	0.0000	1.0000	99.88
5.5	97,904,128	45,137	0.0005	0.9995	99.88
6.5	93,915,854	313,182	0.0033	0.9967	99.84
7.5	92,312,982	73,269	0.0008	0.9992	99.51
8.5	83,573,216	4,250,138	0.0509	0.9491	99.43
9.5	77,955,135	667,574	0.0086	0.9914	94.37
10.5	73,824,226	171,391	0.0023	0.9977	93.56
11.5	70,873,829		0.0000	1.0000	93.34
12.5	64,082,132	1,000	0.0000	1.0000	93.34
13.5	59,258,714	889,976	0.0150	0.9850	93.34
14.5	45,889,792	3,271,252	0.0713	0.9287	91.94
15.5	37,651,074	965,716	0.0256	0.9744	85.39
16.5	33,051,720	1,895,794	0.0574	0.9426	83.20
17.5	28,664,663	134,502	0.0047	0.9953	78.42
18.5	24,183,660	25,564	0.0011	0.9989	78.06
19.5	21,256,023	72,220	0.0034	0.9966	77.97
20.5	21,177,893	193,176	0.0091	0.9909	77.71
21.5	20,396,620	5,814	0.0003	0.9997	77.00
22.5	20,265,246	4,500	0.0002	0.9998	76.98
23.5	20,019,285		0.0000	1.0000	76.96
24.5	19,862,468	25,233	0.0013	0.9987	76.96
25.5	18,676,539		0.0000	1.0000	76.86
26.5	18,527,653	41,175	0.0022	0.9978	76.86
27.5	18,542,086	4,893	0.0003	0.9997	76.69
28.5	18,520,835	2,000	0.0001	0.9999	76.67
29.5	18,471,061	21,614	0.0012	0.9988	76.66
30.5	18,446,012	1,000	0.0001	0.9999	76.57
31.5	14,552,131		0.0000	1.0000	76.57
32.5	12,679,351	8,600	0.0007	0.9993	76.57
33.5	12,646,935	541,068	0.0428	0.9572	76.52
34.5	11,968,716	31,173	0.0026	0.9974	73.24
35.5	11,744,812	300,696	0.0256	0.9744	73.05
36.5	11,444,116	7,036	0.0006	0.9994	71.18
37.5	6,605,160		0.0000	1.0000	71.14
38.5	6,596,160		0.0000	1.0000	71.14

MANITOBA HYDRO

ACCOUNT 000Q - INSTRUMENTATION, CONTROL AND D/C SYSTEMS

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1955-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
39.5	6,203,378	7,116	0.0011	0.9989	71.14	
40.5	3,936,407		0.0000	1.0000	71.06	
41.5	3,657,705		0.0000	1.0000	71.06	
42.5	3,657,705		0.0000	1.0000	71.06	
43.5	3,642,274		0.0000	1.0000	71.06	
44.5	2,261,508		0.0000	1.0000	71.06	
45.5	2,261,508		0.0000	1.0000	71.06	
46.5	2,261,508		0.0000	1.0000	71.06	
47.5	2,261,508		0.0000	1.0000	71.06	
48.5	2,256,039		0.0000	1.0000	71.06	
49.5	2,061,683		0.0000	1.0000	71.06	
50.5	2,060,954		0.0000	1.0000	71.06	
51.5	2,006,520	559,931	0.2791	0.7209	71.06	
52.5	475,938		0.0000	1.0000	51.23	
53.5	475,938		0.0000	1.0000	51.23	
54.5	475,938		0.0000	1.0000	51.23	
55.5	475,938		0.0000	1.0000	51.23	
56.5	475,938		0.0000	1.0000	51.23	
57.5	475,938		0.0000	1.0000	51.23	
58.5	475,938		0.0000	1.0000	51.23	
59.5	475,938		0.0000	1.0000	51.23	
60.5	475,938		0.0000	1.0000	51.23	
61.5	475,938		0.0000	1.0000	51.23	
62.5	475,938		0.0000	1.0000	51.23	
63.5	475,938		0.0000	1.0000	51.23	
64.5	475,938		0.0000	1.0000	51.23	
65.5	475,938		0.0000	1.0000	51.23	
66.5	475,938		0.0000	1.0000	51.23	
67.5	475,938		0.0000	1.0000	51.23	
68.5	475,938		0.0000	1.0000	51.23	
69.5	475,938		0.0000	1.0000	51.23	
70.5	475,938		0.0000	1.0000	51.23	
71.5	475,938		0.0000	1.0000	51.23	
72.5	475,938		0.0000	1.0000	51.23	
73.5	475,938		0.0000	1.0000	51.23	
74.5	475,938		0.0000	1.0000	51.23	
75.5	475,938		0.0000	1.0000	51.23	
76.5	475,938		0.0000	1.0000	51.23	
77.5	475,938		0.0000	1.0000	51.23	
78.5	475,938		0.0000	1.0000	51.23	


MANITOBA HYDRO

ACCOUNT 000Q - INSTRUMENTATION, CONTROL AND D/C SYSTEMS

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1955-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
79.5	475,938		0.0000	1.0000	51.23
80.5	475,938		0.0000	1.0000	51.23
81.5	248,803		0.0000	1.0000	51.23
82.5	190,007		0.0000	1.0000	51.23
83.5	134,399		0.0000	1.0000	51.23
84.5	134,399		0.0000	1.0000	51.23
85.5	134,399		0.0000	1.0000	51.23
86.5	98,990		0.0000	1.0000	51.23
87.5					51.23

MANITOBA HYDRO
ACCOUNT 000R - AUXILIARY STATION PROCESSES
ORIGINAL AND SMOOTH SURVIVOR CURVES

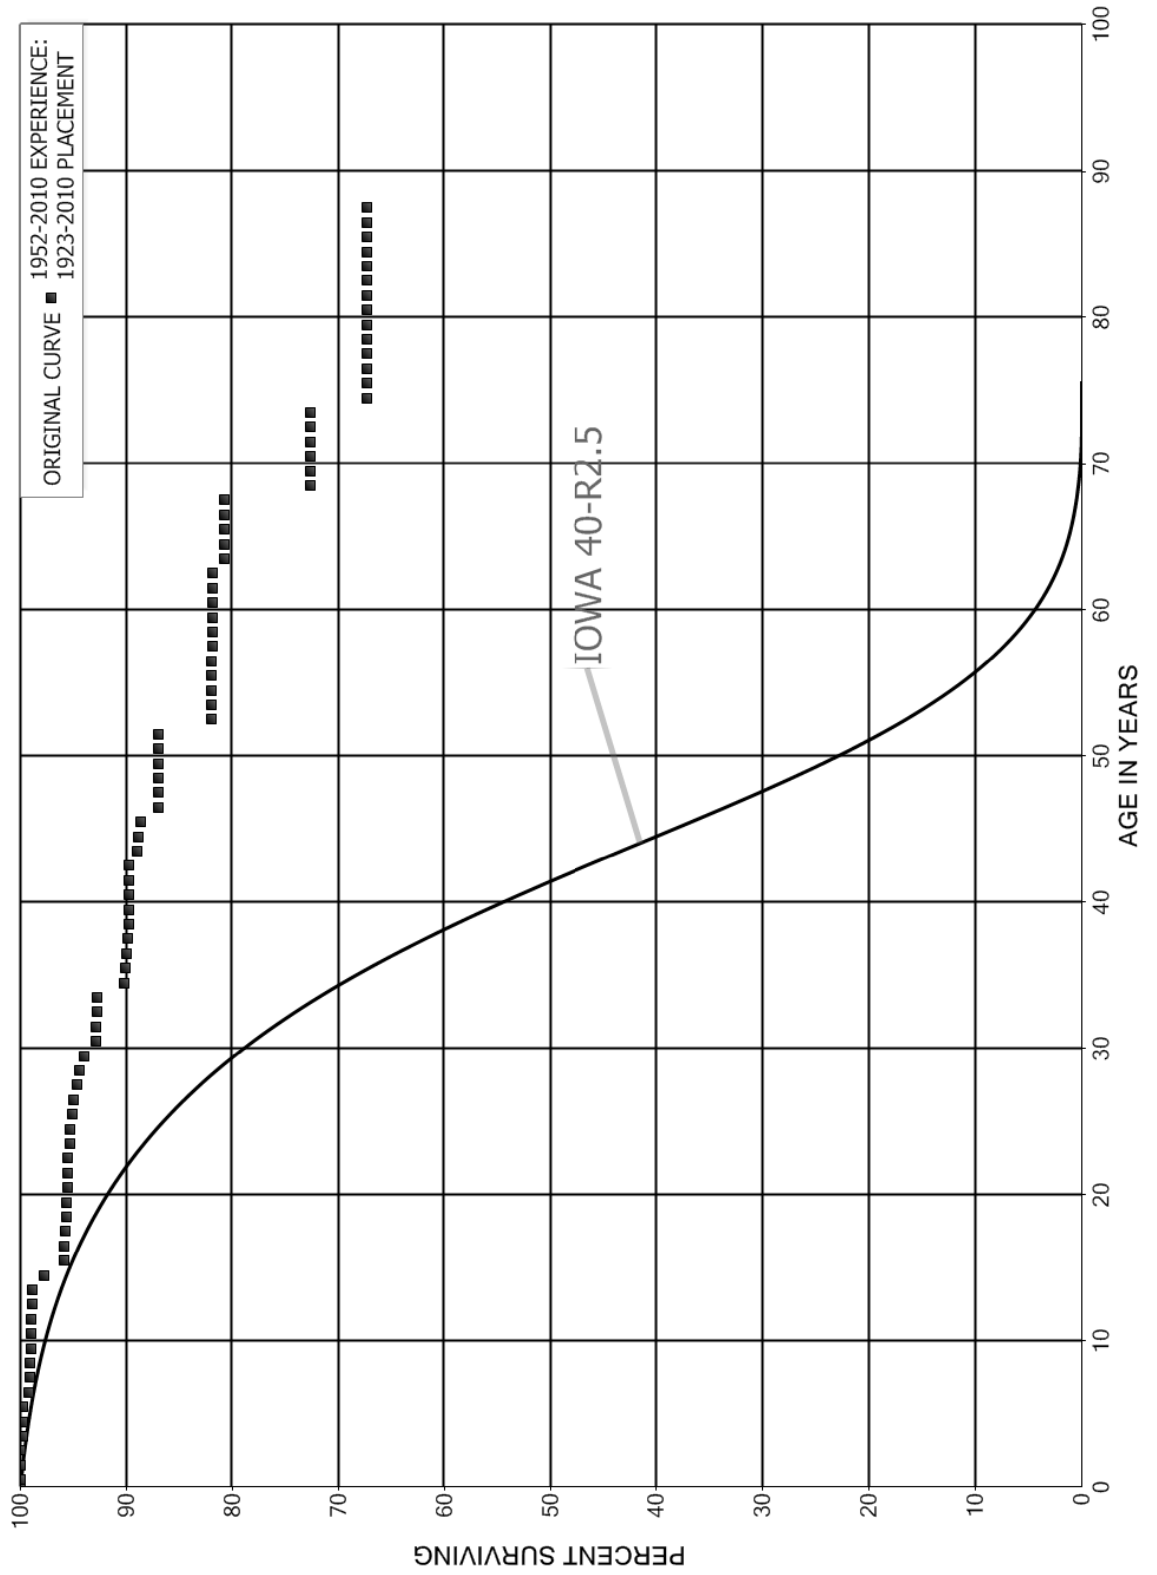

MANITOBA HYDRO

ACCOUNT 000R - AUXILIARY STATION PROCESSES

ORIGINAL LIFE TABLE

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1952-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	192,624,854		0.0000	1.0000	100.00
0.5	184,805,819		0.0000	1.0000	100.00
1.5	179,793,702	13,946	0.0001	0.9999	100.00
2.5	176,424,434	486,671	0.0028	0.9972	99.99
3.5	169,989,173	610	0.0000	1.0000	99.72
4.5	167,342,114	18,978	0.0001	0.9999	99.72
5.5	165,029,209	963,272	0.0058	0.9942	99.70
6.5	158,223,071	72,518	0.0005	0.9995	99.12
7.5	147,022,130		0.0000	1.0000	99.08
8.5	144,278,234	122,136	0.0008	0.9992	99.08
9.5	143,700,574	231	0.0000	1.0000	98.99
10.5	140,201,772	100,311	0.0007	0.9993	98.99
11.5	136,482,240	46,729	0.0003	0.9997	98.92
12.5	130,907,743	4,553	0.0000	1.0000	98.89
13.5	122,020,915	1,371,150	0.0112	0.9888	98.89
14.5	97,190,921	1,933,878	0.0199	0.9801	97.77
15.5	92,079,982	39,726	0.0004	0.9996	95.83
16.5	86,682,515	36,609	0.0004	0.9996	95.79
17.5	75,602,356	128,938	0.0017	0.9983	95.75
18.5	61,025,988		0.0000	1.0000	95.58
19.5	45,316,350	46,375	0.0010	0.9990	95.58
20.5	43,704,160		0.0000	1.0000	95.49
21.5	42,368,695		0.0000	1.0000	95.49
22.5	41,158,808	103,849	0.0025	0.9975	95.49
23.5	40,955,165	5,322	0.0001	0.9999	95.24
24.5	40,190,640	63,238	0.0016	0.9984	95.23
25.5	39,390,661	39,485	0.0010	0.9990	95.08
26.5	38,144,989	135,096	0.0035	0.9965	94.99
27.5	37,461,286	90,669	0.0024	0.9976	94.65
28.5	37,376,798	169,653	0.0045	0.9955	94.42
29.5	37,154,410	438,438	0.0118	0.9882	93.99
30.5	36,609,146	33,298	0.0009	0.9991	92.88
31.5	27,362,995	6,065	0.0002	0.9998	92.80
32.5	23,034,951		0.0000	1.0000	92.78
33.5	22,976,353	647,311	0.0282	0.9718	92.78
34.5	22,172,044	23,311	0.0011	0.9989	90.17
35.5	22,138,406	34,197	0.0015	0.9985	90.07
36.5	21,975,375	10,346	0.0005	0.9995	89.93
37.5	13,525,241	20,084	0.0015	0.9985	89.89
38.5	13,275,764	1,103	0.0001	0.9999	89.76

MANITOBA HYDRO

ACCOUNT 000R - AUXILIARY STATION PROCESSES

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1952-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
39.5	12,124,532		0.0000	1.0000	89.75
40.5	11,320,803		0.0000	1.0000	89.75
41.5	11,202,706	1,312	0.0001	0.9999	89.75
42.5	11,110,105	96,785	0.0087	0.9913	89.74
43.5	10,947,641	10,144	0.0009	0.9991	88.96
44.5	10,843,253	36,619	0.0034	0.9966	88.87
45.5	10,706,636	200,000	0.0187	0.9813	88.57
46.5	10,489,195	600	0.0001	0.9999	86.92
47.5	10,482,935		0.0000	1.0000	86.91
48.5	10,482,701		0.0000	1.0000	86.91
49.5	6,282,977		0.0000	1.0000	86.91
50.5	6,278,935		0.0000	1.0000	86.91
51.5	6,239,360	355,563	0.0570	0.9430	86.91
52.5	1,352,685		0.0000	1.0000	81.96
53.5	1,349,124		0.0000	1.0000	81.96
54.5	1,349,124	600	0.0004	0.9996	81.96
55.5	880,961		0.0000	1.0000	81.92
56.5	880,961	1,213	0.0014	0.9986	81.92
57.5	879,603		0.0000	1.0000	81.81
58.5	467,314		0.0000	1.0000	81.81
59.5	467,216		0.0000	1.0000	81.81
60.5	443,426		0.0000	1.0000	81.81
61.5	443,426		0.0000	1.0000	81.81
62.5	443,426	6,000	0.0135	0.9865	81.81
63.5	437,426		0.0000	1.0000	80.70
64.5	437,426		0.0000	1.0000	80.70
65.5	437,426		0.0000	1.0000	80.70
66.5	437,426		0.0000	1.0000	80.70
67.5	437,426	43,712	0.0999	0.9001	80.70
68.5	393,714		0.0000	1.0000	72.64
69.5	393,714		0.0000	1.0000	72.64
70.5	393,714		0.0000	1.0000	72.64
71.5	393,714		0.0000	1.0000	72.64
72.5	393,714		0.0000	1.0000	72.64
73.5	393,714	29,068	0.0738	0.9262	72.64
74.5	364,647		0.0000	1.0000	67.28
75.5	364,647		0.0000	1.0000	67.28
76.5	364,647		0.0000	1.0000	67.28
77.5	364,647		0.0000	1.0000	67.28
78.5	47,772		0.0000	1.0000	67.28


MANITOBA HYDRO

ACCOUNT 000R - AUXILIARY STATION PROCESSES

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1952-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
79.5	47,772		0.0000	1.0000	67.28
80.5	47,772		0.0000	1.0000	67.28
81.5	21,135		0.0000	1.0000	67.28
82.5	21,135		0.0000	1.0000	67.28
83.5	18,210		0.0000	1.0000	67.28
84.5	18,210		0.0000	1.0000	67.28
85.5	18,210		0.0000	1.0000	67.28
86.5	18,210		0.0000	1.0000	67.28
87.5					67.28

MANITOBA HYDRO
ACCOUNT 000V - TOWN SITE BUILDING
ORIGINAL AND SMOOTH SURVIVOR CURVES

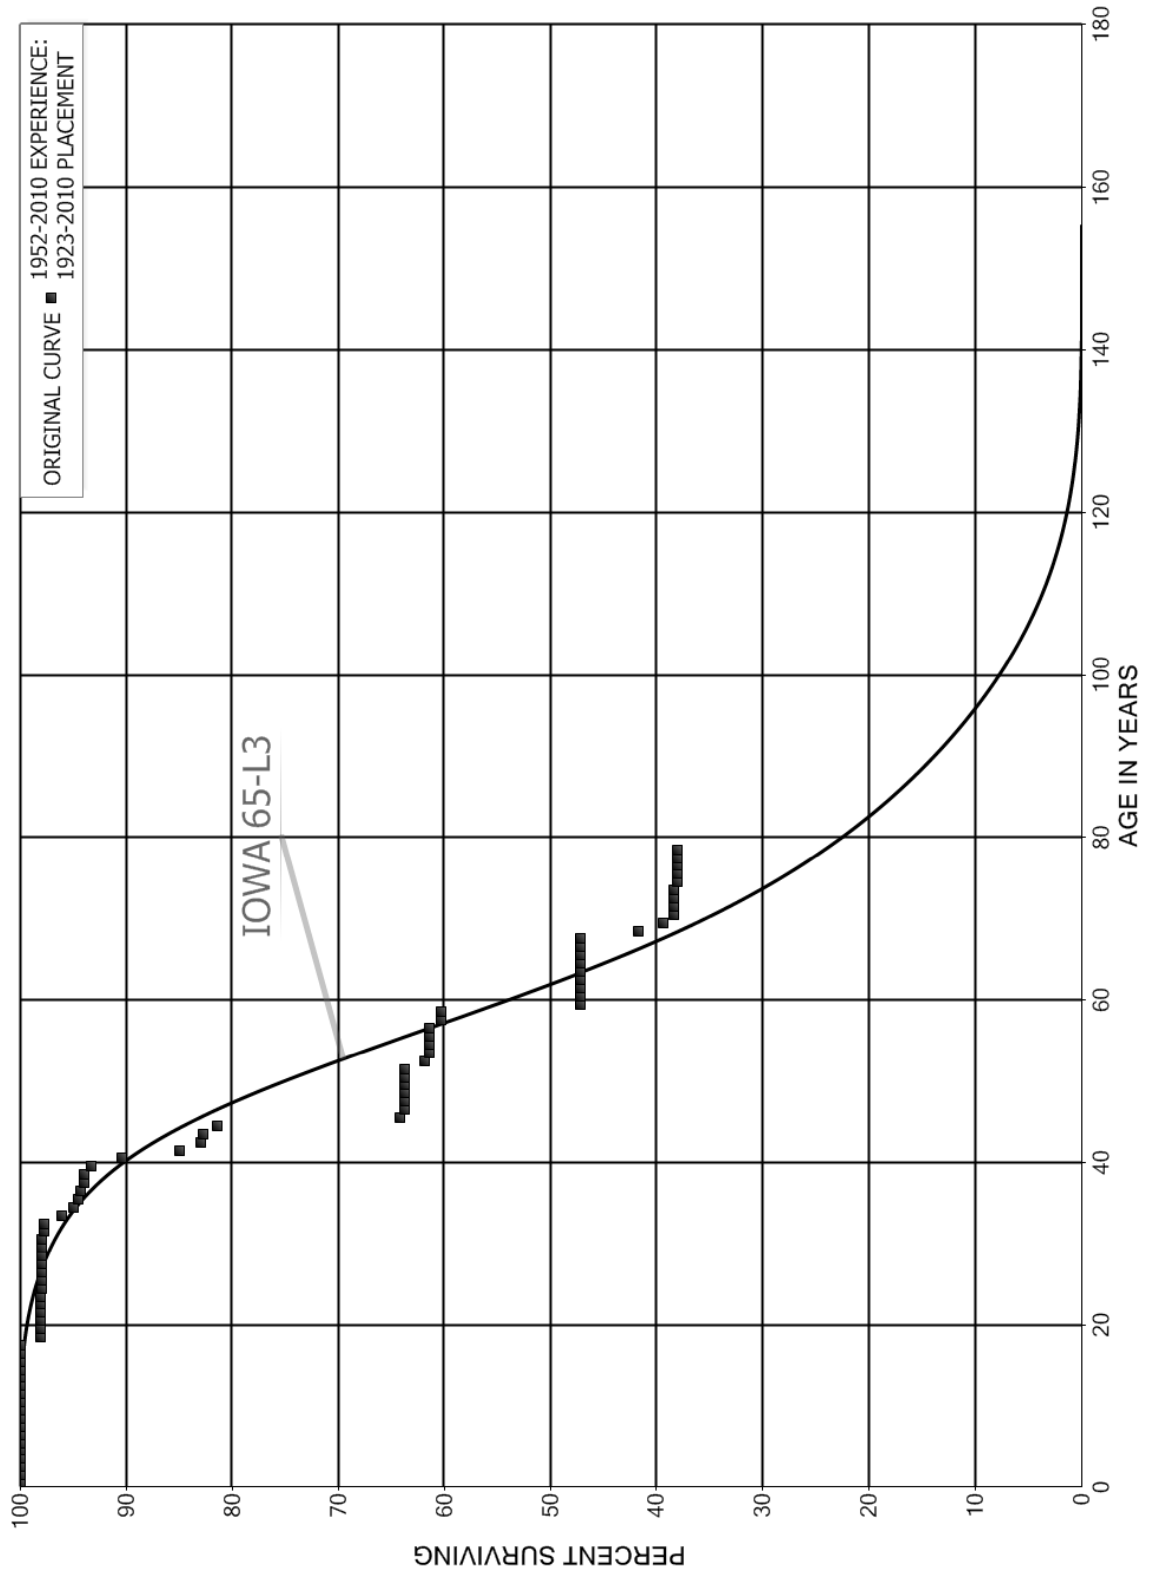

MANITOBA HYDRO

ACCOUNT 000V - TOWN SITE BUILDING

ORIGINAL LIFE TABLE

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1952-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	61,916,630		0.0000	1.0000	100.00
0.5	60,156,072		0.0000	1.0000	100.00
1.5	57,323,328		0.0000	1.0000	100.00
2.5	54,642,240		0.0000	1.0000	100.00
3.5	53,603,510		0.0000	1.0000	100.00
4.5	49,079,689		0.0000	1.0000	100.00
5.5	48,986,247		0.0000	1.0000	100.00
6.5	48,996,334		0.0000	1.0000	100.00
7.5	48,989,321		0.0000	1.0000	100.00
8.5	48,846,804		0.0000	1.0000	100.00
9.5	47,741,402	4,325	0.0001	0.9999	100.00
10.5	45,508,060		0.0000	1.0000	99.99
11.5	45,046,404		0.0000	1.0000	99.99
12.5	44,009,404		0.0000	1.0000	99.99
13.5	42,772,297		0.0000	1.0000	99.99
14.5	42,610,137		0.0000	1.0000	99.99
15.5	42,145,031		0.0000	1.0000	99.99
16.5	38,392,785		0.0000	1.0000	99.99
17.5	38,392,785	731,713	0.0191	0.9809	99.99
18.5	37,291,313		0.0000	1.0000	98.09
19.5	36,158,607		0.0000	1.0000	98.09
20.5	33,585,873		0.0000	1.0000	98.09
21.5	27,834,848	15,000	0.0005	0.9995	98.09
22.5	27,494,118		0.0000	1.0000	98.03
23.5	27,509,443	10,965	0.0004	0.9996	98.03
24.5	22,119,445		0.0000	1.0000	97.99
25.5	22,119,445	761	0.0000	1.0000	97.99
26.5	22,065,719		0.0000	1.0000	97.99
27.5	22,065,719		0.0000	1.0000	97.99
28.5	21,239,277	4,433	0.0002	0.9998	97.99
29.5	20,828,965	9,114	0.0004	0.9996	97.97
30.5	20,819,851	45,101	0.0022	0.9978	97.93
31.5	10,120,997	3,618	0.0004	0.9996	97.71
32.5	10,117,379	169,076	0.0167	0.9833	97.68
33.5	9,948,303	108,958	0.0110	0.9890	96.05
34.5	9,824,944	48,375	0.0049	0.9951	95.00
35.5	9,772,738	28,769	0.0029	0.9971	94.53
36.5	9,735,678	26,163	0.0027	0.9973	94.25
37.5	2,368,657		0.0000	1.0000	94.00
38.5	2,368,657	17,649	0.0075	0.9925	94.00


MANITOBA HYDRO

ACCOUNT 000V - TOWN SITE BUILDING

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1952-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
39.5	2,345,175	72,580	0.0309	0.9691	93.30
40.5	2,272,595	136,469	0.0601	0.9399	90.41
41.5	1,962,231	46,332	0.0236	0.9764	84.98
42.5	1,915,900	4,833	0.0025	0.9975	82.97
43.5	1,859,687	31,908	0.0172	0.9828	82.76
44.5	661,942	139,698	0.2110	0.7890	81.34
45.5	493,189	3,874	0.0079	0.9921	64.18
46.5	439,590		0.0000	1.0000	63.67
47.5	439,590		0.0000	1.0000	63.67
48.5	439,590		0.0000	1.0000	63.67
49.5	425,042		0.0000	1.0000	63.67
50.5	421,470		0.0000	1.0000	63.67
51.5	421,470	12,213	0.0290	0.9710	63.67
52.5	409,257	3,000	0.0073	0.9927	61.83
53.5	405,256		0.0000	1.0000	61.37
54.5	405,106		0.0000	1.0000	61.37
55.5	405,106		0.0000	1.0000	61.37
56.5	405,106	7,000	0.0173	0.9827	61.37
57.5	398,106		0.0000	1.0000	60.31
58.5	398,094	87,285	0.2193	0.7807	60.31
59.5	310,810		0.0000	1.0000	47.09
60.5	303,510		0.0000	1.0000	47.09
61.5	303,510		0.0000	1.0000	47.09
62.5	303,510		0.0000	1.0000	47.09
63.5	303,510		0.0000	1.0000	47.09
64.5	303,510		0.0000	1.0000	47.09
65.5	303,510		0.0000	1.0000	47.09
66.5	303,510		0.0000	1.0000	47.09
67.5	303,510	35,256	0.1162	0.8838	47.09
68.5	268,254	15,326	0.0571	0.9429	41.62
69.5	252,929	5,903	0.0233	0.9767	39.24
70.5	247,025		0.0000	1.0000	38.33
71.5	247,025		0.0000	1.0000	38.33
72.5	247,025		0.0000	1.0000	38.33
73.5	247,025	2,559	0.0104	0.9896	38.33
74.5	244,467		0.0000	1.0000	37.93
75.5	244,467		0.0000	1.0000	37.93
76.5	244,467		0.0000	1.0000	37.93
77.5	244,467		0.0000	1.0000	37.93
78.5					37.93

MANITOBA HYDRO
ACCOUNT 000X - SUPPORT BUILDINGS
ORIGINAL AND SMOOTH SURVIVOR CURVES

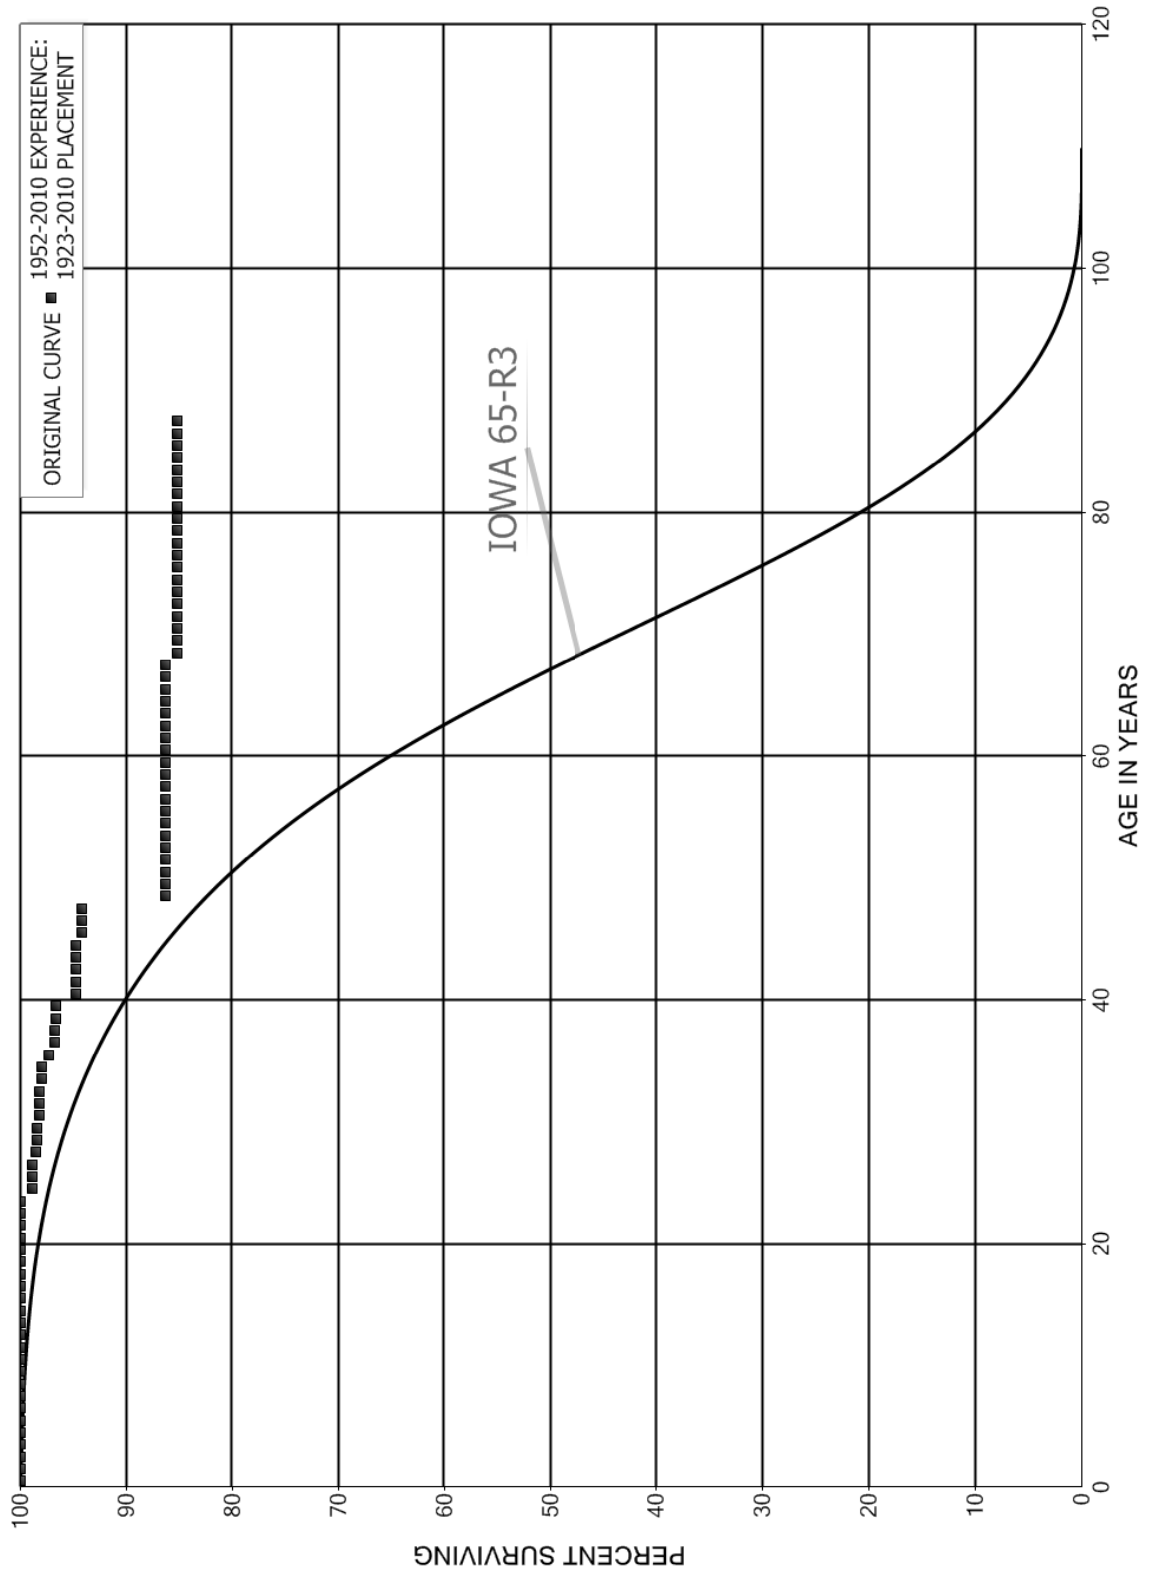

MANITOBA HYDRO

ACCOUNT 000X - SUPPORT BUILDINGS

ORIGINAL LIFE TABLE

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1952-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	53,265,314		0.0000	1.0000	100.00
0.5	51,710,788		0.0000	1.0000	100.00
1.5	49,728,815		0.0000	1.0000	100.00
2.5	48,507,423		0.0000	1.0000	100.00
3.5	48,155,695		0.0000	1.0000	100.00
4.5	47,400,616		0.0000	1.0000	100.00
5.5	46,904,041	8,065	0.0002	0.9998	100.00
6.5	43,889,140		0.0000	1.0000	99.98
7.5	37,885,207		0.0000	1.0000	99.98
8.5	37,470,809		0.0000	1.0000	99.98
9.5	36,997,262		0.0000	1.0000	99.98
10.5	35,950,102		0.0000	1.0000	99.98
11.5	35,231,141		0.0000	1.0000	99.98
12.5	28,844,054		0.0000	1.0000	99.98
13.5	27,869,847		0.0000	1.0000	99.98
14.5	22,298,714		0.0000	1.0000	99.98
15.5	21,042,579		0.0000	1.0000	99.98
16.5	20,761,245		0.0000	1.0000	99.98
17.5	14,397,669	5,000	0.0003	0.9997	99.98
18.5	12,583,643		0.0000	1.0000	99.95
19.5	10,790,616		0.0000	1.0000	99.95
20.5	10,655,066		0.0000	1.0000	99.95
21.5	10,594,622		0.0000	1.0000	99.95
22.5	10,603,778		0.0000	1.0000	99.95
23.5	9,738,510	105,000	0.0108	0.9892	99.95
24.5	9,646,586		0.0000	1.0000	98.87
25.5	6,068,037		0.0000	1.0000	98.87
26.5	6,068,037	24,541	0.0040	0.9960	98.87
27.5	5,887,995	3,750	0.0006	0.9994	98.47
28.5	6,287,289		0.0000	1.0000	98.41
29.5	6,167,681	13,076	0.0021	0.9979	98.41
30.5	6,147,403		0.0000	1.0000	98.20
31.5	6,147,403	140	0.0000	1.0000	98.20
32.5	5,935,367	13,913	0.0023	0.9977	98.20
33.5	5,913,554	2,230	0.0004	0.9996	97.97
34.5	5,880,223	36,237	0.0062	0.9938	97.93
35.5	5,843,986	33,826	0.0058	0.9942	97.33
36.5	5,810,159	1,939	0.0003	0.9997	96.76
37.5	1,951,527	2,049	0.0011	0.9989	96.73
38.5	1,864,106	1,132	0.0006	0.9994	96.63

MANITOBA HYDRO

ACCOUNT 000X - SUPPORT BUILDINGS

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1952-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
39.5	1,818,759	34,550	0.0190	0.9810	96.57
40.5	1,784,209		0.0000	1.0000	94.74
41.5	1,784,209		0.0000	1.0000	94.74
42.5	1,781,193		0.0000	1.0000	94.74
43.5	1,781,193		0.0000	1.0000	94.74
44.5	1,641,309	9,816	0.0060	0.9940	94.74
45.5	1,621,462		0.0000	1.0000	94.17
46.5	1,621,462		0.0000	1.0000	94.17
47.5	1,621,462	136,000	0.0839	0.9161	94.17
48.5	1,485,462		0.0000	1.0000	86.27
49.5	826,055		0.0000	1.0000	86.27
50.5	826,055		0.0000	1.0000	86.27
51.5	816,248		0.0000	1.0000	86.27
52.5	418,391		0.0000	1.0000	86.27
53.5	418,391		0.0000	1.0000	86.27
54.5	418,391		0.0000	1.0000	86.27
55.5	418,391		0.0000	1.0000	86.27
56.5	418,391		0.0000	1.0000	86.27
57.5	418,391	15	0.0000	1.0000	86.27
58.5	418,375		0.0000	1.0000	86.27
59.5	418,375		0.0000	1.0000	86.27
60.5	418,375		0.0000	1.0000	86.27
61.5	418,375		0.0000	1.0000	86.27
62.5	418,375		0.0000	1.0000	86.27
63.5	418,375		0.0000	1.0000	86.27
64.5	418,375		0.0000	1.0000	86.27
65.5	418,375		0.0000	1.0000	86.27
66.5	418,375		0.0000	1.0000	86.27
67.5	418,375	5,406	0.0129	0.9871	86.27
68.5	412,969		0.0000	1.0000	85.15
69.5	412,969		0.0000	1.0000	85.15
70.5	412,969		0.0000	1.0000	85.15
71.5	412,969		0.0000	1.0000	85.15
72.5	412,969		0.0000	1.0000	85.15
73.5	412,969		0.0000	1.0000	85.15
74.5	412,969		0.0000	1.0000	85.15
75.5	412,969		0.0000	1.0000	85.15
76.5	412,969		0.0000	1.0000	85.15
77.5	412,969		0.0000	1.0000	85.15
78.5	412,969		0.0000	1.0000	85.15


MANITOBA HYDRO

ACCOUNT 000X - SUPPORT BUILDINGS

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1952-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
79.5	412,969		0.0000	1.0000	85.15
80.5	412,969		0.0000	1.0000	85.15
81.5	412,969		0.0000	1.0000	85.15
82.5	412,969		0.0000	1.0000	85.15
83.5	412,969		0.0000	1.0000	85.15
84.5	412,969		0.0000	1.0000	85.15
85.5	412,969		0.0000	1.0000	85.15
86.5	412,969		0.0000	1.0000	85.15
87.5					85.15

MANITOBA HYDRO
ACCOUNT 000Y - TOWN SITE OTHER INFRASTRUCTURE
ORIGINAL AND SMOOTH SURVIVOR CURVES

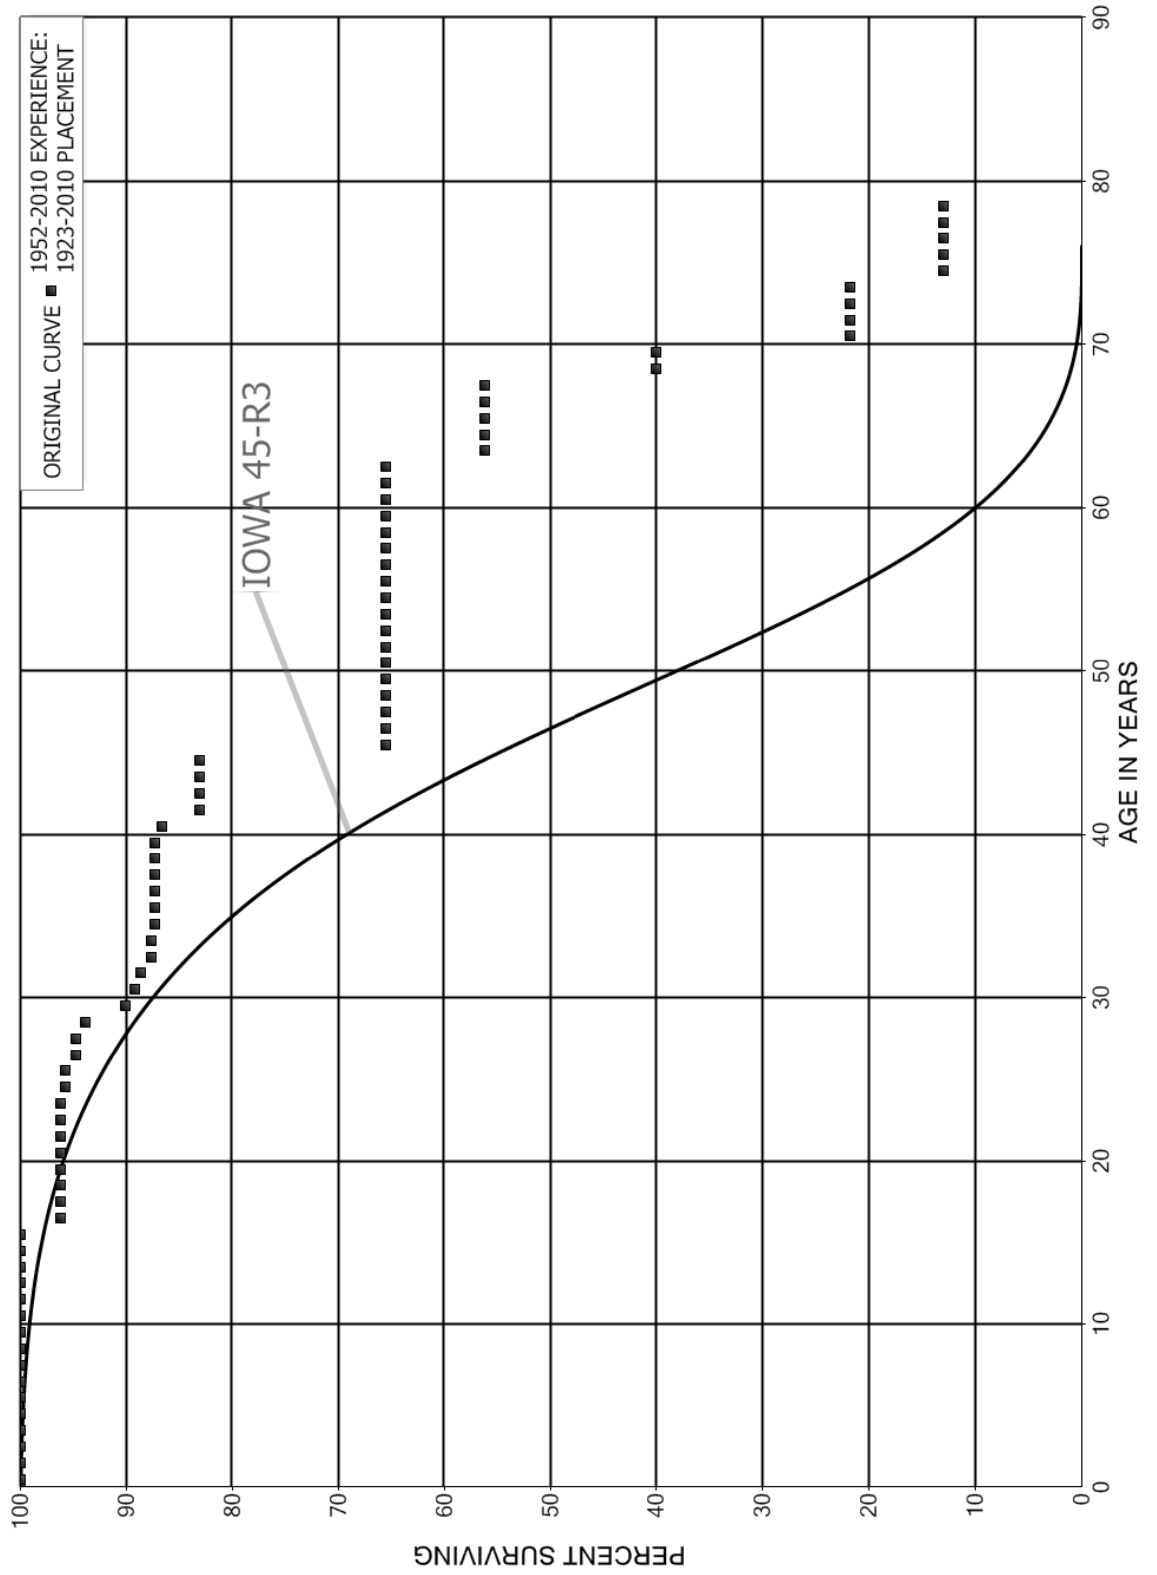

MANITOBA HYDRO

ACCOUNT 000Y - TOWN SITE OTHER INFRASTRUCTURE

ORIGINAL LIFE TABLE

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1952-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	26,962,127		0.0000	1.0000	100.00
0.5	24,661,955		0.0000	1.0000	100.00
1.5	24,443,245		0.0000	1.0000	100.00
2.5	23,018,558		0.0000	1.0000	100.00
3.5	22,865,349		0.0000	1.0000	100.00
4.5	22,347,512		0.0000	1.0000	100.00
5.5	17,646,550		0.0000	1.0000	100.00
6.5	16,955,132		0.0000	1.0000	100.00
7.5	16,786,460		0.0000	1.0000	100.00
8.5	14,898,563		0.0000	1.0000	100.00
9.5	11,181,716		0.0000	1.0000	100.00
10.5	10,804,400		0.0000	1.0000	100.00
11.5	10,499,905	2,648	0.0003	0.9997	100.00
12.5	7,092,531		0.0000	1.0000	99.97
13.5	4,656,753		0.0000	1.0000	99.97
14.5	4,339,626		0.0000	1.0000	99.97
15.5	4,213,310	160,237	0.0380	0.9620	99.97
16.5	3,946,446		0.0000	1.0000	96.17
17.5	3,946,446		0.0000	1.0000	96.17
18.5	3,867,574		0.0000	1.0000	96.17
19.5	3,976,181		0.0000	1.0000	96.17
20.5	3,916,614		0.0000	1.0000	96.17
21.5	3,073,875		0.0000	1.0000	96.17
22.5	2,958,860		0.0000	1.0000	96.17
23.5	2,647,763	13,660	0.0052	0.9948	96.17
24.5	2,403,122		0.0000	1.0000	95.68
25.5	2,282,796	22,099	0.0097	0.9903	95.68
26.5	2,236,560		0.0000	1.0000	94.75
27.5	2,192,114	21,075	0.0096	0.9904	94.75
28.5	2,214,444	89,800	0.0406	0.9594	93.84
29.5	2,124,645	21,333	0.0100	0.9900	90.03
30.5	2,103,312	13,038	0.0062	0.9938	89.13
31.5	2,090,274	21,589	0.0103	0.9897	88.58
32.5	2,068,684		0.0000	1.0000	87.66
33.5	2,068,684	8,629	0.0042	0.9958	87.66
34.5	2,060,055		0.0000	1.0000	87.30
35.5	2,060,055		0.0000	1.0000	87.30
36.5	2,060,055		0.0000	1.0000	87.30
37.5	793,872		0.0000	1.0000	87.30
38.5	793,872		0.0000	1.0000	87.30


MANITOBA HYDRO

ACCOUNT 000Y - TOWN SITE OTHER INFRASTRUCTURE

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1952-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
39.5	769,124	6,270	0.0082	0.9918	87.30	
40.5	762,855	30,675	0.0402	0.9598	86.59	
41.5	732,179		0.0000	1.0000	83.10	
42.5	732,179		0.0000	1.0000	83.10	
43.5	732,179		0.0000	1.0000	83.10	
44.5	409,891	86,788	0.2117	0.7883	83.10	
45.5	323,103		0.0000	1.0000	65.51	
46.5	323,103		0.0000	1.0000	65.51	
47.5	323,103		0.0000	1.0000	65.51	
48.5	323,103		0.0000	1.0000	65.51	
49.5	323,103		0.0000	1.0000	65.51	
50.5	323,103		0.0000	1.0000	65.51	
51.5	323,103		0.0000	1.0000	65.51	
52.5	323,103		0.0000	1.0000	65.51	
53.5	323,103		0.0000	1.0000	65.51	
54.5	320,603		0.0000	1.0000	65.51	
55.5	320,603		0.0000	1.0000	65.51	
56.5	320,603		0.0000	1.0000	65.51	
57.5	320,603		0.0000	1.0000	65.51	
58.5	320,603		0.0000	1.0000	65.51	
59.5	320,603		0.0000	1.0000	65.51	
60.5	320,603		0.0000	1.0000	65.51	
61.5	320,603		0.0000	1.0000	65.51	
62.5	320,603	45,430	0.1417	0.8583	65.51	
63.5	275,173		0.0000	1.0000	56.23	
64.5	275,173		0.0000	1.0000	56.23	
65.5	275,173		0.0000	1.0000	56.23	
66.5	275,173		0.0000	1.0000	56.23	
67.5	275,173	79,771	0.2899	0.7101	56.23	
68.5	195,402		0.0000	1.0000	39.93	
69.5	195,402	88,819	0.4545	0.5455	39.93	
70.5	106,582		0.0000	1.0000	21.78	
71.5	106,582		0.0000	1.0000	21.78	
72.5	106,582		0.0000	1.0000	21.78	
73.5	106,582	43,405	0.4072	0.5928	21.78	
74.5	63,177		0.0000	1.0000	12.91	
75.5	63,177		0.0000	1.0000	12.91	
76.5	63,177		0.0000	1.0000	12.91	
77.5	63,177		0.0000	1.0000	12.91	
78.5					12.91	

MANITOBA HYDRO
ACCOUNT 1300B - BUILDINGS
ORIGINAL AND SMOOTH SURVIVOR CURVES

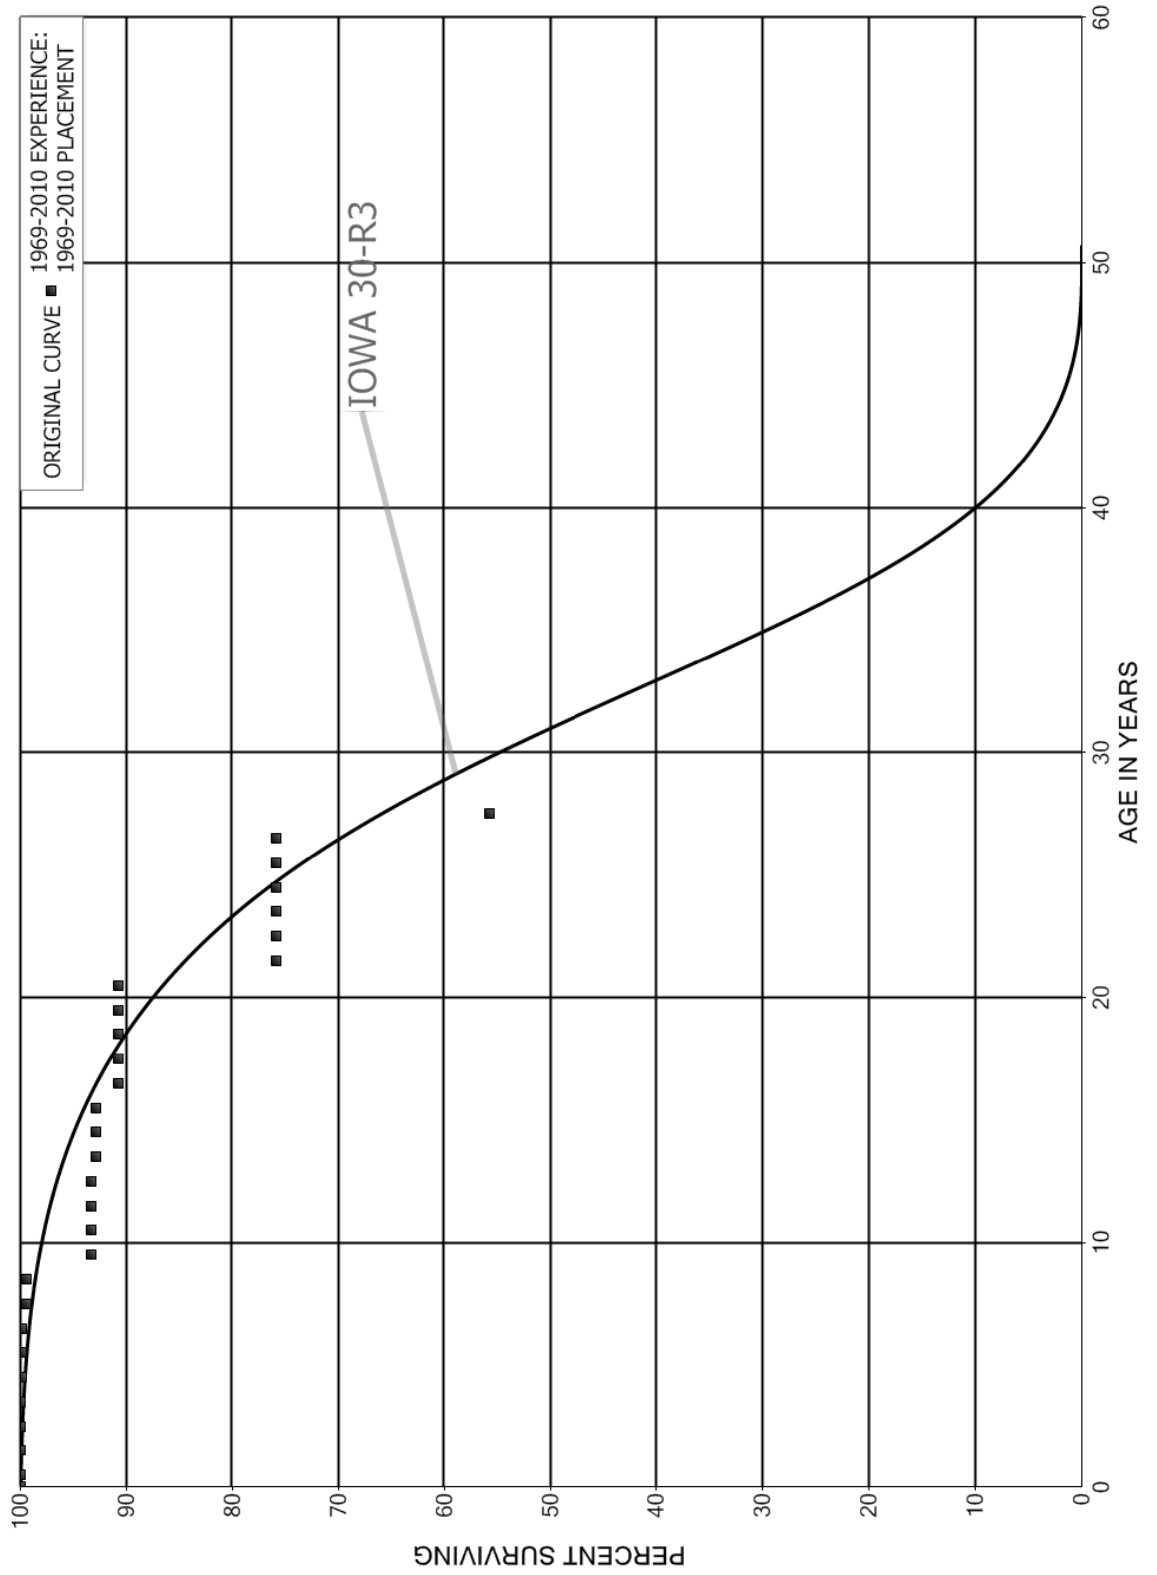


MANITOBA HYDRO

ACCOUNT 1300B - BUILDINGS

ORIGINAL LIFE TABLE

PLACEMENT BAND 1969-2010			EXPERIENCE BAND 1969-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
0.0	9,583,878	6,187	0.0006	0.9994	100.00	
0.5	9,572,965		0.0000	1.0000	99.94	
1.5	9,158,746		0.0000	1.0000	99.94	
2.5	8,838,340		0.0000	1.0000	99.94	
3.5	8,837,489	6,018	0.0007	0.9993	99.94	
4.5	8,924,618		0.0000	1.0000	99.87	
5.5	8,807,177		0.0000	1.0000	99.87	
6.5	6,607,729	27,966	0.0042	0.9958	99.87	
7.5	6,579,763		0.0000	1.0000	99.44	
8.5	6,579,763	405,204	0.0616	0.9384	99.44	
9.5	5,858,745		0.0000	1.0000	93.32	
10.5	2,959,957		0.0000	1.0000	93.32	
11.5	2,959,957		0.0000	1.0000	93.32	
12.5	2,296,581	11,963	0.0052	0.9948	93.32	
13.5	694,911		0.0000	1.0000	92.83	
14.5	694,911		0.0000	1.0000	92.83	
15.5	694,911	15,439	0.0222	0.9778	92.83	
16.5	622,424		0.0000	1.0000	90.77	
17.5	622,424		0.0000	1.0000	90.77	
18.5	622,424		0.0000	1.0000	90.77	
19.5	312,471		0.0000	1.0000	90.77	
20.5	312,471	51,461	0.1647	0.8353	90.77	
21.5	261,010		0.0000	1.0000	75.82	
22.5	261,010		0.0000	1.0000	75.82	
23.5	252,203		0.0000	1.0000	75.82	
24.5	252,203		0.0000	1.0000	75.82	
25.5	252,203		0.0000	1.0000	75.82	
26.5	86,796	22,979	0.2648	0.7352	75.82	
27.5	63,817		0.0000	1.0000	55.75	
28.5	53,817		0.0000	1.0000	55.75	
29.5	53,817		0.0000	1.0000	55.75	
30.5	53,817		0.0000	1.0000	55.75	
31.5	53,817		0.0000	1.0000	55.75	
32.5					55.75	

MANITOBA HYDRO
ACCOUNT 1300N - ENGINES AND GENERATORS
ORIGINAL AND SMOOTH SURVIVOR CURVES

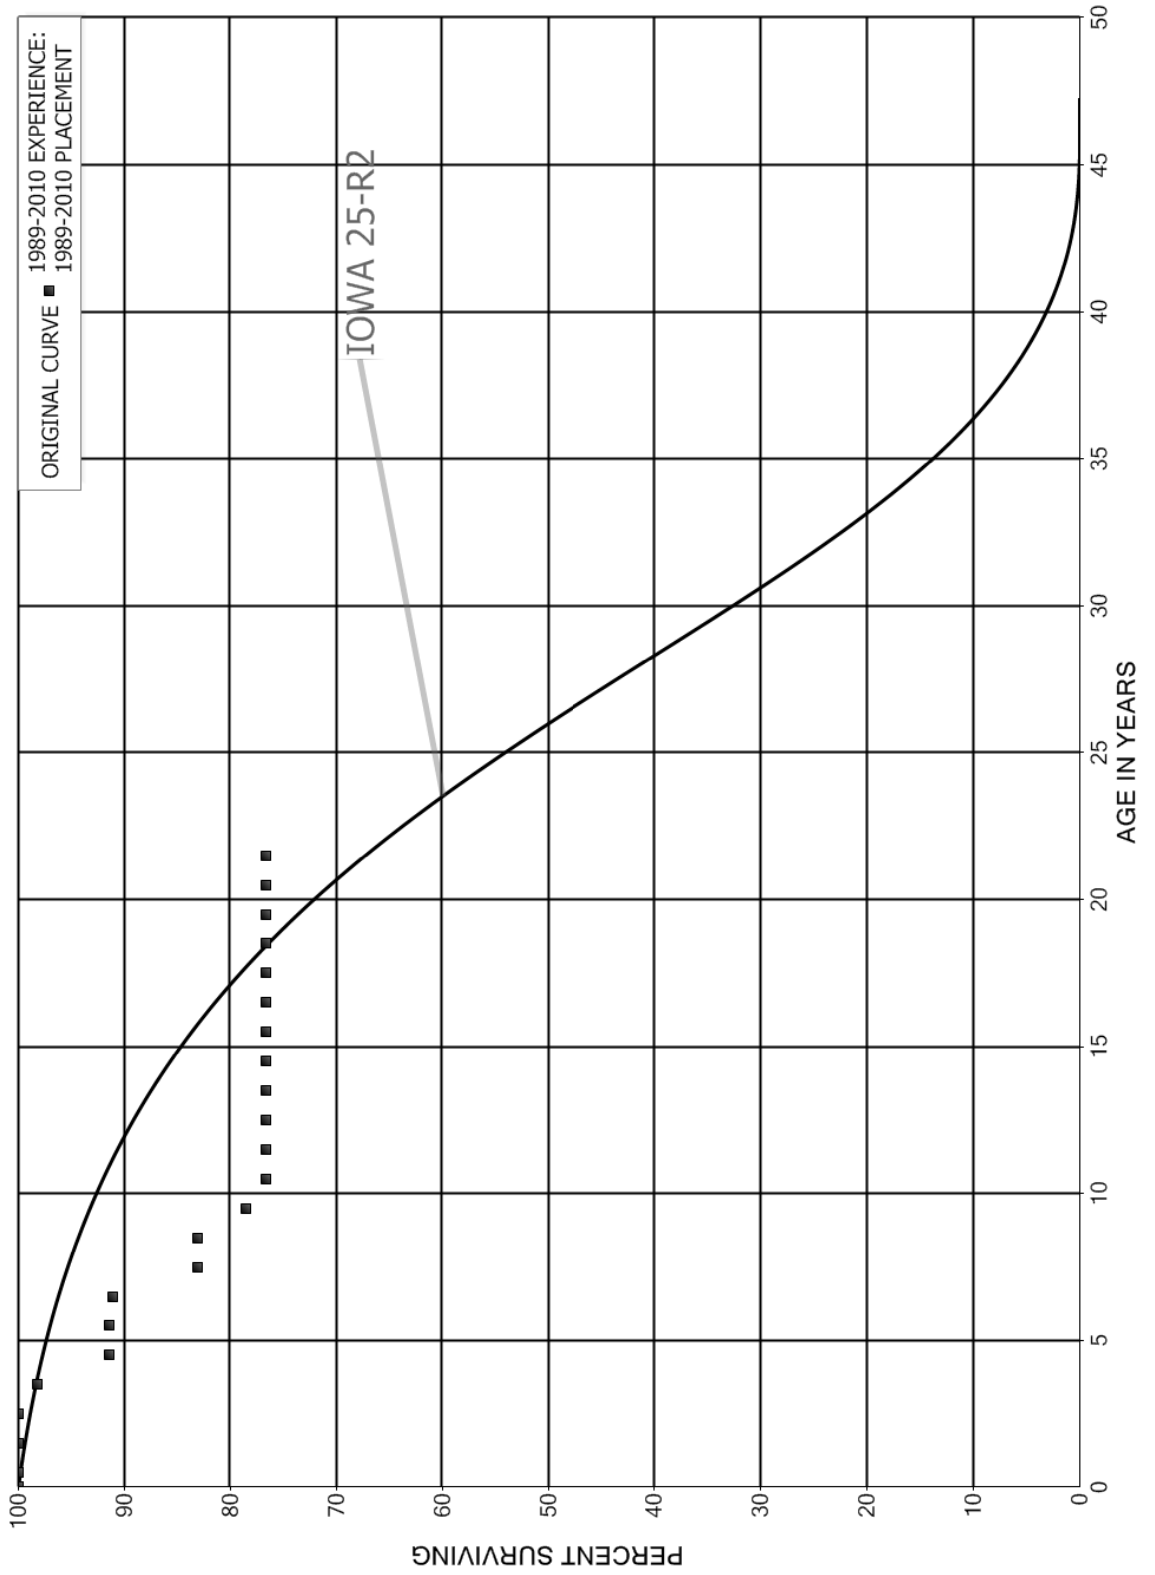


MANITOBA HYDRO

ACCOUNT 1300N - ENGINES AND GENERATORS

ORIGINAL LIFE TABLE

PLACEMENT BAND 1989-2010			EXPERIENCE BAND 1989-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
0.0	21,060,023	877	0.0000	1.0000	100.00	
0.5	20,087,437		0.0000	1.0000	100.00	
1.5	20,002,462		0.0000	1.0000	100.00	
2.5	20,002,462	357,976	0.0179	0.9821	100.00	
3.5	18,921,328	1,307,837	0.0691	0.9309	98.21	
4.5	16,145,983		0.0000	1.0000	91.42	
5.5	15,588,645	59,016	0.0038	0.9962	91.42	
6.5	9,913,245	875,373	0.0883	0.9117	91.07	
7.5	9,037,872		0.0000	1.0000	83.03	
8.5	9,037,872	487,350	0.0539	0.9461	83.03	
9.5	7,944,411	193,546	0.0244	0.9756	78.55	
10.5	5,055,358		0.0000	1.0000	76.64	
11.5	5,055,358		0.0000	1.0000	76.64	
12.5	4,350,668		0.0000	1.0000	76.64	
13.5	1,492,509		0.0000	1.0000	76.64	
14.5	1,475,614		0.0000	1.0000	76.64	
15.5	1,475,614		0.0000	1.0000	76.64	
16.5	469,356		0.0000	1.0000	76.64	
17.5	351,053		0.0000	1.0000	76.64	
18.5	254,269		0.0000	1.0000	76.64	
19.5	111,048		0.0000	1.0000	76.64	
20.5	60,048		0.0000	1.0000	76.64	
21.5					76.64	

MANITOBA HYDRO
ACCOUNT 1300Q - ACCESSORY STATION EQUIPMENT
ORIGINAL AND SMOOTH SURVIVOR CURVES

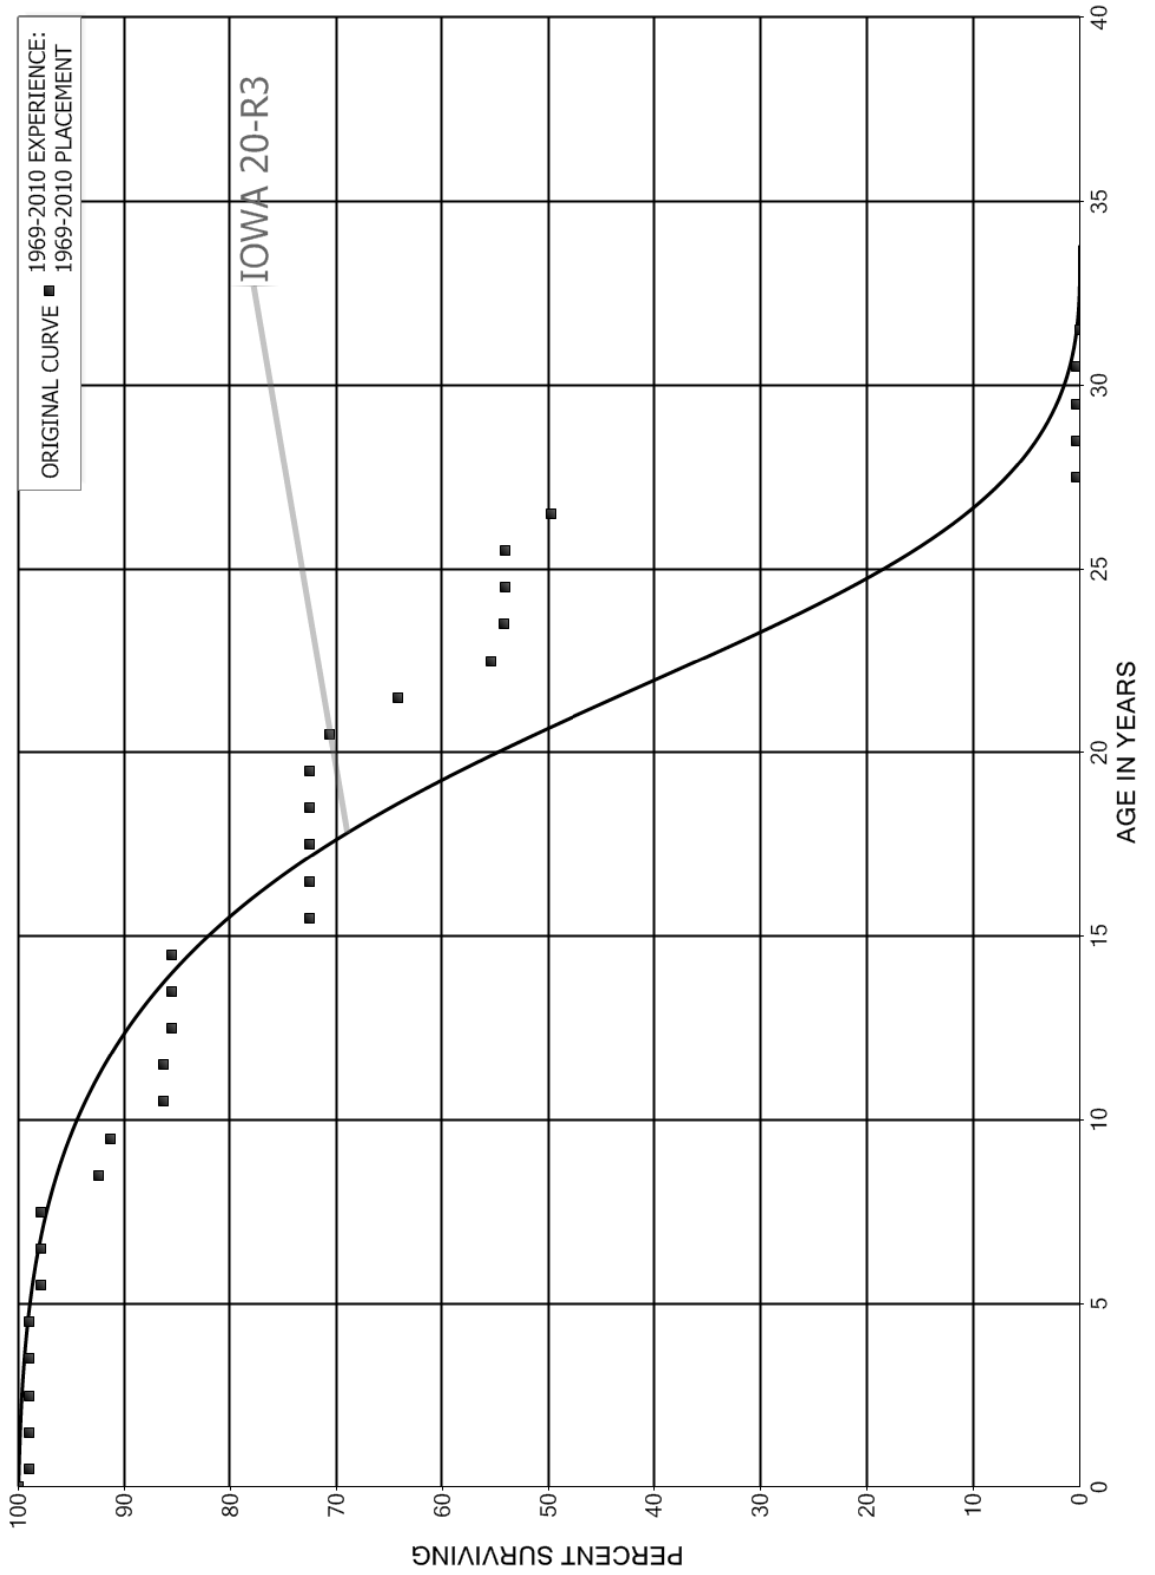


MANITOBA HYDRO

ACCOUNT 1300Q - ACCESSORY STATION EQUIPMENT

ORIGINAL LIFE TABLE

PLACEMENT BAND 1969-2010			EXPERIENCE BAND 1969-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	20,671,711	220,998	0.0107	0.9893	100.00
0.5	20,389,293		0.0000	1.0000	98.93
1.5	20,511,933		0.0000	1.0000	98.93
2.5	13,434,722		0.0000	1.0000	98.93
3.5	13,388,883		0.0000	1.0000	98.93
4.5	13,266,250	147,056	0.0111	0.9889	98.93
5.5	13,043,459		0.0000	1.0000	97.83
6.5	8,961,148		0.0000	1.0000	97.83
7.5	8,933,438	493,353	0.0552	0.9448	97.83
8.5	7,783,674	99,124	0.0127	0.9873	92.43
9.5	6,756,811	366,421	0.0542	0.9458	91.25
10.5	4,347,888		0.0000	1.0000	86.31
11.5	4,347,259	39,448	0.0091	0.9909	86.31
12.5	3,504,963		0.0000	1.0000	85.52
13.5	1,526,698	1,162	0.0008	0.9992	85.52
14.5	1,519,129	229,472	0.1511	0.8489	85.46
15.5	1,220,072		0.0000	1.0000	72.55
16.5	439,405		0.0000	1.0000	72.55
17.5	365,774		0.0000	1.0000	72.55
18.5	365,774		0.0000	1.0000	72.55
19.5	365,657	9,808	0.0268	0.9732	72.55
20.5	355,849	32,170	0.0904	0.9096	70.60
21.5	323,679	44,556	0.1377	0.8623	64.22
22.5	279,123	5,924	0.0212	0.9788	55.38
23.5	272,640	736	0.0027	0.9973	54.20
24.5	271,904		0.0000	1.0000	54.06
25.5	255,999	20,443	0.0799	0.9201	54.06
26.5	9,791	9,734	0.9942	0.0058	49.74
27.5	57		0.0000	1.0000	0.29
28.5	57		0.0000	1.0000	0.29
29.5	57		0.0000	1.0000	0.29
30.5	57	57	1.0000		0.29
31.5					

MANITOBA HYDRO
ACCOUNT 1300T - FUEL STORAGE AND HANDLING
ORIGINAL AND SMOOTH SURVIVOR CURVES

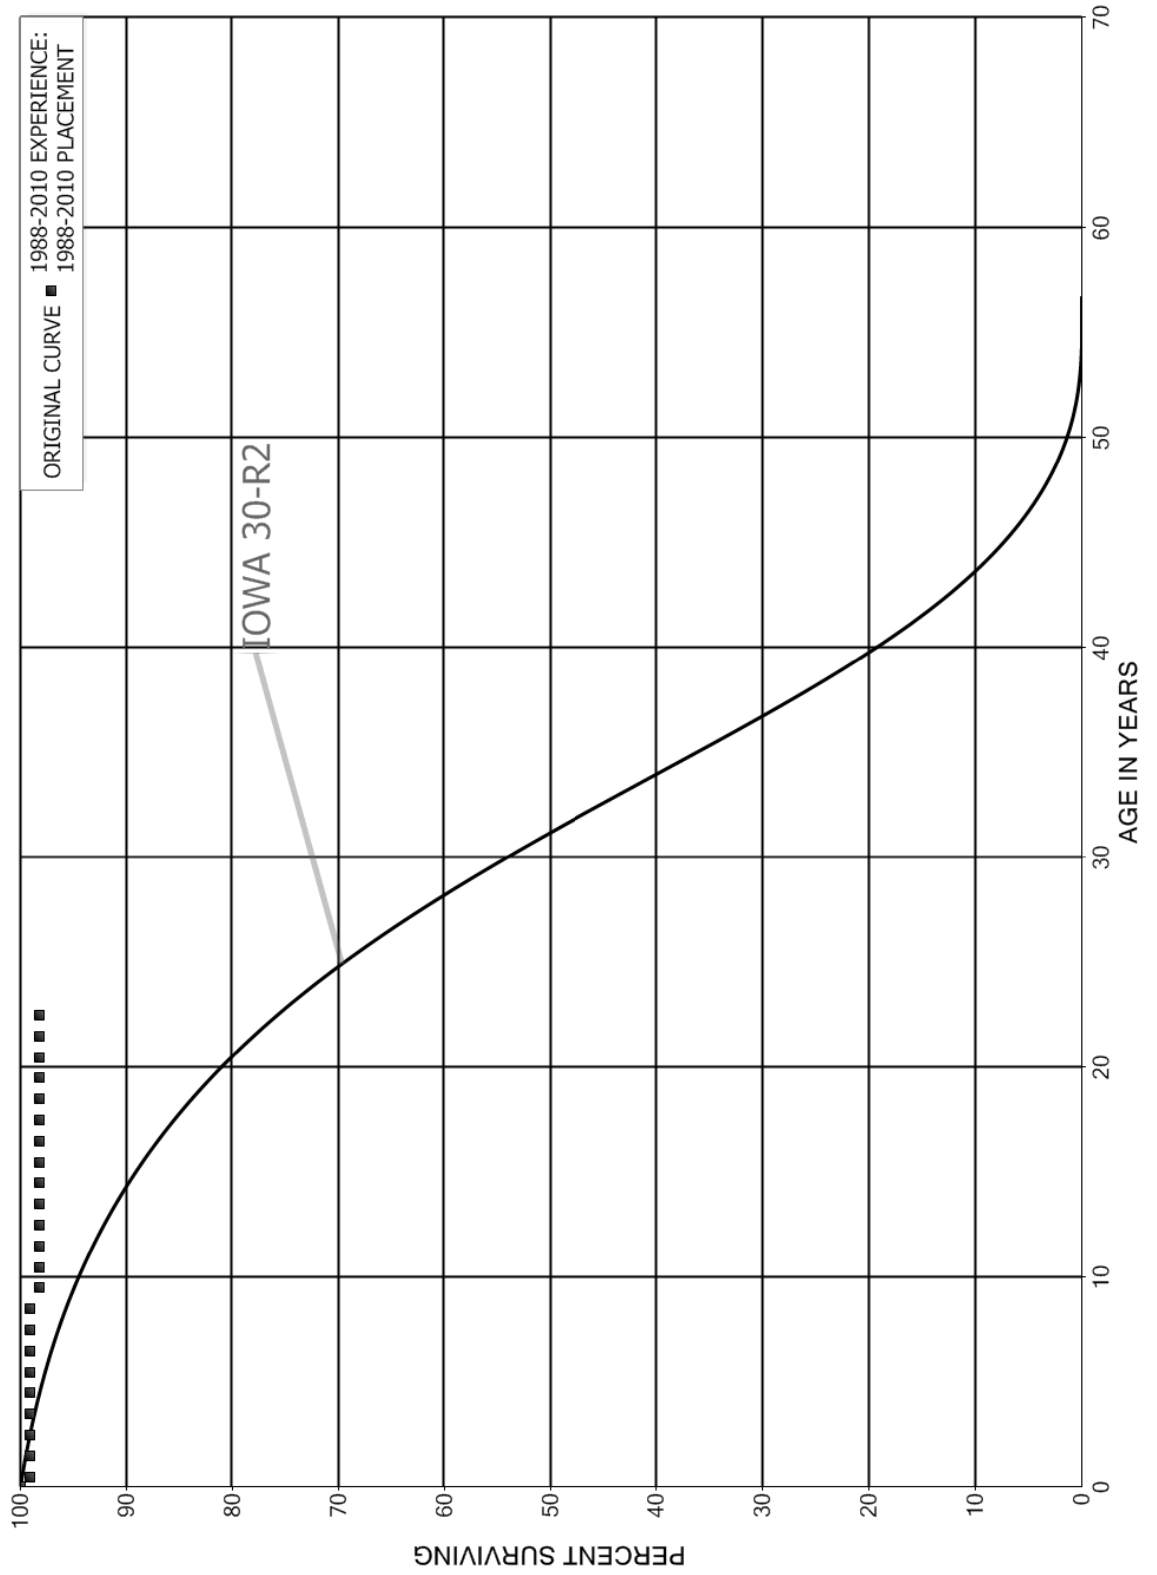


MANITOBA HYDRO

ACCOUNT 1300T - FUEL STORAGE AND HANDLING

ORIGINAL LIFE TABLE

PLACEMENT BAND 1988-2010			EXPERIENCE BAND 1988-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
0.0	3,405,930	31,628	0.0093	0.9907	100.00	
0.5	3,330,440		0.0000	1.0000	99.07	
1.5	3,330,440		0.0000	1.0000	99.07	
2.5	3,320,986		0.0000	1.0000	99.07	
3.5	3,306,891		0.0000	1.0000	99.07	
4.5	3,013,661		0.0000	1.0000	99.07	
5.5	3,036,653		0.0000	1.0000	99.07	
6.5	2,669,779		0.0000	1.0000	99.07	
7.5	2,669,217		0.0000	1.0000	99.07	
8.5	2,464,786	23,319	0.0095	0.9905	99.07	
9.5	2,195,067		0.0000	1.0000	98.13	
10.5	1,793,128		0.0000	1.0000	98.13	
11.5	1,793,128		0.0000	1.0000	98.13	
12.5	1,783,166		0.0000	1.0000	98.13	
13.5	585,990		0.0000	1.0000	98.13	
14.5	399,150		0.0000	1.0000	98.13	
15.5	399,150		0.0000	1.0000	98.13	
16.5	364,446		0.0000	1.0000	98.13	
17.5	333,000		0.0000	1.0000	98.13	
18.5	333,000		0.0000	1.0000	98.13	
19.5	146,401		0.0000	1.0000	98.13	
20.5	146,401		0.0000	1.0000	98.13	
21.5	45,394		0.0000	1.0000	98.13	
22.5					98.13	

MANITOBA HYDRO
ACCOUNT 2000F - ROADS, TRAILS AND BRIDGES
ORIGINAL AND SMOOTH SURVIVOR CURVES

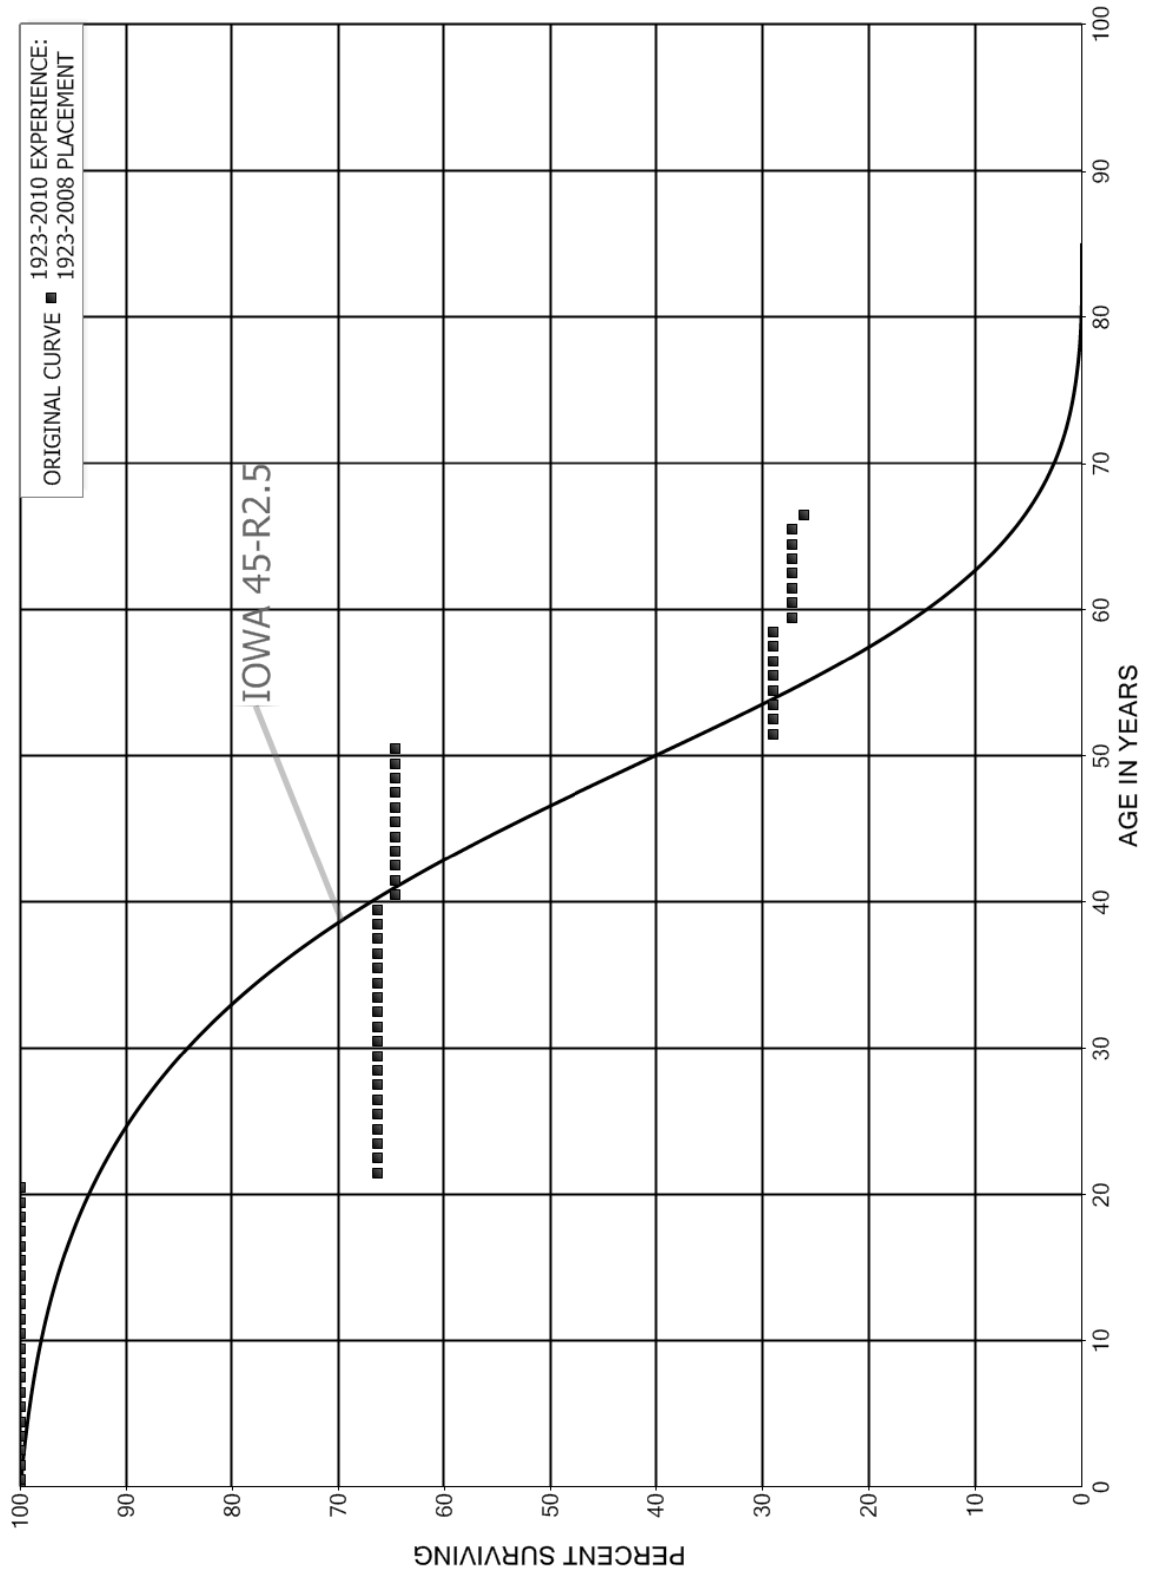

MANITOBA HYDRO

ACCOUNT 2000F - ROADS, TRAILS AND BRIDGES

ORIGINAL LIFE TABLE

PLACEMENT BAND 1923-2008			EXPERIENCE BAND 1923-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
0.0	4,214,395	1,449	0.0003	0.9997	100.00	
0.5	4,212,946		0.0000	1.0000	99.97	
1.5	4,212,946		0.0000	1.0000	99.97	
2.5	3,761,975		0.0000	1.0000	99.97	
3.5	3,525,385		0.0000	1.0000	99.97	
4.5	3,505,941		0.0000	1.0000	99.97	
5.5	3,505,941		0.0000	1.0000	99.97	
6.5	3,505,941		0.0000	1.0000	99.97	
7.5	3,487,836		0.0000	1.0000	99.97	
8.5	3,450,133		0.0000	1.0000	99.97	
9.5	3,287,169		0.0000	1.0000	99.97	
10.5	3,050,719		0.0000	1.0000	99.97	
11.5	1,703,056		0.0000	1.0000	99.97	
12.5	491,868		0.0000	1.0000	99.97	
13.5	491,868		0.0000	1.0000	99.97	
14.5	491,868		0.0000	1.0000	99.97	
15.5	491,868		0.0000	1.0000	99.97	
16.5	491,868		0.0000	1.0000	99.97	
17.5	362,885		0.0000	1.0000	99.97	
18.5	362,885		0.0000	1.0000	99.97	
19.5	362,885		0.0000	1.0000	99.97	
20.5	362,885	122,342	0.3371	0.6629	99.97	
21.5	219,959		0.0000	1.0000	66.26	
22.5	219,959		0.0000	1.0000	66.26	
23.5	219,959		0.0000	1.0000	66.26	
24.5	219,959		0.0000	1.0000	66.26	
25.5	219,959		0.0000	1.0000	66.26	
26.5	219,959		0.0000	1.0000	66.26	
27.5	219,959		0.0000	1.0000	66.26	
28.5	219,959		0.0000	1.0000	66.26	
29.5	219,959		0.0000	1.0000	66.26	
30.5	219,959		0.0000	1.0000	66.26	
31.5	169,463		0.0000	1.0000	66.26	
32.5	169,463		0.0000	1.0000	66.26	
33.5	169,463		0.0000	1.0000	66.26	
34.5	169,463		0.0000	1.0000	66.26	
35.5	169,463		0.0000	1.0000	66.26	
36.5	169,463		0.0000	1.0000	66.26	
37.5	162,692		0.0000	1.0000	66.26	
38.5	162,692		0.0000	1.0000	66.26	

MANITOBA HYDRO

ACCOUNT 2000F - ROADS, TRAILS AND BRIDGES

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1923-2008			EXPERIENCE BAND 1923-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
39.5	162,692	4,066	0.0250	0.9750	66.26	
40.5	158,625		0.0000	1.0000	64.61	
41.5	149,818		0.0000	1.0000	64.61	
42.5	149,818		0.0000	1.0000	64.61	
43.5	149,818		0.0000	1.0000	64.61	
44.5	69,251		0.0000	1.0000	64.61	
45.5	69,251		0.0000	1.0000	64.61	
46.5	69,251		0.0000	1.0000	64.61	
47.5	69,251		0.0000	1.0000	64.61	
48.5	69,251		0.0000	1.0000	64.61	
49.5	69,251		0.0000	1.0000	64.61	
50.5	69,251	38,172	0.5512	0.4488	64.61	
51.5	31,079		0.0000	1.0000	29.00	
52.5	31,079		0.0000	1.0000	29.00	
53.5	31,079		0.0000	1.0000	29.00	
54.5	31,079		0.0000	1.0000	29.00	
55.5	31,079		0.0000	1.0000	29.00	
56.5	31,079		0.0000	1.0000	29.00	
57.5	31,079		0.0000	1.0000	29.00	
58.5	31,079	1,948	0.0627	0.9373	29.00	
59.5	29,132		0.0000	1.0000	27.18	
60.5	29,132		0.0000	1.0000	27.18	
61.5	16,509		0.0000	1.0000	27.18	
62.5	16,509		0.0000	1.0000	27.18	
63.5	16,509		0.0000	1.0000	27.18	
64.5	16,509		0.0000	1.0000	27.18	
65.5	16,509	700	0.0424	0.9576	27.18	
66.5	15,809		0.0000	1.0000	26.03	
67.5	15,809		0.0000	1.0000	26.03	
68.5	15,809		0.0000	1.0000	26.03	
69.5	15,809		0.0000	1.0000	26.03	
70.5	15,809		0.0000	1.0000	26.03	
71.5	15,809		0.0000	1.0000	26.03	
72.5	15,809		0.0000	1.0000	26.03	
73.5	15,809		0.0000	1.0000	26.03	
74.5	15,809		0.0000	1.0000	26.03	
75.5	15,809		0.0000	1.0000	26.03	
76.5	15,809		0.0000	1.0000	26.03	
77.5	15,809		0.0000	1.0000	26.03	
78.5	15,809		0.0000	1.0000	26.03	


MANITOBA HYDRO

ACCOUNT 2000F - ROADS, TRAILS AND BRIDGES

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1923-2008			EXPERIENCE BAND 1923-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
79.5	15,809		0.0000	1.0000	26.03
80.5	4,982		0.0000	1.0000	26.03
81.5	4,982		0.0000	1.0000	26.03
82.5	4,982		0.0000	1.0000	26.03
83.5	4,982		0.0000	1.0000	26.03
84.5	4,982		0.0000	1.0000	26.03
85.5	4,982		0.0000	1.0000	26.03
86.5	4,982		0.0000	1.0000	26.03
87.5					26.03

MANITOBA HYDRO
ACCOUNT 2000G - METAL TOWERS AND CONCRETE POLES
ORIGINAL AND SMOOTH SURVIVOR CURVES

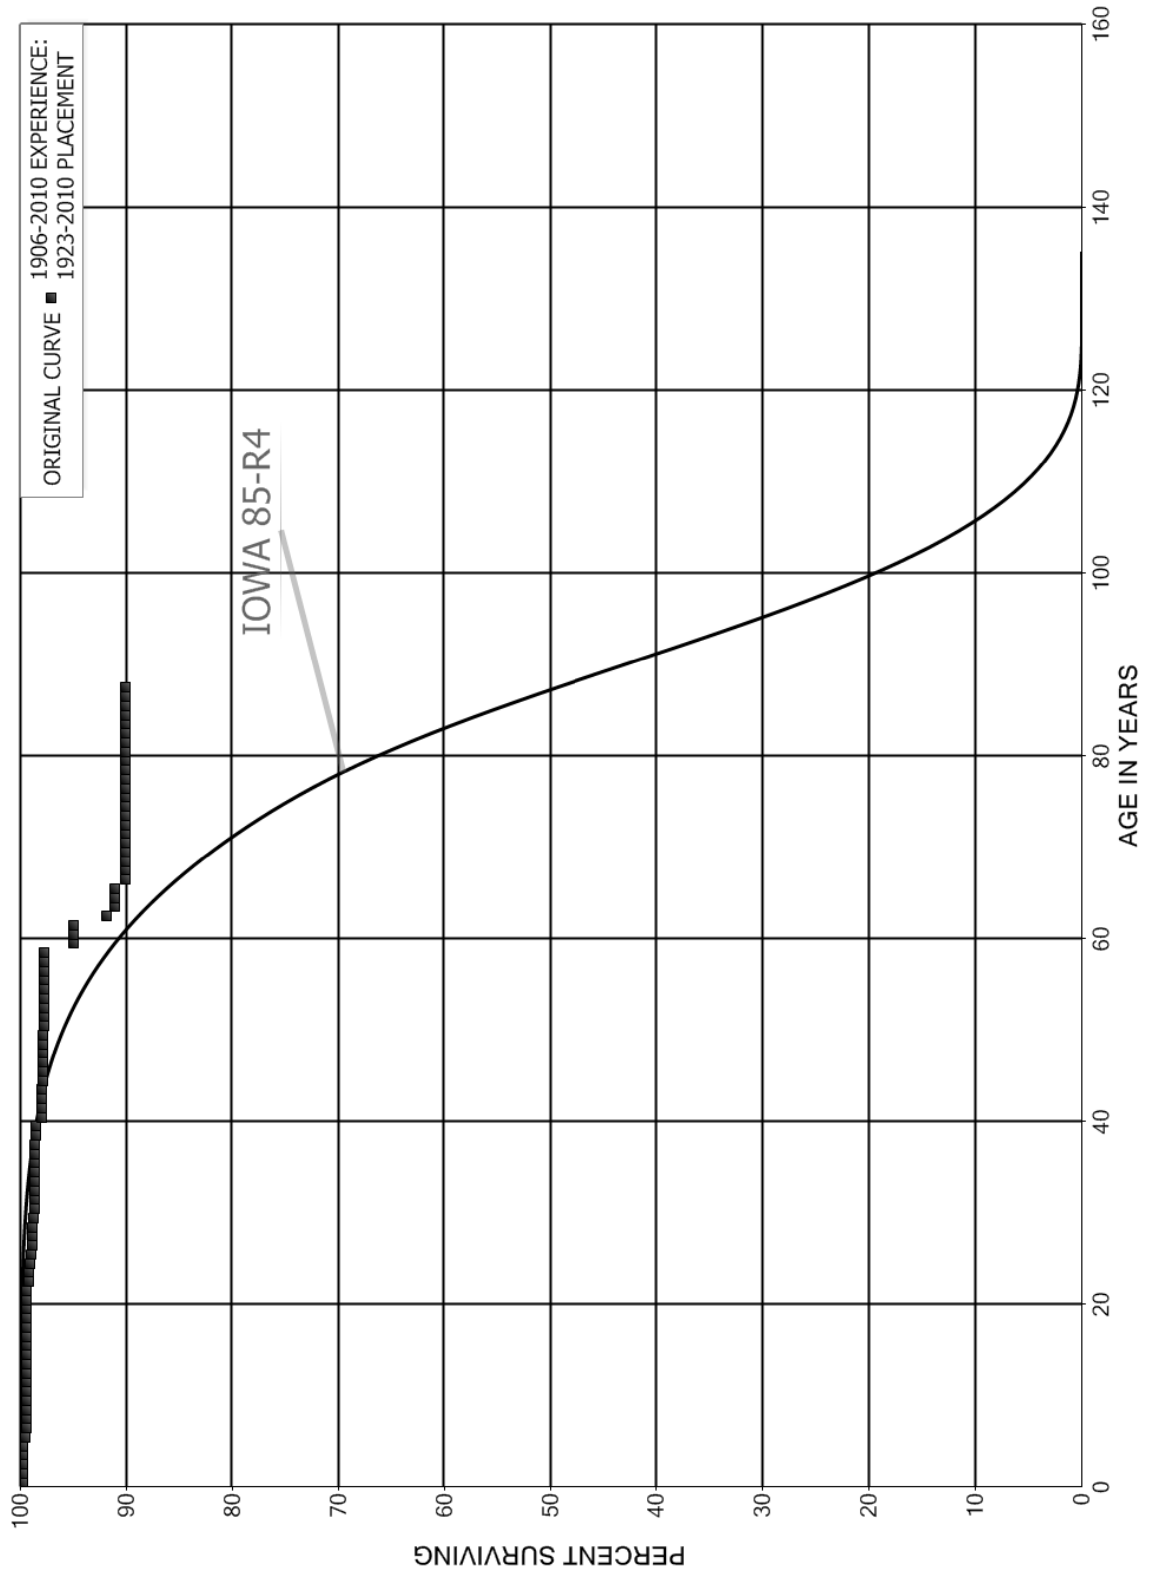

MANITOBA HYDRO

ACCOUNT 2000G - METAL TOWERS AND CONCRETE POLES

ORIGINAL LIFE TABLE

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1906-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	343,221,273	790,419	0.0023	0.9977	100.00
0.5	341,263,398	97,340	0.0003	0.9997	99.77
1.5	340,028,377		0.0000	1.0000	99.74
2.5	334,825,846	23,659	0.0001	0.9999	99.74
3.5	328,454,824	633	0.0000	1.0000	99.73
4.5	325,322,955	792,488	0.0024	0.9976	99.73
5.5	323,308,335	175,753	0.0005	0.9995	99.49
6.5	321,664,814	1,784	0.0000	1.0000	99.44
7.5	311,759,023		0.0000	1.0000	99.44
8.5	308,300,878	7,135	0.0000	1.0000	99.44
9.5	286,912,989	800	0.0000	1.0000	99.43
10.5	283,661,591	35	0.0000	1.0000	99.43
11.5	254,545,487		0.0000	1.0000	99.43
12.5	213,536,288	7,526	0.0000	1.0000	99.43
13.5	193,910,406		0.0000	1.0000	99.43
14.5	193,170,631		0.0000	1.0000	99.43
15.5	188,959,516	13,873	0.0001	0.9999	99.43
16.5	187,948,087		0.0000	1.0000	99.42
17.5	187,410,338		0.0000	1.0000	99.42
18.5	184,464,992		0.0000	1.0000	99.42
19.5	183,022,654	71,732	0.0004	0.9996	99.42
20.5	180,460,002	783	0.0000	1.0000	99.38
21.5	160,035,959	283,982	0.0018	0.9982	99.38
22.5	159,361,386	127,407	0.0008	0.9992	99.21
23.5	158,908,885	68,000	0.0004	0.9996	99.13
24.5	158,534,829	157,879	0.0010	0.9990	99.09
25.5	141,971,893	185,278	0.0013	0.9987	98.99
26.5	141,023,871	2,392	0.0000	1.0000	98.86
27.5	141,021,479		0.0000	1.0000	98.86
28.5	55,226,157	91,411	0.0017	0.9983	98.86
29.5	54,909,666	25,130	0.0005	0.9995	98.69
30.5	45,455,622		0.0000	1.0000	98.65
31.5	44,322,516	2,483	0.0001	0.9999	98.65
32.5	41,177,892		0.0000	1.0000	98.64
33.5	37,025,046		0.0000	1.0000	98.64
34.5	35,683,656		0.0000	1.0000	98.64
35.5	34,836,510		0.0000	1.0000	98.64
36.5	31,835,413	879	0.0000	1.0000	98.64
37.5	29,855,522	28,174	0.0009	0.9991	98.64
38.5	24,885,015		0.0000	1.0000	98.55

MANITOBA HYDRO

ACCOUNT 2000G - METAL TOWERS AND CONCRETE POLES

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1906-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
39.5	24,551,667	152,354	0.0062	0.9938	98.55
40.5	22,853,880		0.0000	1.0000	97.93
41.5	18,935,574		0.0000	1.0000	97.93
42.5	16,073,564		0.0000	1.0000	97.93
43.5	9,224,201	11,480	0.0012	0.9988	97.93
44.5	9,072,577		0.0000	1.0000	97.81
45.5	7,712,334		0.0000	1.0000	97.81
46.5	7,689,357		0.0000	1.0000	97.81
47.5	7,555,915		0.0000	1.0000	97.81
48.5	5,602,785		0.0000	1.0000	97.81
49.5	5,468,225	2,101	0.0004	0.9996	97.81
50.5	5,451,912		0.0000	1.0000	97.77
51.5	5,226,073		0.0000	1.0000	97.77
52.5	5,132,409		0.0000	1.0000	97.77
53.5	5,132,409	1,064	0.0002	0.9998	97.77
54.5	4,206,828		0.0000	1.0000	97.75
55.5	4,204,286		0.0000	1.0000	97.75
56.5	4,203,945		0.0000	1.0000	97.75
57.5	4,191,699	1,284	0.0003	0.9997	97.75
58.5	3,433,451	96,590	0.0281	0.9719	97.72
59.5	3,336,861		0.0000	1.0000	94.98
60.5	2,901,225		0.0000	1.0000	94.98
61.5	2,512,454	83,486	0.0332	0.9668	94.98
62.5	2,427,520	20,976	0.0086	0.9914	91.82
63.5	2,406,544		0.0000	1.0000	91.03
64.5	2,405,615		0.0000	1.0000	91.03
65.5	2,405,615	25,079	0.0104	0.9896	91.03
66.5	2,380,536		0.0000	1.0000	90.08
67.5	2,380,536		0.0000	1.0000	90.08
68.5	2,380,536		0.0000	1.0000	90.08
69.5	2,380,536		0.0000	1.0000	90.08
70.5	2,380,536		0.0000	1.0000	90.08
71.5	2,380,424		0.0000	1.0000	90.08
72.5	2,380,424		0.0000	1.0000	90.08
73.5	2,380,424		0.0000	1.0000	90.08
74.5	2,380,424		0.0000	1.0000	90.08
75.5	2,380,424		0.0000	1.0000	90.08
76.5	2,380,424		0.0000	1.0000	90.08
77.5	2,380,424		0.0000	1.0000	90.08
78.5	2,380,424		0.0000	1.0000	90.08


MANITOBA HYDRO

ACCOUNT 2000G - METAL TOWERS AND CONCRETE POLES

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1906-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
79.5	1,380,424		0.0000	1.0000	90.08
80.5	861,166		0.0000	1.0000	90.08
81.5	861,166		0.0000	1.0000	90.08
82.5	807,290		0.0000	1.0000	90.08
83.5	185,908		0.0000	1.0000	90.08
84.5	67,433		0.0000	1.0000	90.08
85.5	67,433		0.0000	1.0000	90.08
86.5	67,433		0.0000	1.0000	90.08
87.5					90.08

MANITOBA HYDRO
ACCOUNT 2000J - POLES AND FIXTURES
ORIGINAL AND SMOOTH SURVIVOR CURVES

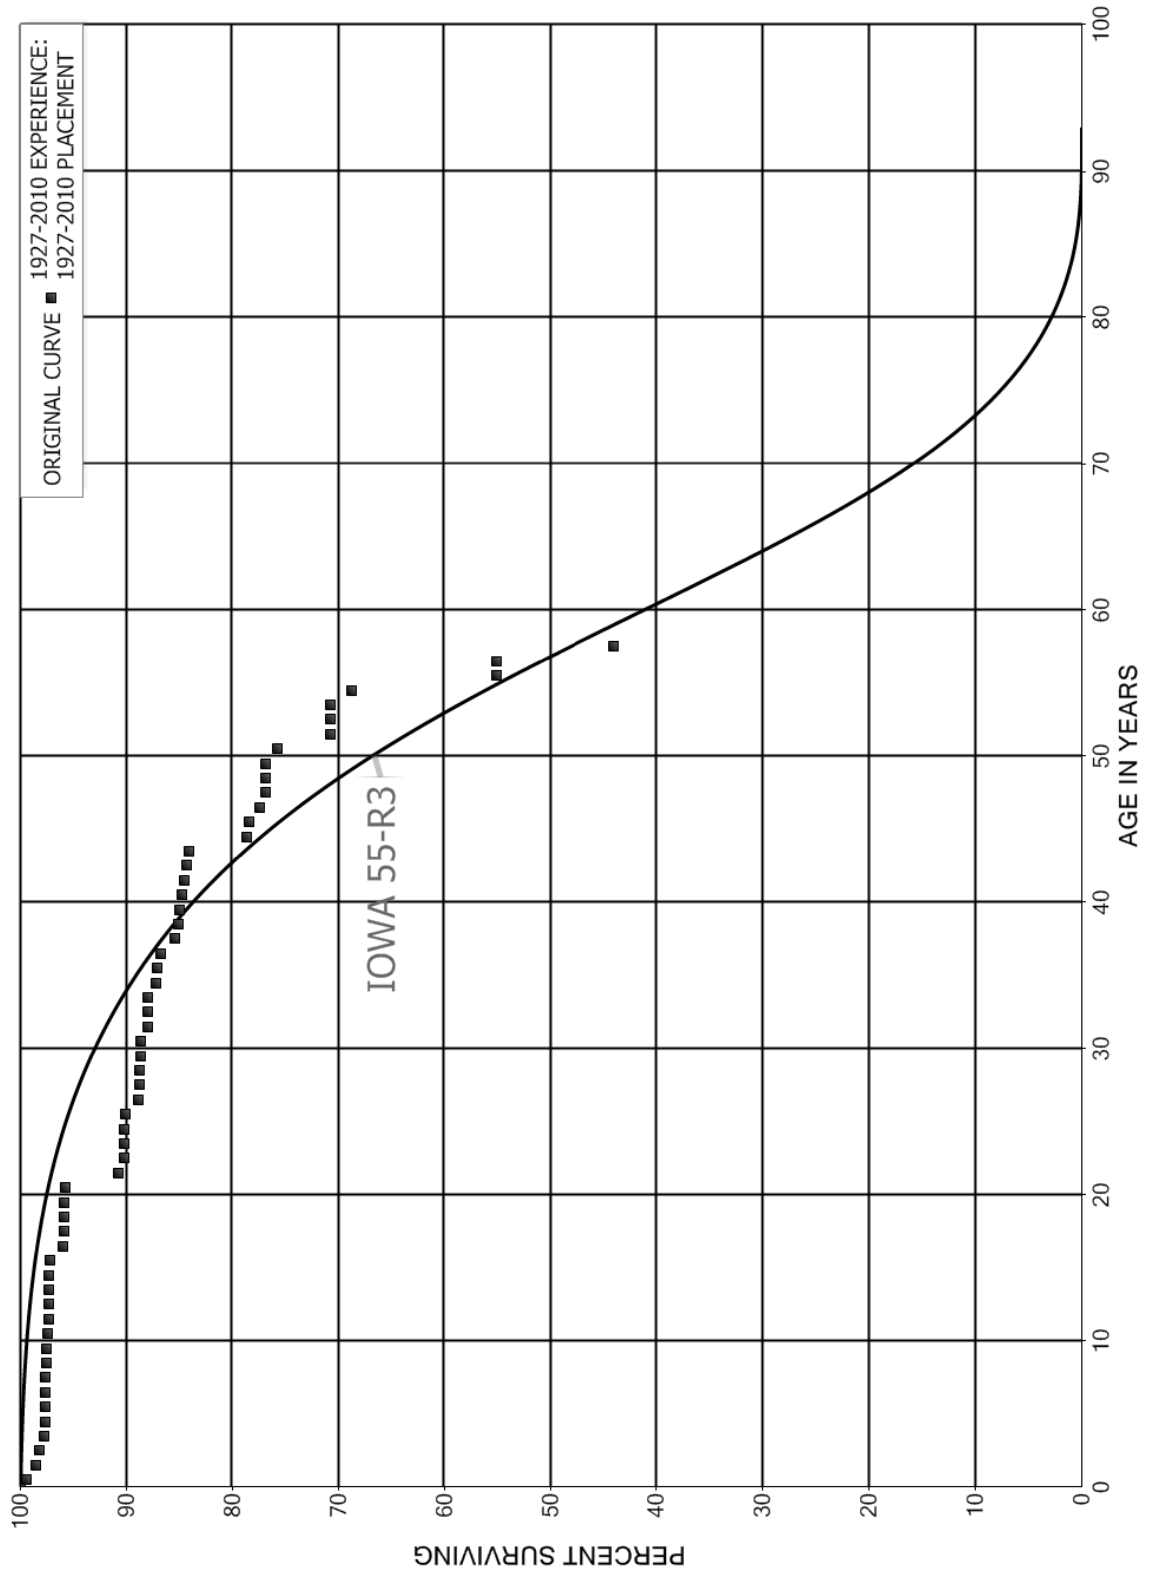

MANITOBA HYDRO

ACCOUNT 2000J - POLES AND FIXTURES

ORIGINAL LIFE TABLE

PLACEMENT BAND 1927-2010			EXPERIENCE BAND 1927-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	111,668,368	643,616	0.0058	0.9942	100.00
0.5	106,229,173	1,004,758	0.0095	0.9905	99.42
1.5	104,087,735	276,957	0.0027	0.9973	98.48
2.5	98,972,816	534,142	0.0054	0.9946	98.22
3.5	88,271,155	36,231	0.0004	0.9996	97.69
4.5	86,199,593	46,189	0.0005	0.9995	97.65
5.5	83,825,180	16,221	0.0002	0.9998	97.60
6.5	82,763,572	12,261	0.0001	0.9999	97.58
7.5	74,836,796	11,785	0.0002	0.9998	97.57
8.5	71,825,670	64,424	0.0009	0.9991	97.55
9.5	69,191,979	50,160	0.0007	0.9993	97.46
10.5	68,691,579	42,292	0.0006	0.9994	97.39
11.5	66,138,851	4,900	0.0001	0.9999	97.33
12.5	58,611,602	22,960	0.0004	0.9996	97.32
13.5	51,901,235	19,187	0.0004	0.9996	97.29
14.5	51,693,357	23,209	0.0004	0.9996	97.25
15.5	47,662,307	630,178	0.0132	0.9868	97.21
16.5	46,446,697	27,087	0.0006	0.9994	95.92
17.5	42,393,943	1,223	0.0000	1.0000	95.87
18.5	36,429,262	1,960	0.0001	0.9999	95.86
19.5	34,793,312	34,568	0.0010	0.9990	95.86
20.5	28,933,082	1,509,587	0.0522	0.9478	95.76
21.5	27,074,219	161,801	0.0060	0.9940	90.77
22.5	26,405,690	4,728	0.0002	0.9998	90.22
23.5	26,328,120	8,924	0.0003	0.9997	90.21
24.5	26,302,393	29,303	0.0011	0.9989	90.18
25.5	22,859,061	312,066	0.0137	0.9863	90.08
26.5	22,382,721	31,466	0.0014	0.9986	88.85
27.5	22,271,752	1,210	0.0001	0.9999	88.72
28.5	20,632,351	14,210	0.0007	0.9993	88.72
29.5	20,495,895	21,308	0.0010	0.9990	88.66
30.5	16,810,912	105,728	0.0063	0.9937	88.56
31.5	16,640,757	10,877	0.0007	0.9993	88.01
32.5	14,198,036	4,082	0.0003	0.9997	87.95
33.5	14,139,071	127,017	0.0090	0.9910	87.92
34.5	11,962,774	10,913	0.0009	0.9991	87.13
35.5	9,185,460	39,914	0.0043	0.9957	87.05
36.5	8,757,253	134,210	0.0153	0.9847	86.68
37.5	8,025,254	27,407	0.0034	0.9966	85.35
38.5	6,066,514	6,927	0.0011	0.9989	85.06


MANITOBA HYDRO

ACCOUNT 2000J - POLES AND FIXTURES

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1927-2010			EXPERIENCE BAND 1927-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
39.5	4,101,535	13,076	0.0032	0.9968	84.96	
40.5	3,687,799	8,236	0.0022	0.9978	84.69	
41.5	3,170,417	9,618	0.0030	0.9970	84.50	
42.5	2,878,485	6,228	0.0022	0.9978	84.24	
43.5	2,053,790	133,128	0.0648	0.9352	84.06	
44.5	1,412,794	3,428	0.0024	0.9976	78.61	
45.5	1,404,299	18,579	0.0132	0.9868	78.42	
46.5	1,385,519	9,159	0.0066	0.9934	77.38	
47.5	1,340,484	887	0.0007	0.9993	76.87	
48.5	1,331,640	86	0.0001	0.9999	76.82	
49.5	733,964	10,497	0.0143	0.9857	76.82	
50.5	721,864	47,796	0.0662	0.9338	75.72	
51.5	638,573		0.0000	1.0000	70.70	
52.5	638,571		0.0000	1.0000	70.70	
53.5	556,958	15,619	0.0280	0.9720	70.70	
54.5	438,220	87,205	0.1990	0.8010	68.72	
55.5	328,315		0.0000	1.0000	55.05	
56.5	281,387	56,990	0.2025	0.7975	55.05	
57.5	224,397		0.0000	1.0000	43.90	
58.5	214,901	83,002	0.3862	0.6138	43.90	
59.5	127,114	121,766	0.9579	0.0421	26.94	
60.5					1.13	

MANITOBA HYDRO
ACCOUNT 2000L - OVERHEAD CONDUCTOR AND DEVICES
ORIGINAL AND SMOOTH SURVIVOR CURVES

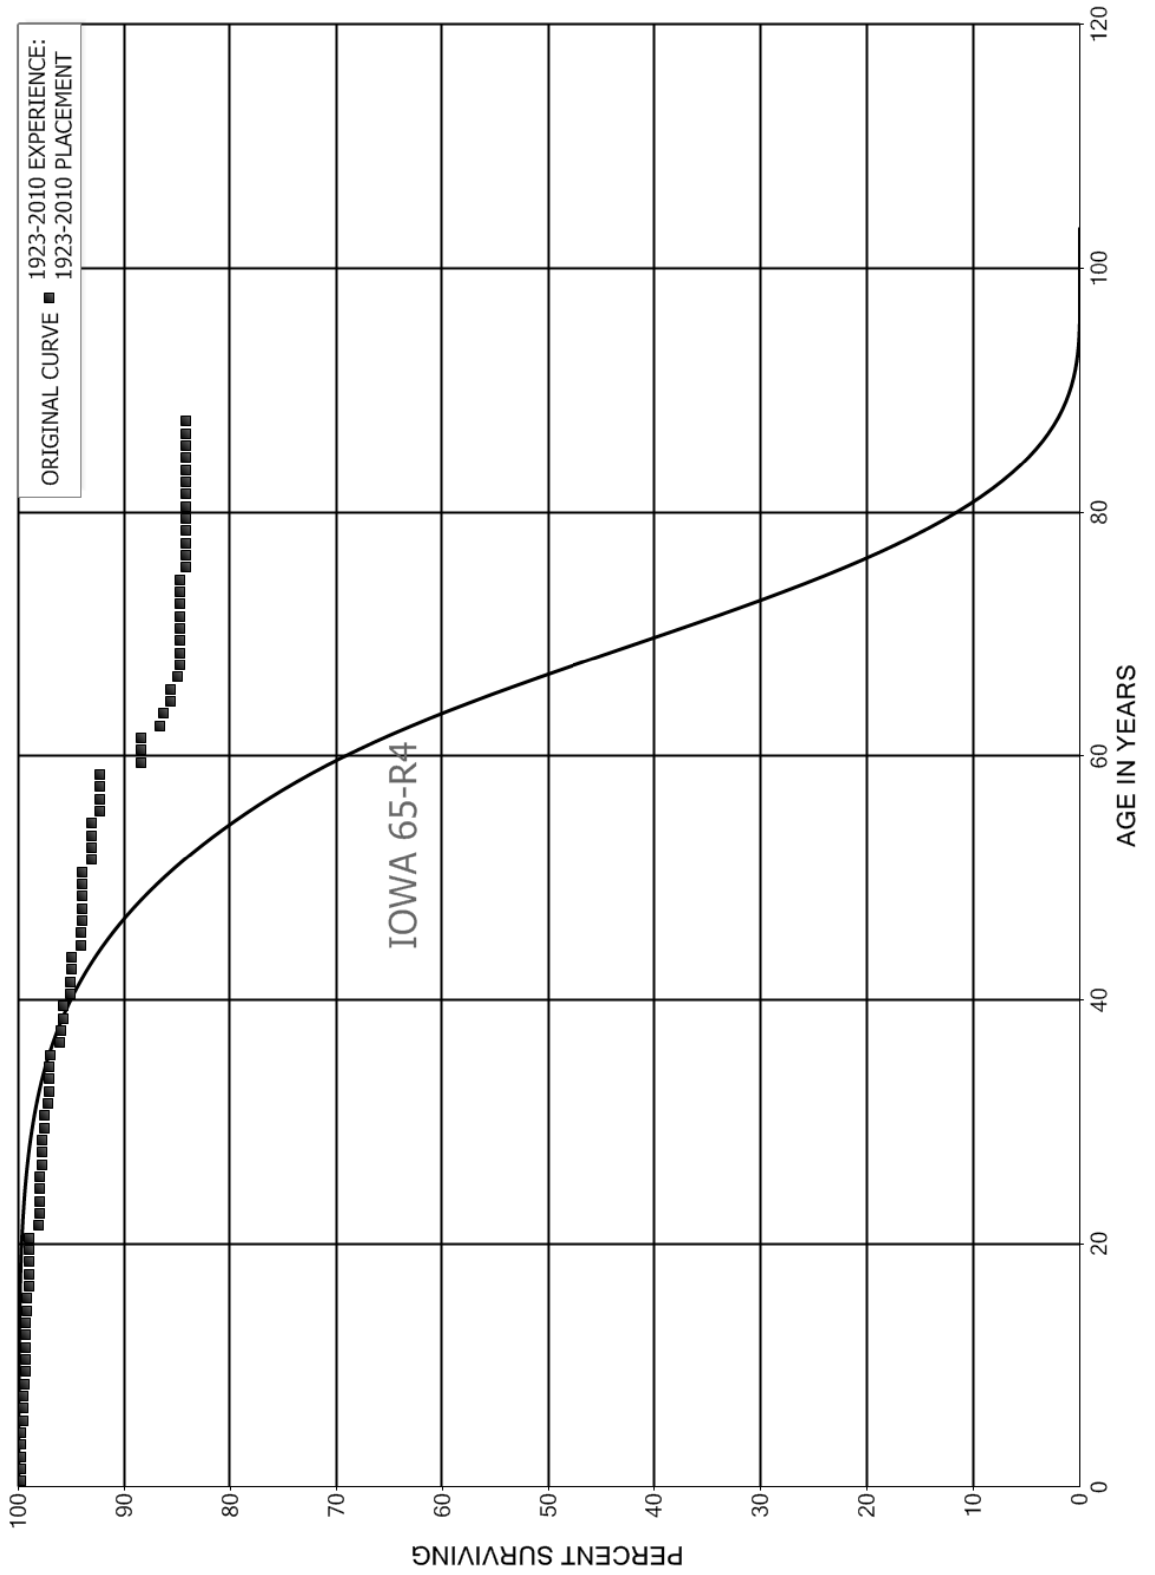

MANITOBA HYDRO

ACCOUNT 2000L - OVERHEAD CONDUCTOR AND DEVICES

ORIGINAL LIFE TABLE

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1923-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	310,397,555	770,980	0.0025	0.9975	100.00
0.5	307,303,595	52,683	0.0002	0.9998	99.75
1.5	305,229,108	20,103	0.0001	0.9999	99.73
2.5	300,792,995	92,075	0.0003	0.9997	99.73
3.5	284,255,781	3,116	0.0000	1.0000	99.70
4.5	281,979,747	535,729	0.0019	0.9981	99.70
5.5	275,231,475	14,647	0.0001	0.9999	99.51
6.5	268,403,518	22,851	0.0001	0.9999	99.50
7.5	254,993,658	155,590	0.0006	0.9994	99.49
8.5	240,977,839	237,587	0.0010	0.9990	99.43
9.5	229,383,648	64,635	0.0003	0.9997	99.33
10.5	225,523,280	10,661	0.0000	1.0000	99.31
11.5	208,929,294	9,064	0.0000	1.0000	99.30
12.5	194,056,844	130,555	0.0007	0.9993	99.30
13.5	175,261,319	6,345	0.0000	1.0000	99.23
14.5	174,809,116	11,385	0.0001	0.9999	99.23
15.5	170,428,236	363,049	0.0021	0.9979	99.22
16.5	168,196,508	5,714	0.0000	1.0000	99.01
17.5	165,728,232	517	0.0000	1.0000	99.01
18.5	161,933,991	38,713	0.0002	0.9998	99.01
19.5	159,277,614	17,720	0.0001	0.9999	98.98
20.5	149,865,868	1,428,380	0.0095	0.9905	98.97
21.5	141,881,506	74,998	0.0005	0.9995	98.03
22.5	141,384,559	3,660	0.0000	1.0000	97.98
23.5	141,367,867	14,783	0.0001	0.9999	97.97
24.5	141,333,278	964	0.0000	1.0000	97.96
25.5	119,067,807	307,764	0.0026	0.9974	97.96
26.5	118,397,803	29,453	0.0002	0.9998	97.71
27.5	118,283,503	4,121	0.0000	1.0000	97.68
28.5	60,426,258	78,173	0.0013	0.9987	97.68
29.5	59,911,466	27,968	0.0005	0.9995	97.55
30.5	53,075,868	198,549	0.0037	0.9963	97.51
31.5	52,270,478	36,235	0.0007	0.9993	97.14
32.5	49,599,922	4,282	0.0001	0.9999	97.08
33.5	44,325,248	22,833	0.0005	0.9995	97.07
34.5	41,268,688	33,318	0.0008	0.9992	97.02
35.5	37,681,208	331,062	0.0088	0.9912	96.94
36.5	34,152,050	59,358	0.0017	0.9983	96.09
37.5	32,230,781	53,918	0.0017	0.9983	95.92
38.5	28,637,167	164	0.0000	1.0000	95.76

MANITOBA HYDRO

ACCOUNT 2000L - OVERHEAD CONDUCTOR AND DEVICES

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1923-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
39.5	26,870,875	197,813	0.0074	0.9926	95.76
40.5	25,475,827	43	0.0000	1.0000	95.06
41.5	23,620,222	16,317	0.0007	0.9993	95.06
42.5	22,854,261	44	0.0000	1.0000	94.99
43.5	12,370,659	124,453	0.0101	0.9899	94.99
44.5	11,668,702	2,272	0.0002	0.9998	94.03
45.5	10,340,557	1,925	0.0002	0.9998	94.02
46.5	10,261,870		0.0000	1.0000	94.00
47.5	10,151,010		0.0000	1.0000	94.00
48.5	7,911,460	1,242	0.0002	0.9998	94.00
49.5	6,638,287	187	0.0000	1.0000	93.98
50.5	6,628,995	67,301	0.0102	0.9898	93.98
51.5	6,515,763		0.0000	1.0000	93.03
52.5	6,504,205		0.0000	1.0000	93.03
53.5	6,260,060		0.0000	1.0000	93.03
54.5	5,242,360	40,592	0.0077	0.9923	93.03
55.5	4,987,541		0.0000	1.0000	92.31
56.5	4,987,541		0.0000	1.0000	92.31
57.5	4,802,836	82	0.0000	1.0000	92.31
58.5	4,178,931	176,478	0.0422	0.9578	92.31
59.5	3,591,350		0.0000	1.0000	88.41
60.5	3,074,940		0.0000	1.0000	88.41
61.5	2,635,288	51,893	0.0197	0.9803	88.41
62.5	2,582,799	11,421	0.0044	0.9956	86.67
63.5	2,571,378	20,820	0.0081	0.9919	86.28
64.5	2,549,505		0.0000	1.0000	85.58
65.5	2,549,505	18,277	0.0072	0.9928	85.58
66.5	2,512,952	6,865	0.0027	0.9973	84.97
67.5	2,506,086		0.0000	1.0000	84.74
68.5	2,506,086		0.0000	1.0000	84.74
69.5	2,506,086		0.0000	1.0000	84.74
70.5	2,506,086		0.0000	1.0000	84.74
71.5	2,505,640		0.0000	1.0000	84.74
72.5	2,505,640		0.0000	1.0000	84.74
73.5	2,505,640		0.0000	1.0000	84.74
74.5	2,505,640	15,280	0.0061	0.9939	84.74
75.5	2,490,360		0.0000	1.0000	84.22
76.5	2,490,360		0.0000	1.0000	84.22
77.5	2,490,360		0.0000	1.0000	84.22
78.5	2,490,360		0.0000	1.0000	84.22


MANITOBA HYDRO

ACCOUNT 2000L - OVERHEAD CONDUCTOR AND DEVICES

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1923-2010			EXPERIENCE BAND 1923-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
79.5	990,360		0.0000	1.0000	84.22
80.5	468,297	119	0.0003	0.9997	84.22
81.5	468,177		0.0000	1.0000	84.20
82.5	428,814		0.0000	1.0000	84.20
83.5	113,957		0.0000	1.0000	84.20
84.5	51,029		0.0000	1.0000	84.20
85.5	51,029		0.0000	1.0000	84.20
86.5	51,029		0.0000	1.0000	84.20
87.5					84.20

MANITOBA HYDRO
ACCOUNT 2000M - UNDERGROUND CABLE AND DEVICES
ORIGINAL AND SMOOTH SURVIVOR CURVES

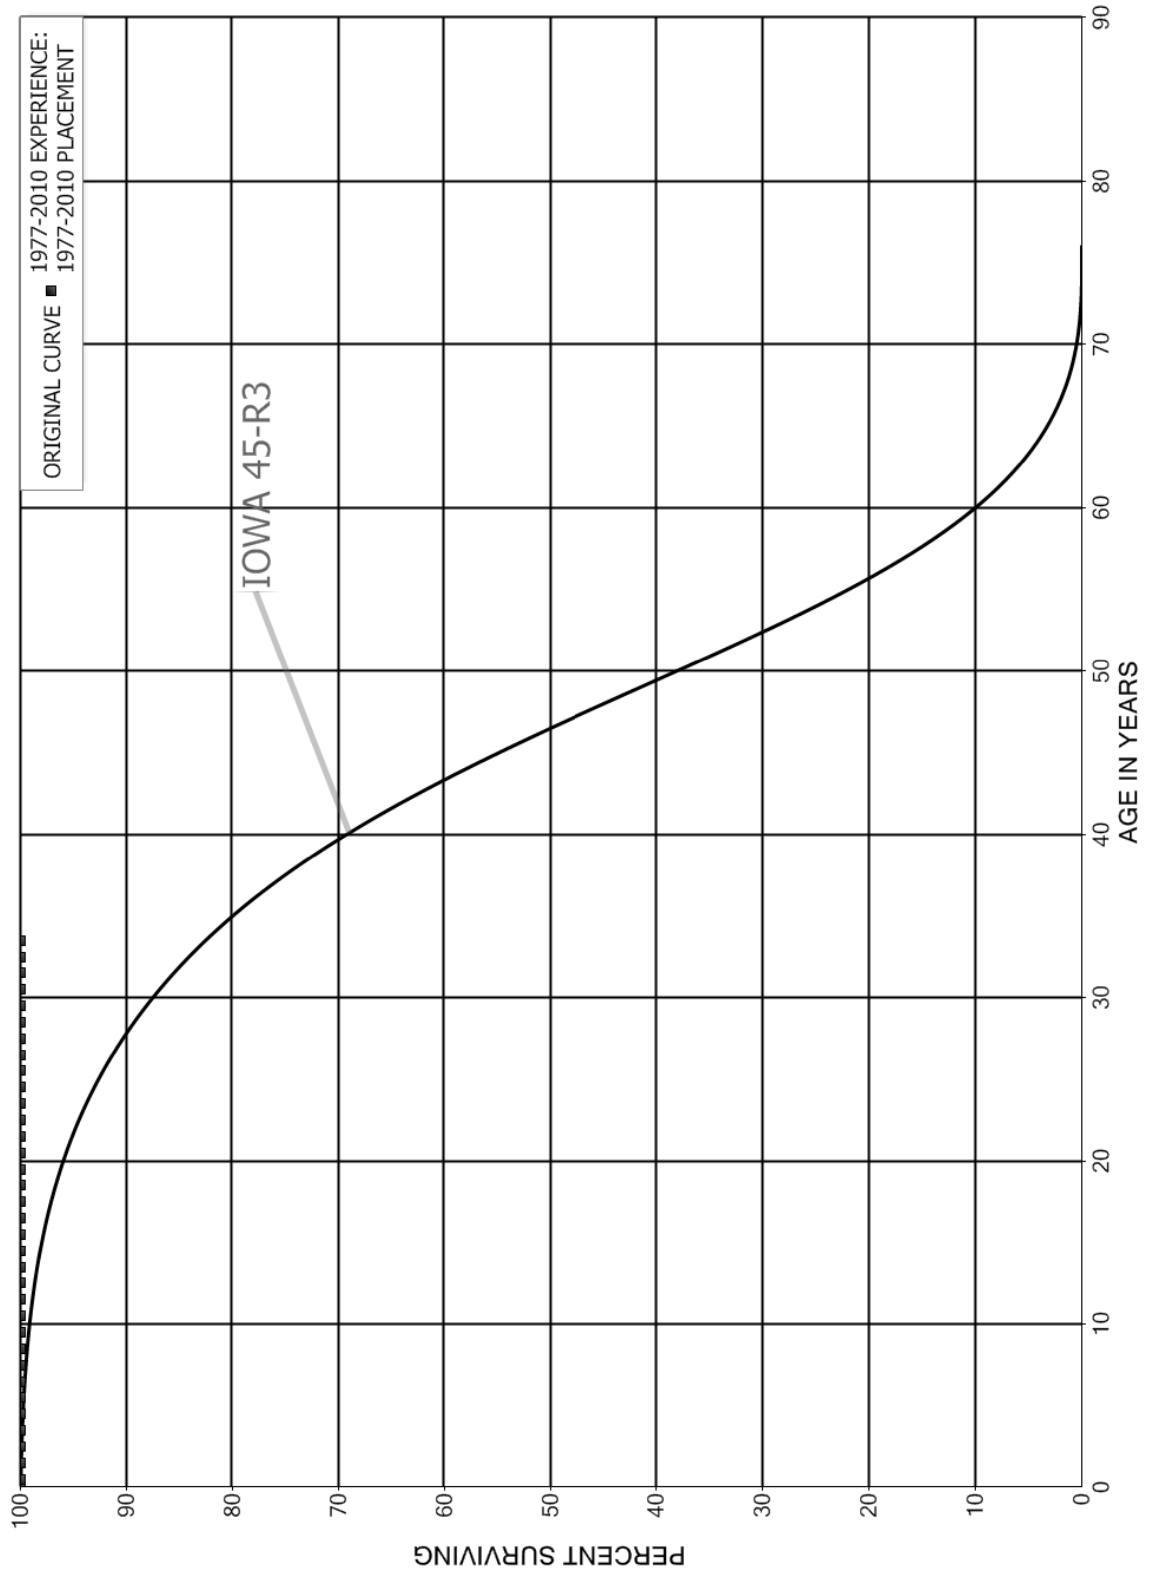


MANITOBA HYDRO

ACCOUNT 2000M - UNDERGROUND CABLE AND DEVICES

ORIGINAL LIFE TABLE

PLACEMENT BAND 1977-2010			EXPERIENCE BAND 1977-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
0.0	1,167,855	93	0.0001	0.9999	100.00	
0.5	1,163,975		0.0000	1.0000	99.99	
1.5	1,163,975		0.0000	1.0000	99.99	
2.5	1,163,975		0.0000	1.0000	99.99	
3.5	1,163,975		0.0000	1.0000	99.99	
4.5	1,163,975		0.0000	1.0000	99.99	
5.5	987,317		0.0000	1.0000	99.99	
6.5	987,317		0.0000	1.0000	99.99	
7.5	987,317		0.0000	1.0000	99.99	
8.5	986,702		0.0000	1.0000	99.99	
9.5	960,628		0.0000	1.0000	99.99	
10.5	960,628		0.0000	1.0000	99.99	
11.5	960,628		0.0000	1.0000	99.99	
12.5	960,628		0.0000	1.0000	99.99	
13.5	960,628		0.0000	1.0000	99.99	
14.5	960,628		0.0000	1.0000	99.99	
15.5	960,628	0	0.0000	1.0000	99.99	
16.5	960,628		0.0000	1.0000	99.99	
17.5	960,628		0.0000	1.0000	99.99	
18.5	960,628		0.0000	1.0000	99.99	
19.5	960,628		0.0000	1.0000	99.99	
20.5	960,628		0.0000	1.0000	99.99	
21.5	960,628		0.0000	1.0000	99.99	
22.5	960,535		0.0000	1.0000	99.99	
23.5	960,535		0.0000	1.0000	99.99	
24.5	960,535		0.0000	1.0000	99.99	
25.5	954,613		0.0000	1.0000	99.99	
26.5	954,613		0.0000	1.0000	99.99	
27.5	954,613		0.0000	1.0000	99.99	
28.5	954,613		0.0000	1.0000	99.99	
29.5	414,801		0.0000	1.0000	99.99	
30.5	414,801		0.0000	1.0000	99.99	
31.5	414,801		0.0000	1.0000	99.99	
32.5	414,801		0.0000	1.0000	99.99	
33.5					99.99	

MANITOBA HYDRO
ACCOUNT 3000B - BUILDINGS
ORIGINAL AND SMOOTH SURVIVOR CURVES

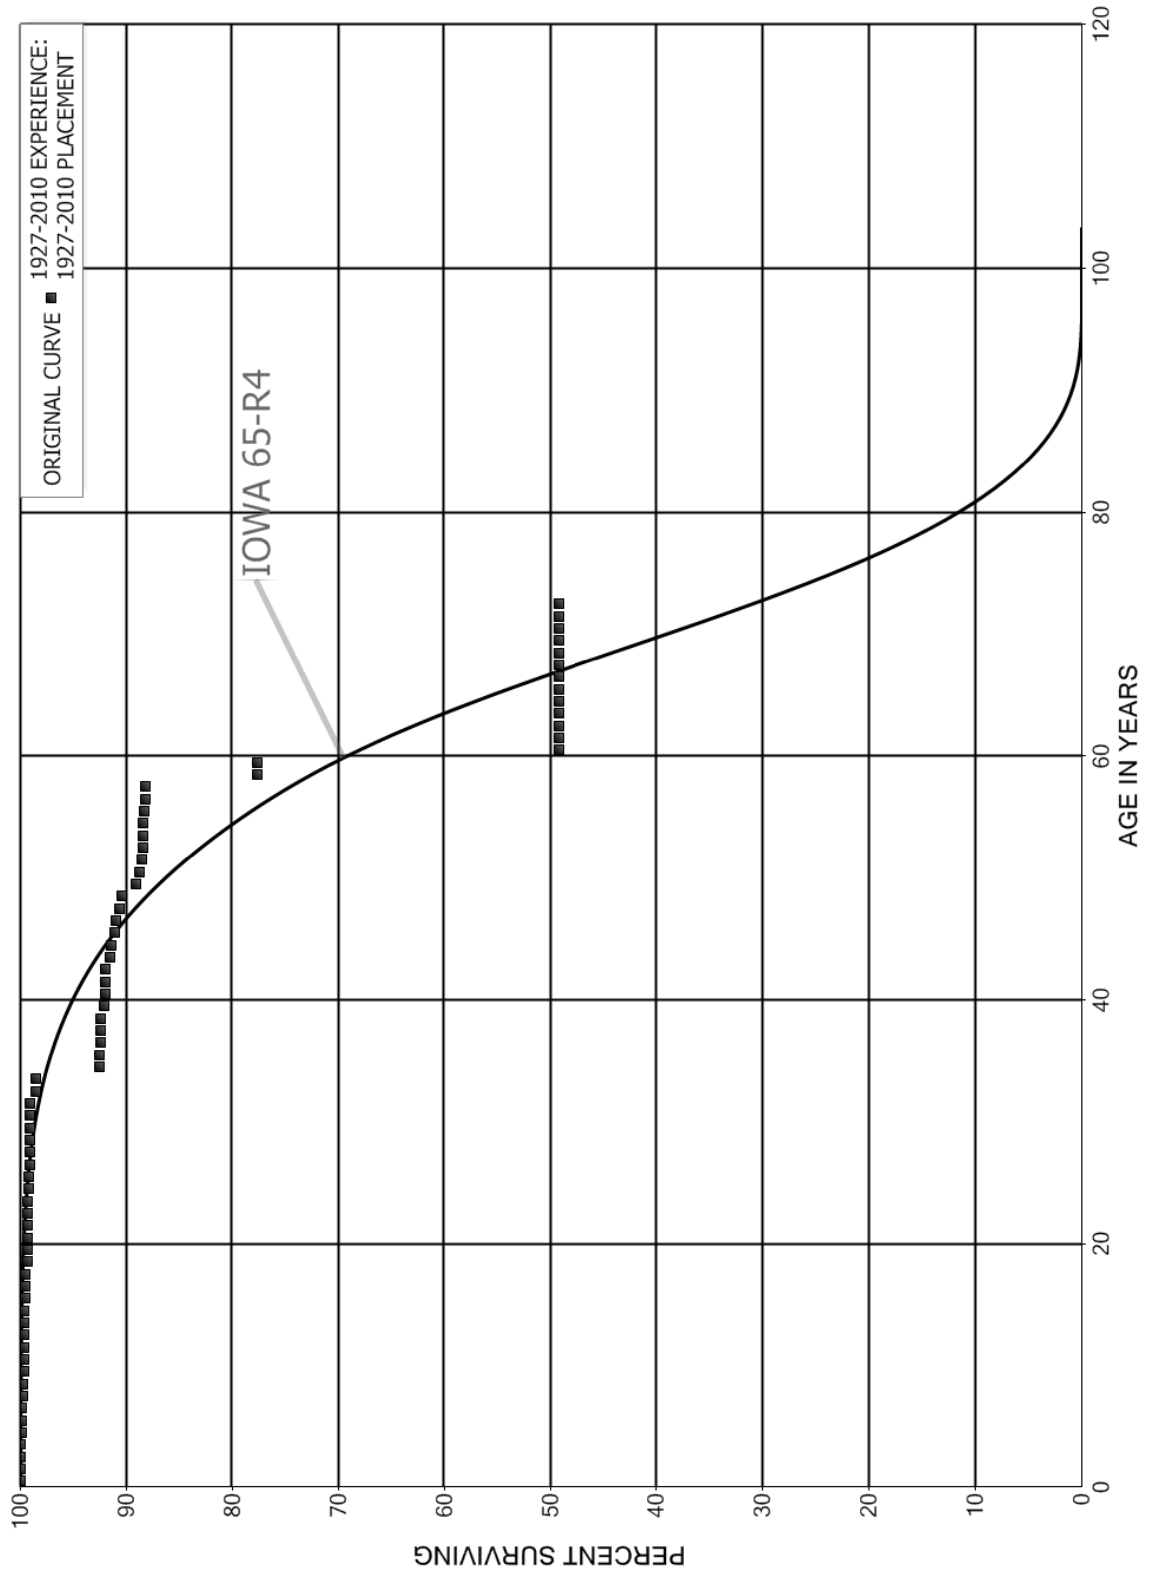

MANITOBA HYDRO

ACCOUNT 3000B - BUILDINGS

ORIGINAL LIFE TABLE

PLACEMENT BAND 1927-2010			EXPERIENCE BAND 1927-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
0.0	56,542,870	5,625	0.0001	0.9999	100.00	
0.5	54,029,821	4,661	0.0001	0.9999	99.99	
1.5	52,142,704	5,088	0.0001	0.9999	99.98	
2.5	49,557,285	10,440	0.0002	0.9998	99.97	
3.5	48,132,226	45,648	0.0009	0.9991	99.95	
4.5	46,458,839	13,619	0.0003	0.9997	99.86	
5.5	44,728,018	19,900	0.0004	0.9996	99.83	
6.5	42,378,937	23,102	0.0005	0.9995	99.78	
7.5	41,401,994	10,449	0.0003	0.9997	99.73	
8.5	37,856,090	12,970	0.0003	0.9997	99.70	
9.5	37,596,460	17,926	0.0005	0.9995	99.67	
10.5	78,206,053	4,852	0.0001	0.9999	99.62	
11.5	76,093,011	18,434	0.0002	0.9998	99.61	
12.5	85,254,748	11,935	0.0001	0.9999	99.59	
13.5	82,909,127	3,956	0.0000	1.0000	99.58	
14.5	82,452,350	22,845	0.0003	0.9997	99.57	
15.5	82,234,768	7,044	0.0001	0.9999	99.54	
16.5	81,700,125	1,017	0.0000	1.0000	99.54	
17.5	80,555,450	185,940	0.0023	0.9977	99.53	
18.5	66,232,273	1,487	0.0000	1.0000	99.30	
19.5	61,843,653	4,061	0.0001	0.9999	99.30	
20.5	60,323,238	6,698	0.0001	0.9999	99.30	
21.5	59,549,371	19,037	0.0003	0.9997	99.29	
22.5	59,242,971	1,341	0.0000	1.0000	99.25	
23.5	59,106,428	51,838	0.0009	0.9991	99.25	
24.5	58,982,435	1,910	0.0000	1.0000	99.16	
25.5	58,599,607	39,649	0.0007	0.9993	99.16	
26.5	58,352,645	27,274	0.0005	0.9995	99.09	
27.5	58,157,754	10,789	0.0002	0.9998	99.05	
28.5	57,810,086	5,943	0.0001	0.9999	99.03	
29.5	57,453,049	2,223	0.0000	1.0000	99.02	
30.5	57,186,882	175	0.0000	1.0000	99.01	
31.5	55,746,830	271,430	0.0049	0.9951	99.01	
32.5	14,791,365	2,411	0.0002	0.9998	98.53	
33.5	14,551,378	889,817	0.0611	0.9389	98.52	
34.5	4,242,540	155	0.0000	1.0000	92.49	
35.5	3,995,087	1,699	0.0004	0.9996	92.49	
36.5	3,956,528	1,478	0.0004	0.9996	92.45	
37.5	3,871,559	1,248	0.0003	0.9997	92.41	
38.5	3,693,855	14,941	0.0040	0.9960	92.39	

MANITOBA HYDRO

ACCOUNT 3000B - BUILDINGS

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1927-2010			EXPERIENCE BAND 1927-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
39.5	3,429,628	378	0.0001	0.9999	92.01	
40.5	3,418,254	1,807	0.0005	0.9995	92.00	
41.5	3,366,918	2,203	0.0007	0.9993	91.95	
42.5	2,939,483	13,269	0.0045	0.9955	91.89	
43.5	1,987,986	2,150	0.0011	0.9989	91.48	
44.5	1,562,969	6,132	0.0039	0.9961	91.38	
45.5	1,518,877	892	0.0006	0.9994	91.02	
46.5	1,299,226	5,610	0.0043	0.9957	90.97	
47.5	1,067,884	2,012	0.0019	0.9981	90.57	
48.5	771,258	11,843	0.0154	0.9846	90.40	
49.5	4,350,926	14,610	0.0034	0.9966	89.02	
50.5	4,299,139	10,395	0.0024	0.9976	88.72	
51.5	4,104,760	3,712	0.0009	0.9991	88.50	
52.5	4,063,123	3,324	0.0008	0.9992	88.42	
53.5	3,993,108	70	0.0000	1.0000	88.35	
54.5	3,797,388	2,588	0.0007	0.9993	88.35	
55.5	3,734,673	2,864	0.0008	0.9992	88.29	
56.5	3,731,630		0.0000	1.0000	88.22	
57.5	94,197	11,292	0.1199	0.8801	88.22	
58.5	55,793		0.0000	1.0000	77.64	
59.5	54,933	20,122	0.3663	0.6337	77.64	
60.5	30,679		0.0000	1.0000	49.20	
61.5	30,679		0.0000	1.0000	49.20	
62.5	30,679		0.0000	1.0000	49.20	
63.5	30,679		0.0000	1.0000	49.20	
64.5	30,679		0.0000	1.0000	49.20	
65.5	30,679		0.0000	1.0000	49.20	
66.5	30,679		0.0000	1.0000	49.20	
67.5	30,679		0.0000	1.0000	49.20	
68.5	30,679		0.0000	1.0000	49.20	
69.5	30,679		0.0000	1.0000	49.20	
70.5	30,679		0.0000	1.0000	49.20	
71.5	30,679		0.0000	1.0000	49.20	
72.5	30,679		0.0000	1.0000	49.20	
73.5	30,679		0.0000	1.0000	49.20	
74.5	30,679		0.0000	1.0000	49.20	
75.5	30,679		0.0000	1.0000	49.20	
76.5	30,679		0.0000	1.0000	49.20	
77.5	30,679		0.0000	1.0000	49.20	
78.5	30,679		0.0000	1.0000	49.20	


MANITOBA HYDRO

ACCOUNT 3000B - BUILDINGS

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1927-2010			EXPERIENCE BAND 1927-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
79.5	30,679		0.0000	1.0000	49.20
80.5	30,679		0.0000	1.0000	49.20
81.5	30,679		0.0000	1.0000	49.20
82.5	30,679		0.0000	1.0000	49.20
83.5					49.20

MANITOBA HYDRO
ACCOUNT 3000F - ROADS, STEEL STRUCTURES AND CIVIL SITE WORK
ORIGINAL AND SMOOTH SURVIVOR CURVES

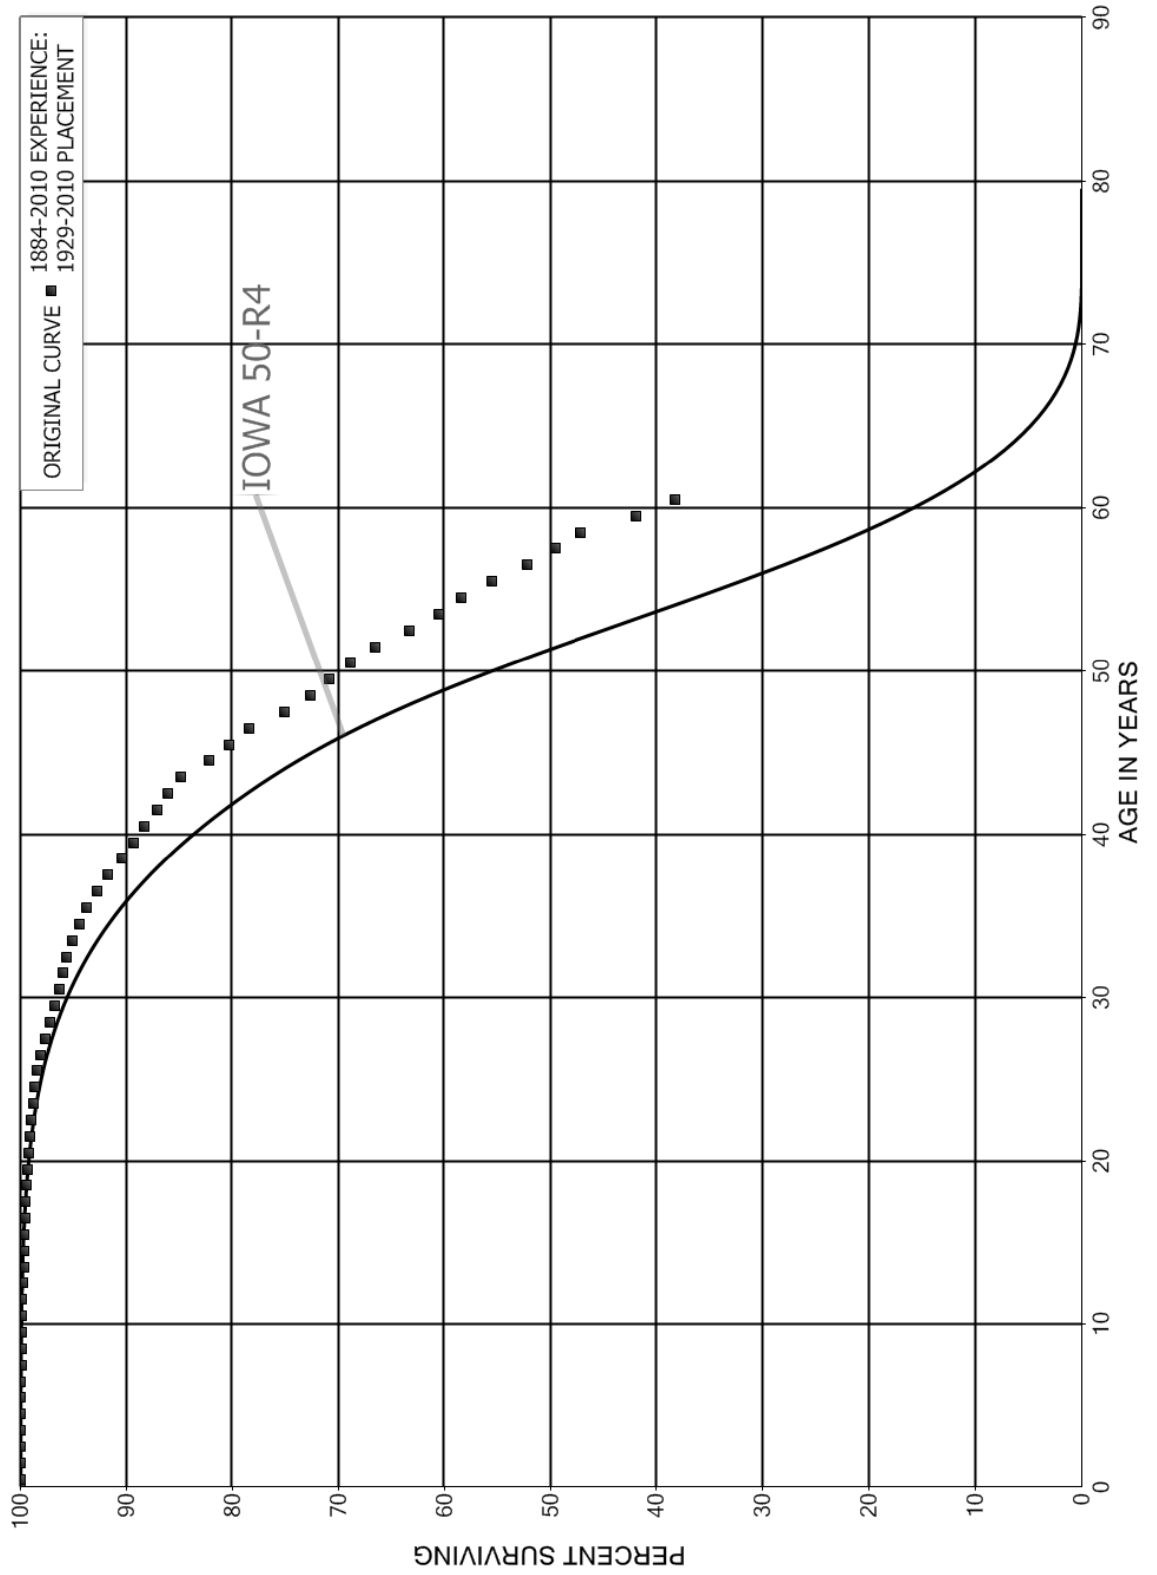

MANITOBA HYDRO

ACCOUNT 3000F - ROADS, STEEL STRUCTURES AND CIVIL SITE WORK

ORIGINAL LIFE TABLE

PLACEMENT BAND 1929-2010			EXPERIENCE BAND 1884-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
0.0	116,284,252	4,722	0.0000	1.0000	100.00	
0.5	114,766,326	11,987	0.0001	0.9999	100.00	
1.5	105,507,888	25,443	0.0002	0.9998	99.99	
2.5	98,499,913	8,095	0.0001	0.9999	99.96	
3.5	91,656,390	11,847	0.0001	0.9999	99.95	
4.5	84,579,418	18,796	0.0002	0.9998	99.94	
5.5	81,671,728	11,189	0.0001	0.9999	99.92	
6.5	77,336,649	12,286	0.0002	0.9998	99.90	
7.5	69,486,835	7,370	0.0001	0.9999	99.89	
8.5	65,682,586	35,487	0.0005	0.9995	99.88	
9.5	63,425,856	12,534	0.0002	0.9998	99.82	
10.5	60,008,530	12,730	0.0002	0.9998	99.80	
11.5	52,509,319	17,249	0.0003	0.9997	99.78	
12.5	48,629,250	53,175	0.0011	0.9989	99.75	
13.5	40,369,563	13,082	0.0003	0.9997	99.64	
14.5	37,642,070	16,119	0.0004	0.9996	99.61	
15.5	33,646,497	17,989	0.0005	0.9995	99.57	
16.5	32,455,301	17,443	0.0005	0.9995	99.51	
17.5	31,049,102	23,562	0.0008	0.9992	99.46	
18.5	29,103,398	25,996	0.0009	0.9991	99.38	
19.5	28,452,037	31,737	0.0011	0.9989	99.30	
20.5	25,583,009	31,262	0.0012	0.9988	99.18	
21.5	23,155,515	34,441	0.0015	0.9985	99.06	
22.5	22,402,432	35,041	0.0016	0.9984	98.92	
23.5	21,875,780	41,363	0.0019	0.9981	98.76	
24.5	21,054,989	41,974	0.0020	0.9980	98.57	
25.5	20,323,143	59,100	0.0029	0.9971	98.38	
26.5	19,380,921	86,276	0.0045	0.9955	98.09	
27.5	18,606,152	81,978	0.0044	0.9956	97.66	
28.5	18,029,159	87,827	0.0049	0.9951	97.22	
29.5	15,822,030	71,584	0.0045	0.9955	96.75	
30.5	14,782,188	58,524	0.0040	0.9960	96.31	
31.5	13,603,981	52,376	0.0039	0.9961	95.93	
32.5	9,048,663	46,875	0.0052	0.9948	95.56	
33.5	8,582,213	57,425	0.0067	0.9933	95.07	
34.5	7,693,759	57,734	0.0075	0.9925	94.43	
35.5	6,807,268	71,420	0.0105	0.9895	93.72	
36.5	6,601,081	74,952	0.0114	0.9886	92.74	
37.5	6,340,232	88,393	0.0139	0.9861	91.69	
38.5	6,136,931	74,963	0.0122	0.9878	90.41	


MANITOBA HYDRO

ACCOUNT 3000F - ROADS, STEEL STRUCTURES AND CIVIL SITE WORK

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1929-2010			EXPERIENCE BAND 1884-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
39.5	5,149,050	56,456	0.0110	0.9890	89.30
40.5	4,997,080	68,432	0.0137	0.9863	88.33
41.5	4,801,985	60,565	0.0126	0.9874	87.12
42.5	4,642,810	66,187	0.0143	0.9857	86.02
43.5	4,373,442	133,378	0.0305	0.9695	84.79
44.5	3,758,919	86,082	0.0229	0.9771	82.20
45.5	3,663,349	89,923	0.0245	0.9755	80.32
46.5	3,564,785	149,985	0.0421	0.9579	78.35
47.5	3,360,601	109,278	0.0325	0.9675	75.05
48.5	3,185,981	75,737	0.0238	0.9762	72.61
49.5	2,909,120	85,627	0.0294	0.9706	70.89
50.5	2,819,813	94,590	0.0335	0.9665	68.80
51.5	2,699,981	129,585	0.0480	0.9520	66.49
52.5	2,329,124	103,978	0.0446	0.9554	63.30
53.5	2,224,872	77,440	0.0348	0.9652	60.48
54.5	2,086,251	101,255	0.0485	0.9515	58.37
55.5	1,758,955	106,015	0.0603	0.9397	55.54
56.5	1,650,889	84,282	0.0511	0.9489	52.19
57.5	570,130	28,160	0.0494	0.9506	49.53
58.5	10,159	1,129	0.1112	0.8888	47.08
59.5	6,981	604	0.0865	0.9135	41.85
60.5	1,812	258	0.1425	0.8575	38.23
61.5	1,553	149	0.0962	0.9038	32.78
62.5	1,404	115	0.0816	0.9184	29.63
63.5	1,290	192	0.1493	0.8507	27.21
64.5	1,097	650	0.5922	0.4078	23.15
65.5	447	130	0.2896	0.7104	9.44
66.5	318	248	0.7800	0.2200	6.71
67.5	70	70	1.0000		1.48
68.5					

MANITOBA HYDRO
ACCOUNT 3000J - POLES AND FIXTURES
ORIGINAL AND SMOOTH SURVIVOR CURVES

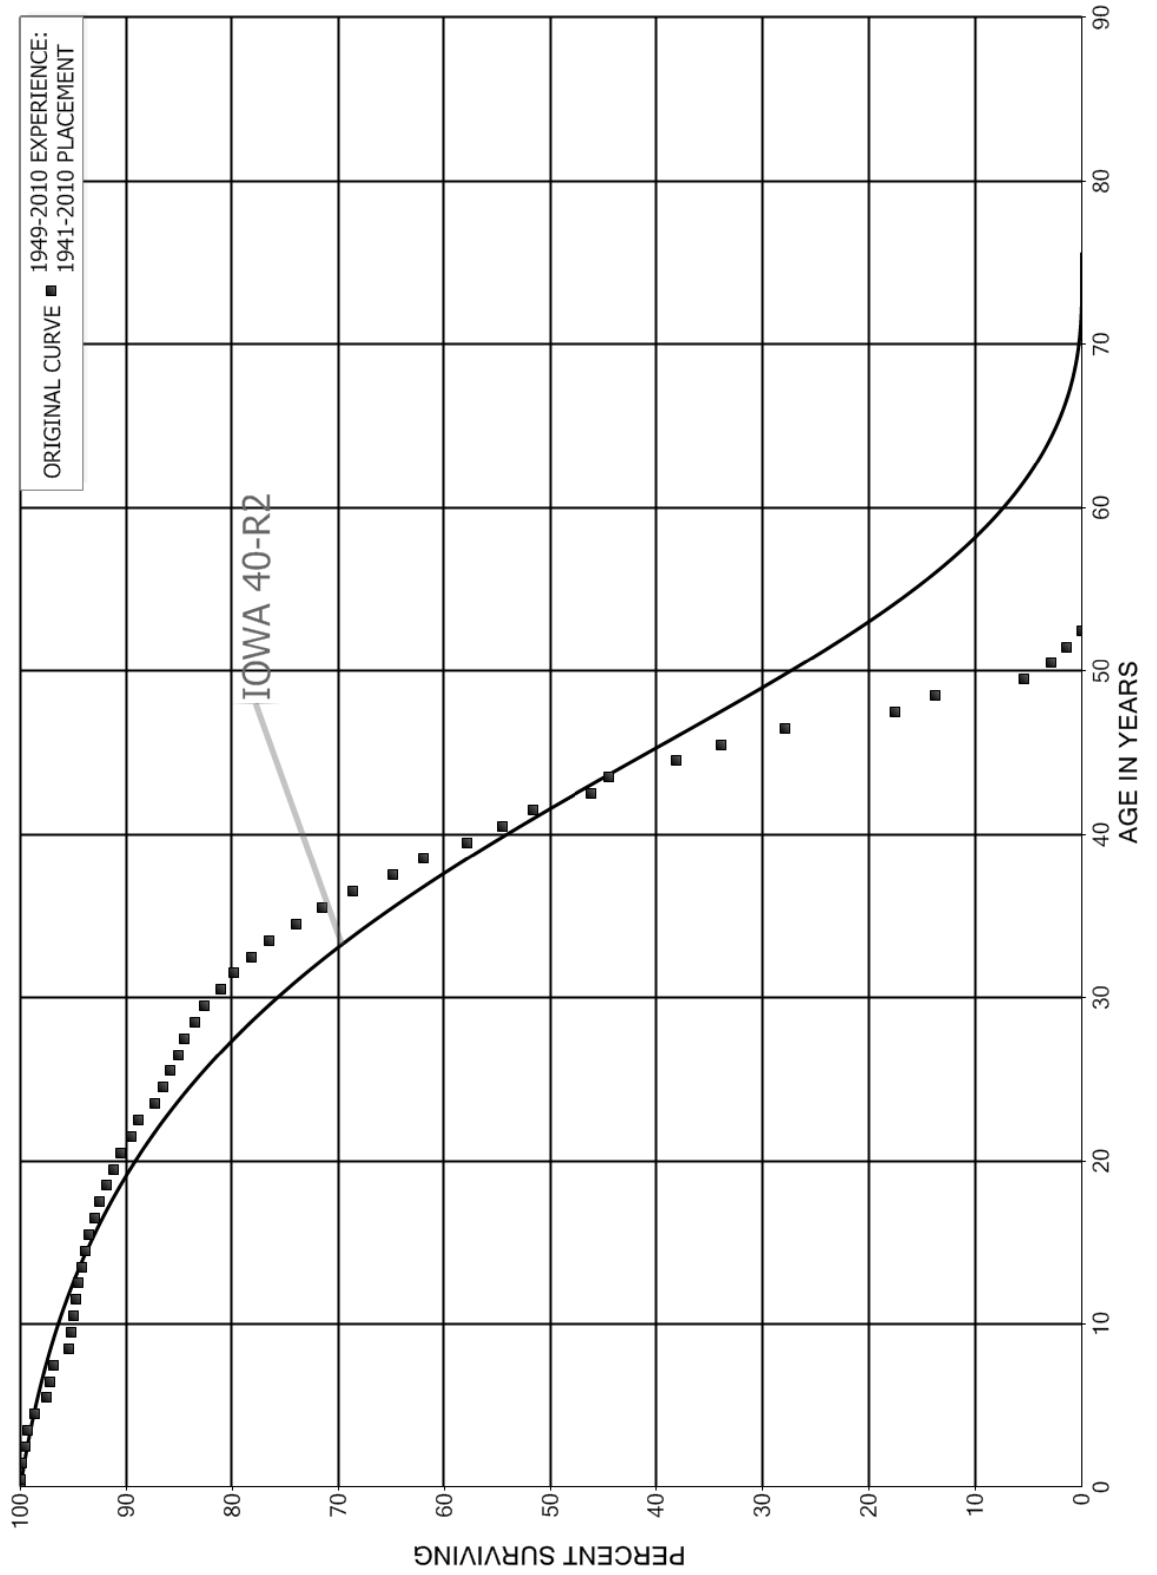

MANITOBA HYDRO

ACCOUNT 3000J - POLES AND FIXTURES

ORIGINAL LIFE TABLE

PLACEMENT BAND 1941-2010			EXPERIENCE BAND 1949-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
0.0	8,916,716	8,608	0.0010	0.9990	100.00	
0.5	8,425,508	6,516	0.0008	0.9992	99.90	
1.5	7,369,165	22,159	0.0030	0.9970	99.83	
2.5	7,267,120	19,814	0.0027	0.9973	99.53	
3.5	6,895,745	40,630	0.0059	0.9941	99.25	
4.5	6,638,267	77,096	0.0116	0.9884	98.67	
5.5	6,385,262	23,106	0.0036	0.9964	97.52	
6.5	6,282,839	22,249	0.0035	0.9965	97.17	
7.5	5,870,891	85,755	0.0146	0.9854	96.83	
8.5	4,490,279	8,641	0.0019	0.9981	95.41	
9.5	4,449,185	10,669	0.0024	0.9976	95.23	
10.5	4,200,187	9,865	0.0023	0.9977	95.00	
11.5	3,868,567	12,386	0.0032	0.9968	94.78	
12.5	3,324,157	10,470	0.0031	0.9969	94.47	
13.5	2,632,129	9,655	0.0037	0.9963	94.18	
14.5	2,301,889	8,743	0.0038	0.9962	93.83	
15.5	2,086,095	12,355	0.0059	0.9941	93.47	
16.5	1,798,642	8,068	0.0045	0.9955	92.92	
17.5	1,679,990	12,593	0.0075	0.9925	92.50	
18.5	1,595,616	10,380	0.0065	0.9935	91.81	
19.5	1,370,013	11,212	0.0082	0.9918	91.21	
20.5	1,268,420	13,931	0.0110	0.9890	90.47	
21.5	1,132,597	8,764	0.0077	0.9923	89.47	
22.5	1,036,253	17,223	0.0166	0.9834	88.78	
23.5	929,901	7,961	0.0086	0.9914	87.31	
24.5	899,673	7,110	0.0079	0.9921	86.56	
25.5	887,616	7,809	0.0088	0.9912	85.87	
26.5	860,827	6,345	0.0074	0.9926	85.12	
27.5	854,482	9,851	0.0115	0.9885	84.49	
28.5	815,042	8,618	0.0106	0.9894	83.52	
29.5	802,082	15,591	0.0194	0.9806	82.63	
30.5	783,832	11,448	0.0146	0.9854	81.03	
31.5	741,057	15,936	0.0215	0.9785	79.84	
32.5	719,391	14,965	0.0208	0.9792	78.13	
33.5	688,062	23,404	0.0340	0.9660	76.50	
34.5	640,012	20,877	0.0326	0.9674	73.90	
35.5	568,800	22,674	0.0399	0.9601	71.49	
36.5	533,969	29,865	0.0559	0.9441	68.64	
37.5	484,821	21,100	0.0435	0.9565	64.80	
38.5	446,623	29,788	0.0667	0.9333	61.98	


MANITOBA HYDRO

ACCOUNT 3000J - POLES AND FIXTURES

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1941-2010			EXPERIENCE BAND 1949-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
39.5	402,161	23,425	0.0582	0.9418	57.85	
40.5	373,690	19,716	0.0528	0.9472	54.48	
41.5	350,576	37,741	0.1077	0.8923	51.60	
42.5	300,415	10,732	0.0357	0.9643	46.05	
43.5	289,385	41,558	0.1436	0.8564	44.40	
44.5	244,099	27,009	0.1106	0.8894	38.03	
45.5	216,492	38,056	0.1758	0.8242	33.82	
46.5	176,975	66,014	0.3730	0.6270	27.87	
47.5	96,432	20,870	0.2164	0.7836	17.48	
48.5	75,562	45,710	0.6049	0.3951	13.69	
49.5	18,936	9,161	0.4838	0.5162	5.41	
50.5	8,280	4,114	0.4969	0.5031	2.79	
51.5	2,330	2,330	1.0000		1.41	
52.5						

MANITOBA HYDRO
ACCOUNT 3100R - POWER TRANSFORMERS
ORIGINAL AND SMOOTH SURVIVOR CURVES

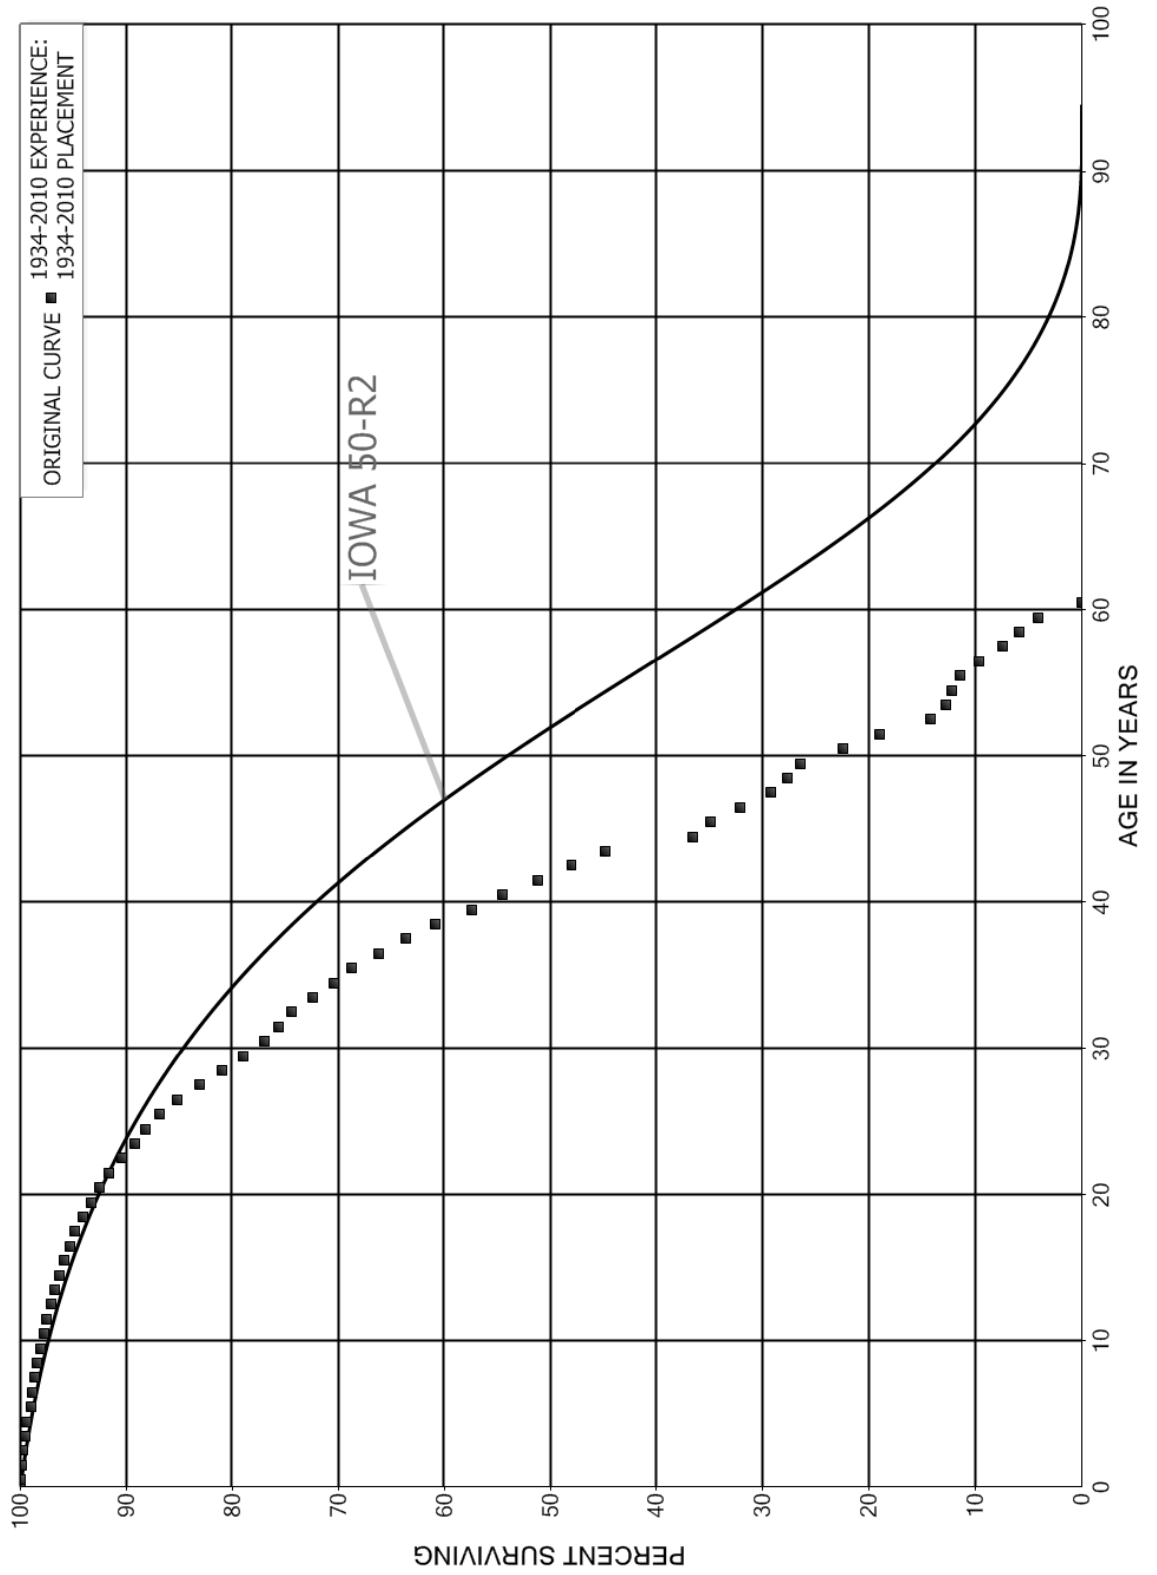

MANITOBA HYDRO

ACCOUNT 3100R - POWER TRANSFORMERS

ORIGINAL LIFE TABLE

PLACEMENT BAND 1934-2010			EXPERIENCE BAND 1934-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	313,839,783	203,070	0.0006	0.9994	100.00
0.5	300,595,744	321,606	0.0011	0.9989	99.94
1.5	288,304,526	447,108	0.0016	0.9984	99.83
2.5	278,660,276	439,353	0.0016	0.9984	99.67
3.5	272,156,905	420,705	0.0015	0.9985	99.52
4.5	255,915,826	911,106	0.0036	0.9964	99.36
5.5	250,305,563	493,921	0.0020	0.9980	99.01
6.5	241,670,014	512,307	0.0021	0.9979	98.81
7.5	226,175,198	534,926	0.0024	0.9976	98.60
8.5	215,792,691	664,875	0.0031	0.9969	98.37
9.5	207,636,585	654,783	0.0032	0.9968	98.07
10.5	198,440,301	570,149	0.0029	0.9971	97.76
11.5	178,430,885	657,289	0.0037	0.9963	97.48
12.5	166,066,493	702,254	0.0042	0.9958	97.12
13.5	138,792,783	538,675	0.0039	0.9961	96.71
14.5	129,945,695	648,491	0.0050	0.9950	96.33
15.5	111,287,119	671,298	0.0060	0.9940	95.85
16.5	104,533,662	536,557	0.0051	0.9949	95.27
17.5	98,008,456	773,055	0.0079	0.9921	94.78
18.5	92,326,799	730,050	0.0079	0.9921	94.04
19.5	87,150,947	736,958	0.0085	0.9915	93.29
20.5	80,401,473	763,091	0.0095	0.9905	92.50
21.5	74,753,273	997,203	0.0133	0.9867	91.63
22.5	72,760,628	957,308	0.0132	0.9868	90.40
23.5	70,269,121	842,846	0.0120	0.9880	89.21
24.5	66,079,364	988,731	0.0150	0.9850	88.14
25.5	61,504,953	1,138,326	0.0185	0.9815	86.83
26.5	59,057,681	1,506,761	0.0255	0.9745	85.22
27.5	55,506,882	1,438,648	0.0259	0.9741	83.04
28.5	51,801,127	1,216,760	0.0235	0.9765	80.89
29.5	40,765,459	1,046,895	0.0257	0.9743	78.99
30.5	34,074,370	602,905	0.0177	0.9823	76.96
31.5	30,171,390	474,437	0.0157	0.9843	75.60
32.5	27,965,723	755,443	0.0270	0.9730	74.41
33.5	26,321,499	738,051	0.0280	0.9720	72.40
34.5	24,129,497	576,742	0.0239	0.9761	70.37
35.5	21,497,565	775,222	0.0361	0.9639	68.69
36.5	19,751,325	760,169	0.0385	0.9615	66.21
37.5	18,187,516	808,282	0.0444	0.9556	63.67
38.5	16,485,718	923,083	0.0560	0.9440	60.84


MANITOBA HYDRO

ACCOUNT 3100R - POWER TRANSFORMERS

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1934-2010			EXPERIENCE BAND 1934-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
39.5	14,005,832	723,636	0.0517	0.9483	57.43
40.5	12,630,616	773,736	0.0613	0.9387	54.46
41.5	11,405,375	698,831	0.0613	0.9387	51.13
42.5	9,959,084	689,574	0.0692	0.9308	47.99
43.5	8,817,476	1,609,327	0.1825	0.8175	44.67
44.5	6,640,288	310,931	0.0468	0.9532	36.52
45.5	6,126,700	481,084	0.0785	0.9215	34.81
46.5	5,504,133	493,958	0.0897	0.9103	32.07
47.5	4,858,780	261,923	0.0539	0.9461	29.20
48.5	4,476,888	201,202	0.0449	0.9551	27.62
49.5	4,139,443	623,159	0.1505	0.8495	26.38
50.5	3,411,513	527,833	0.1547	0.8453	22.41
51.5	2,803,222	699,644	0.2496	0.7504	18.94
52.5	2,045,438	220,675	0.1079	0.8921	14.21
53.5	1,775,756	73,458	0.0414	0.9586	12.68
54.5	1,570,364	95,799	0.0610	0.9390	12.16
55.5	1,445,905	223,579	0.1546	0.8454	11.41
56.5	1,200,609	275,769	0.2297	0.7703	9.65
57.5	24,616	5,309	0.2157	0.7843	7.43
58.5	9,723	2,964	0.3049	0.6951	5.83
59.5	2,284	2,284	1.0000		4.05
60.5					

MANITOBA HYDRO
ACCOUNT 3100S - OTHER TRANSFORMERS
ORIGINAL AND SMOOTH SURVIVOR CURVES

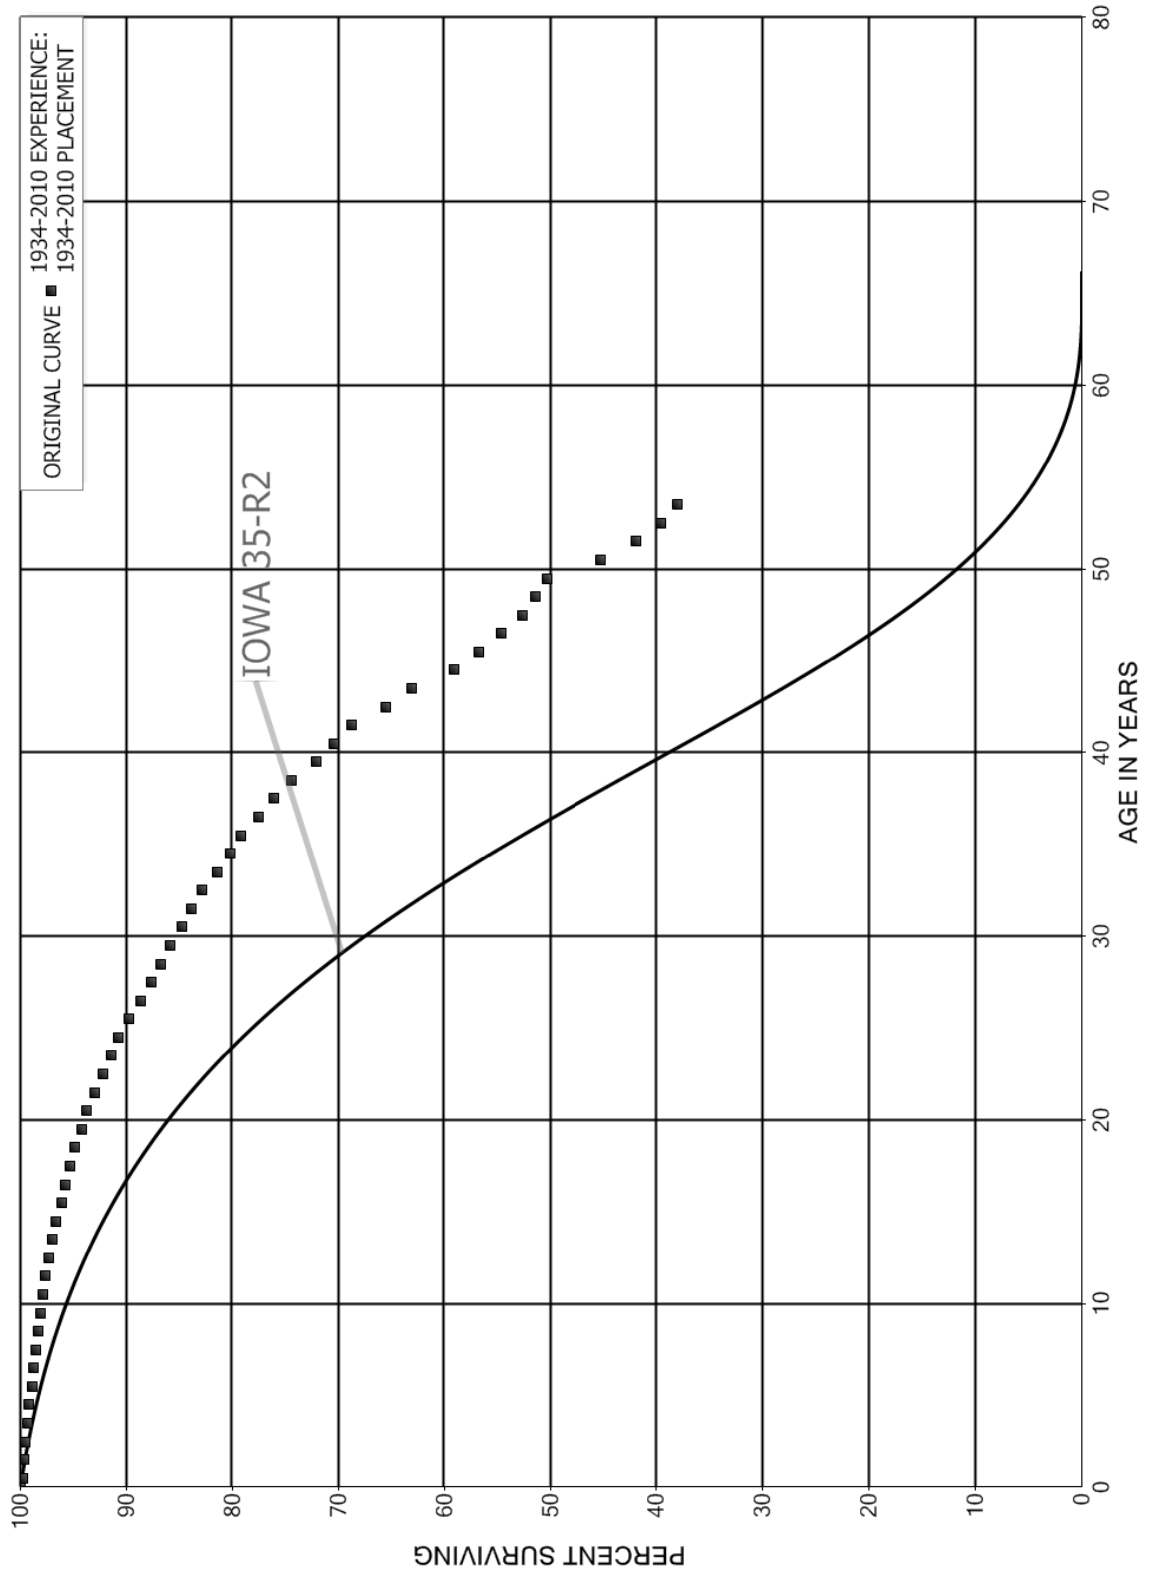

MANITOBA HYDRO

ACCOUNT 3100S - OTHER TRANSFORMERS

ORIGINAL LIFE TABLE

PLACEMENT BAND 1934-2010			EXPERIENCE BAND 1934-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
0.0	70,816,154	221,251	0.0031	0.9969	100.00	
0.5	69,480,687	68,844	0.0010	0.9990	99.69	
1.5	67,782,603	82,704	0.0012	0.9988	99.59	
2.5	65,191,168	101,166	0.0016	0.9984	99.47	
3.5	63,720,682	78,542	0.0012	0.9988	99.31	
4.5	59,766,559	221,683	0.0037	0.9963	99.19	
5.5	58,612,269	75,062	0.0013	0.9987	98.82	
6.5	57,135,538	93,877	0.0016	0.9984	98.70	
7.5	53,452,355	132,908	0.0025	0.9975	98.53	
8.5	51,452,331	132,523	0.0026	0.9974	98.29	
9.5	49,897,878	122,814	0.0025	0.9975	98.04	
10.5	48,000,452	105,390	0.0022	0.9978	97.79	
11.5	44,429,391	118,725	0.0027	0.9973	97.58	
12.5	42,619,786	174,075	0.0041	0.9959	97.32	
13.5	37,424,249	127,190	0.0034	0.9966	96.92	
14.5	32,646,071	163,380	0.0050	0.9950	96.59	
15.5	27,491,233	119,001	0.0043	0.9957	96.11	
16.5	26,444,731	110,578	0.0042	0.9958	95.69	
17.5	25,338,654	127,268	0.0050	0.9950	95.29	
18.5	23,282,630	146,639	0.0063	0.9937	94.81	
19.5	22,560,202	125,102	0.0055	0.9945	94.22	
20.5	20,512,937	170,273	0.0083	0.9917	93.69	
21.5	19,347,963	157,435	0.0081	0.9919	92.92	
22.5	18,872,456	155,543	0.0082	0.9918	92.16	
23.5	18,427,333	131,431	0.0071	0.9929	91.40	
24.5	17,436,067	192,039	0.0110	0.9890	90.75	
25.5	16,907,797	208,322	0.0123	0.9877	89.75	
26.5	16,382,220	183,339	0.0112	0.9888	88.64	
27.5	15,795,025	174,045	0.0110	0.9890	87.65	
28.5	15,282,328	147,092	0.0096	0.9904	86.69	
29.5	12,584,013	172,757	0.0137	0.9863	85.85	
30.5	11,434,631	111,583	0.0098	0.9902	84.67	
31.5	10,445,636	131,208	0.0126	0.9874	83.85	
32.5	6,485,571	110,696	0.0171	0.9829	82.79	
33.5	6,239,016	94,083	0.0151	0.9849	81.38	
34.5	5,396,837	69,306	0.0128	0.9872	80.15	
35.5	4,871,729	98,180	0.0202	0.9798	79.12	
36.5	4,607,043	87,397	0.0190	0.9810	77.53	
37.5	4,180,189	93,368	0.0223	0.9777	76.06	
38.5	3,849,478	121,317	0.0315	0.9685	74.36	


MANITOBA HYDRO

ACCOUNT 3100S - OTHER TRANSFORMERS

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1934-2010			EXPERIENCE BAND 1934-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
39.5	2,652,152	58,826	0.0222	0.9778	72.02	
40.5	2,393,196	57,650	0.0241	0.9759	70.42	
41.5	2,277,676	104,868	0.0460	0.9540	68.72	
42.5	1,945,349	75,406	0.0388	0.9612	65.56	
43.5	1,721,519	109,247	0.0635	0.9365	63.02	
44.5	1,451,014	56,270	0.0388	0.9612	59.02	
45.5	1,288,818	47,121	0.0366	0.9634	56.73	
46.5	1,192,287	43,858	0.0368	0.9632	54.66	
47.5	1,085,698	26,430	0.0243	0.9757	52.64	
48.5	978,428	20,865	0.0213	0.9787	51.36	
49.5	844,803	85,962	0.1018	0.8982	50.27	
50.5	719,364	52,725	0.0733	0.9267	45.15	
51.5	620,977	34,449	0.0555	0.9445	41.84	
52.5	483,349	18,930	0.0392	0.9608	39.52	
53.5	447,453	6,721	0.0150	0.9850	37.97	
54.5	404,194	10,946	0.0271	0.9729	37.40	
55.5	375,089	22,311	0.0595	0.9405	36.39	
56.5	345,916	31,878	0.0922	0.9078	34.23	
57.5	15,581	1,322	0.0849	0.9151	31.07	
58.5	5,212	521	0.0999	0.9001	28.44	
59.5	1,868	442	0.2368	0.7632	25.59	
60.5					19.53	

MANITOBA HYDRO
ACCOUNT 3100T - INTERRUPTING EQUIPMENT
ORIGINAL AND SMOOTH SURVIVOR CURVES

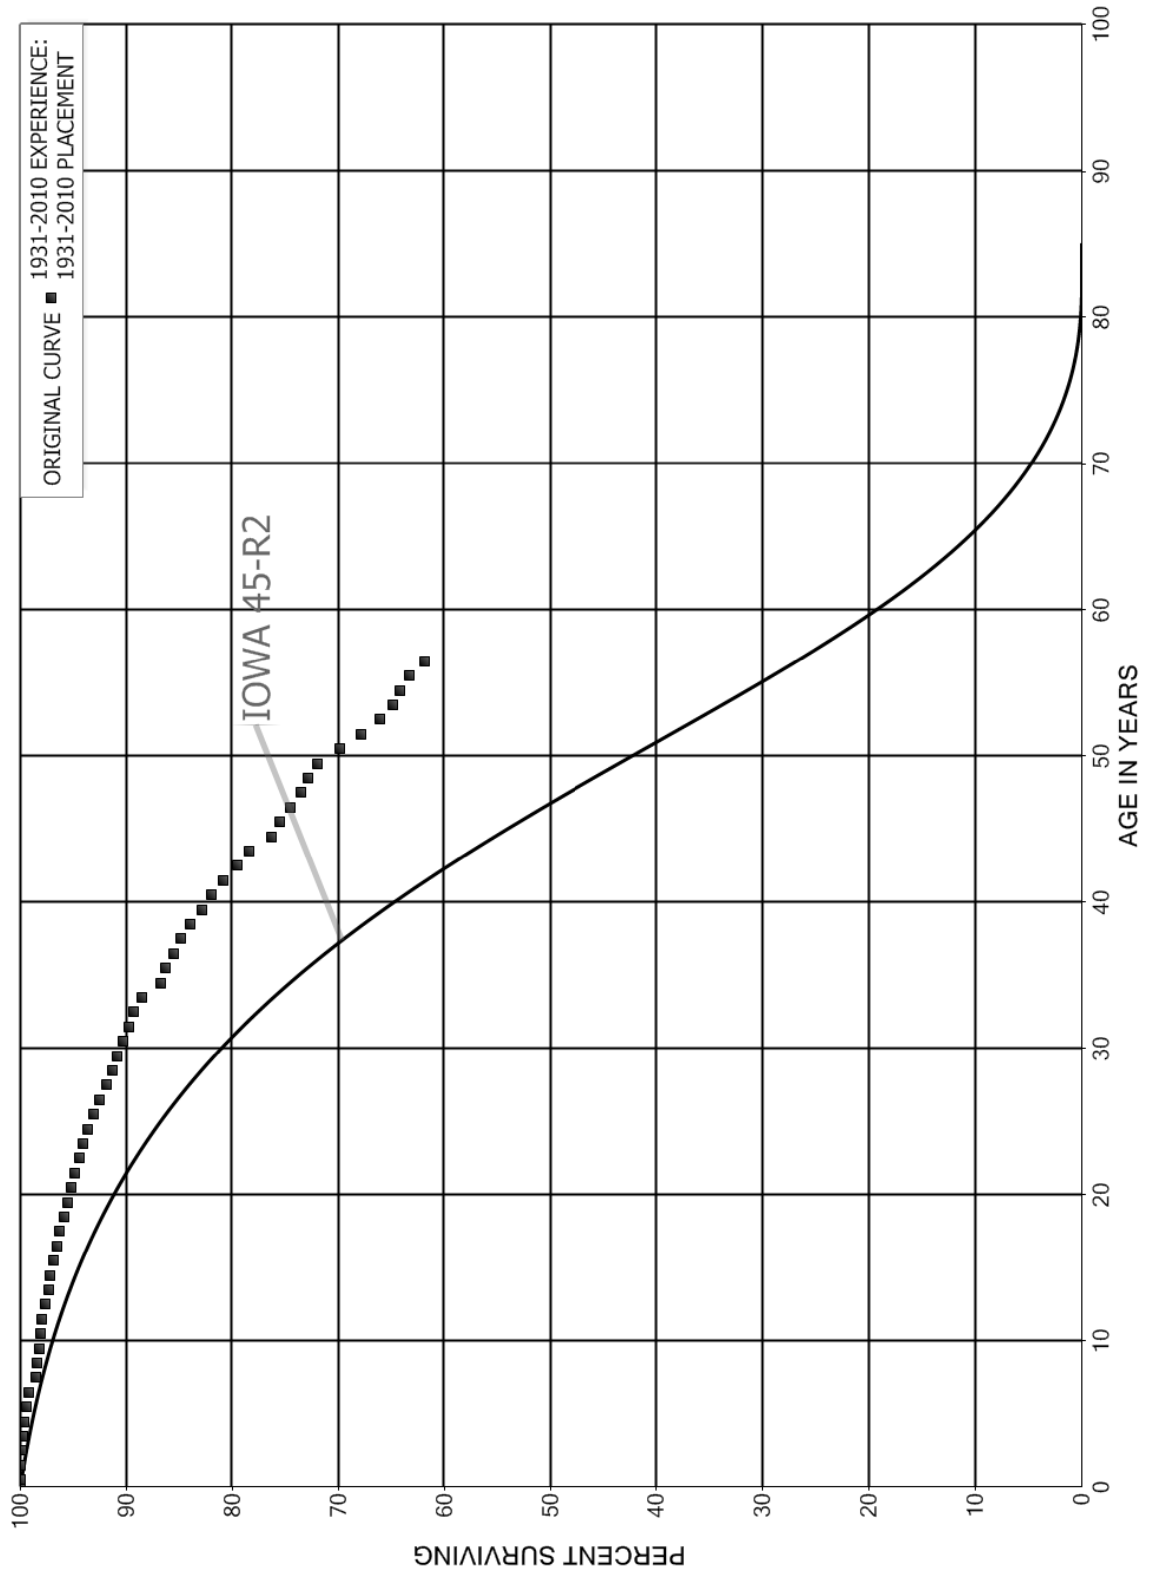

MANITOBA HYDRO

ACCOUNT 3100T - INTERRUPTING EQUIPMENT

ORIGINAL LIFE TABLE

PLACEMENT BAND 1931-2010			EXPERIENCE BAND 1931-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	165,441,707	43,470	0.0003	0.9997	100.00
0.5	161,185,539	85,394	0.0005	0.9995	99.97
1.5	154,726,267	135,625	0.0009	0.9991	99.92
2.5	144,646,153	122,594	0.0008	0.9992	99.83
3.5	142,449,431	181,748	0.0013	0.9987	99.75
4.5	136,064,695	375,423	0.0028	0.9972	99.62
5.5	124,892,988	183,509	0.0015	0.9985	99.35
6.5	123,029,177	807,346	0.0066	0.9934	99.20
7.5	114,303,111	215,178	0.0019	0.9981	98.55
8.5	110,020,288	184,992	0.0017	0.9983	98.36
9.5	107,444,157	165,309	0.0015	0.9985	98.20
10.5	102,853,303	143,723	0.0014	0.9986	98.05
11.5	95,906,179	325,307	0.0034	0.9966	97.91
12.5	92,398,685	231,667	0.0025	0.9975	97.58
13.5	83,172,669	165,641	0.0020	0.9980	97.33
14.5	74,117,494	216,470	0.0029	0.9971	97.14
15.5	66,686,307	275,931	0.0041	0.9959	96.86
16.5	64,412,116	148,546	0.0023	0.9977	96.46
17.5	62,898,486	232,060	0.0037	0.9963	96.23
18.5	59,512,555	215,507	0.0036	0.9964	95.88
19.5	58,129,264	198,132	0.0034	0.9966	95.53
20.5	55,732,623	239,951	0.0043	0.9957	95.21
21.5	54,048,143	221,225	0.0041	0.9959	94.80
22.5	53,273,596	221,534	0.0042	0.9958	94.41
23.5	52,609,910	235,847	0.0045	0.9955	94.01
24.5	51,157,824	266,967	0.0052	0.9948	93.59
25.5	50,416,792	332,188	0.0066	0.9934	93.10
26.5	49,514,230	323,526	0.0065	0.9935	92.49
27.5	48,472,248	288,557	0.0060	0.9940	91.89
28.5	47,426,005	255,285	0.0054	0.9946	91.34
29.5	43,132,662	280,256	0.0065	0.9935	90.85
30.5	41,051,962	243,565	0.0059	0.9941	90.26
31.5	31,744,530	159,298	0.0050	0.9950	89.72
32.5	24,428,457	224,934	0.0092	0.9908	89.27
33.5	23,854,270	466,319	0.0195	0.9805	88.45
34.5	22,069,425	114,304	0.0052	0.9948	86.72
35.5	21,214,470	183,712	0.0087	0.9913	86.27
36.5	20,701,288	168,979	0.0082	0.9918	85.52
37.5	20,128,433	210,129	0.0104	0.9896	84.83
38.5	19,506,340	266,523	0.0137	0.9863	83.94


MANITOBA HYDRO

ACCOUNT 3100T - INTERRUPTING EQUIPMENT

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1931-2010			EXPERIENCE BAND 1931-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
39.5	16,847,416	183,165	0.0109	0.9891	82.79	
40.5	15,896,018	202,142	0.0127	0.9873	81.89	
41.5	15,181,669	262,679	0.0173	0.9827	80.85	
42.5	14,313,654	187,301	0.0131	0.9869	79.45	
43.5	13,310,182	355,882	0.0267	0.9733	78.41	
44.5	11,119,761	120,148	0.0108	0.9892	76.32	
45.5	10,801,741	141,870	0.0131	0.9869	75.49	
46.5	10,459,541	137,350	0.0131	0.9869	74.50	
47.5	10,194,132	100,557	0.0099	0.9901	73.52	
48.5	9,747,176	106,587	0.0109	0.9891	72.80	
49.5	8,694,254	263,062	0.0303	0.9697	72.00	
50.5	8,306,820	236,195	0.0284	0.9716	69.82	
51.5	7,828,254	198,456	0.0254	0.9746	67.84	
52.5	7,137,746	137,994	0.0193	0.9807	66.12	
53.5	6,760,010	65,739	0.0097	0.9903	64.84	
54.5	6,146,164	86,890	0.0141	0.9859	64.21	
55.5	5,834,087	132,335	0.0227	0.9773	63.30	
56.5	5,628,089	261,439	0.0465	0.9535	61.87	
57.5	459,712	17,877	0.0389	0.9611	58.99	
58.5	186,284	7,151	0.0384	0.9616	56.70	
59.5	111,761	6,540	0.0585	0.9415	54.52	
60.5	7,409	617	0.0833	0.9167	51.33	
61.5	1,986	479	0.2410	0.7590	47.06	
62.5					35.72	

MANITOBA HYDRO
ACCOUNT 3100U - OTHER STATION EQUIPMENT
ORIGINAL AND SMOOTH SURVIVOR CURVES

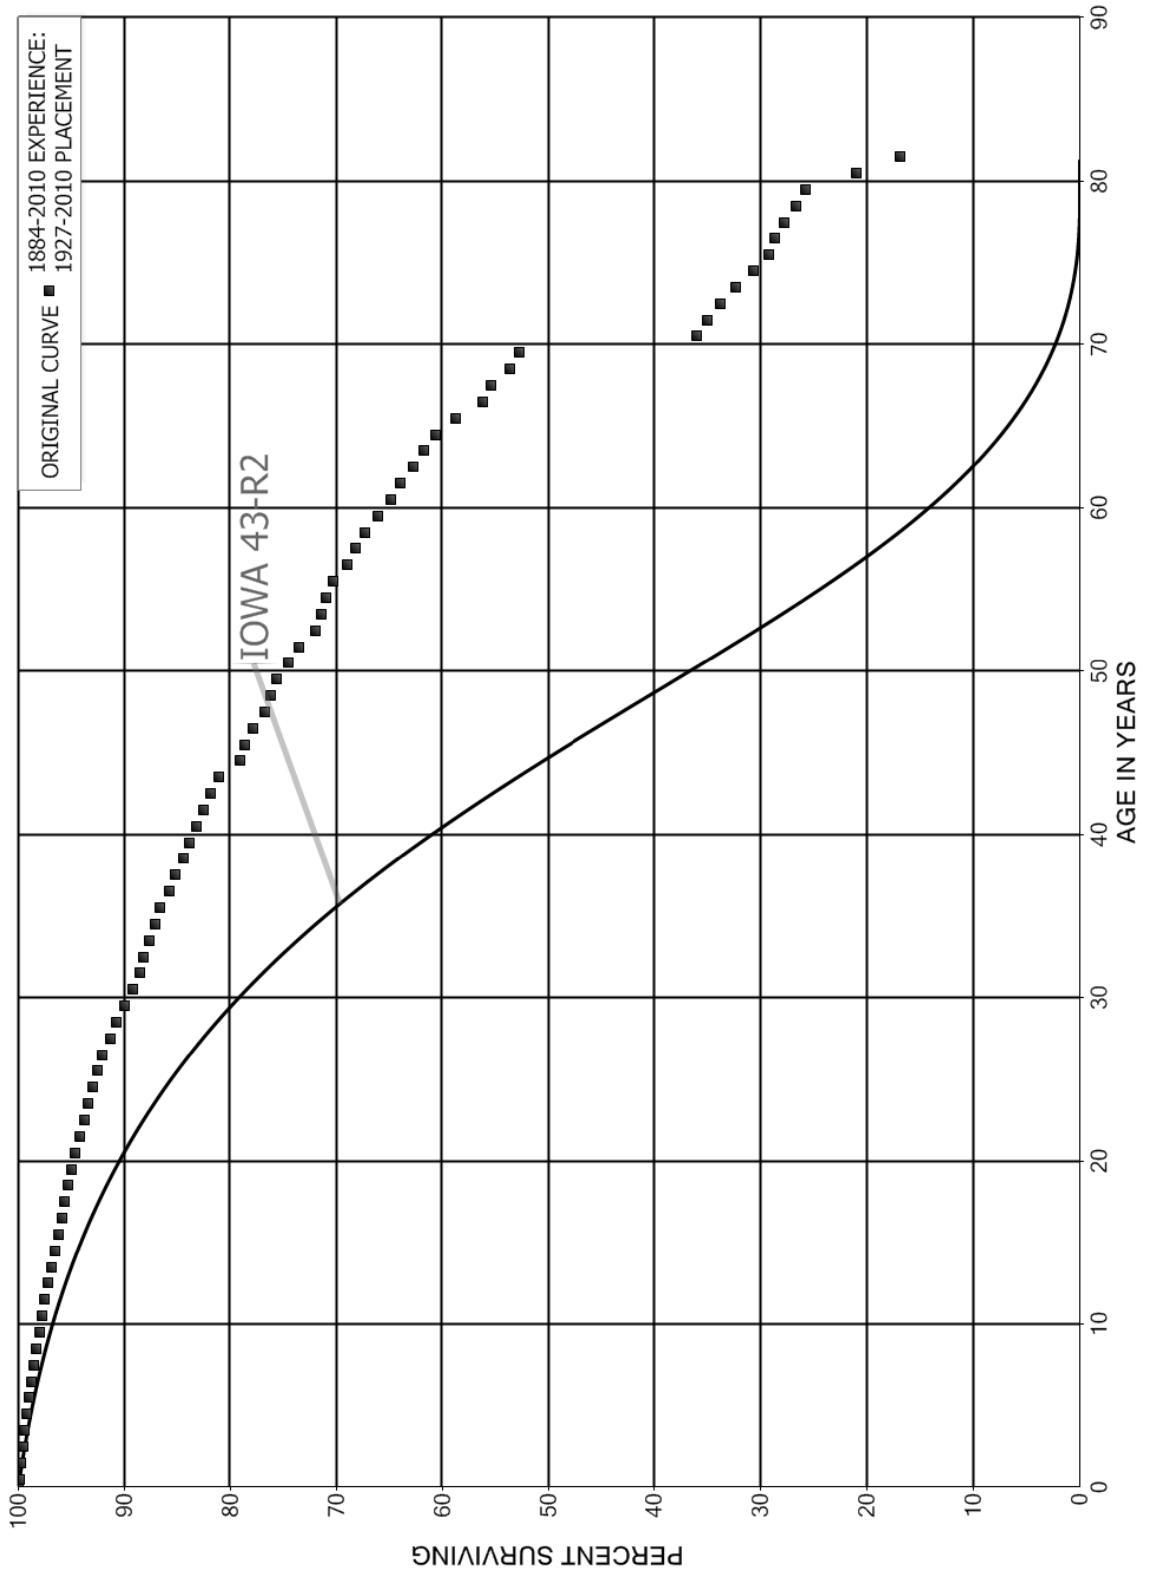

MANITOBA HYDRO

ACCOUNT 3100U - OTHER STATION EQUIPMENT

ORIGINAL LIFE TABLE

PLACEMENT BAND 1927-2010			EXPERIENCE BAND 1884-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	537,241,078	624,567	0.0012	0.9988	100.00
0.5	527,977,415	826,856	0.0016	0.9984	99.88
1.5	495,675,423	898,378	0.0018	0.9982	99.73
2.5	470,304,190	918,675	0.0020	0.9980	99.55
3.5	445,385,461	799,489	0.0018	0.9982	99.35
4.5	416,881,759	1,042,523	0.0025	0.9975	99.17
5.5	403,194,158	799,439	0.0020	0.9980	98.93
6.5	384,007,672	804,958	0.0021	0.9979	98.73
7.5	359,199,604	839,524	0.0023	0.9977	98.52
8.5	338,462,672	1,149,307	0.0034	0.9966	98.29
9.5	325,838,791	797,701	0.0024	0.9976	97.96
10.5	308,376,063	839,329	0.0027	0.9973	97.72
11.5	278,867,976	748,241	0.0027	0.9973	97.45
12.5	258,338,525	1,017,503	0.0039	0.9961	97.19
13.5	218,598,637	734,988	0.0034	0.9966	96.81
14.5	202,652,040	673,041	0.0033	0.9967	96.48
15.5	180,913,560	539,654	0.0030	0.9970	96.16
16.5	170,817,022	477,096	0.0028	0.9972	95.88
17.5	162,160,158	570,366	0.0035	0.9965	95.61
18.5	153,469,603	592,963	0.0039	0.9961	95.27
19.5	148,627,630	518,971	0.0035	0.9965	94.90
20.5	138,342,967	564,997	0.0041	0.9959	94.57
21.5	128,705,620	570,300	0.0044	0.9956	94.19
22.5	124,866,967	519,380	0.0042	0.9958	93.77
23.5	122,129,430	502,599	0.0041	0.9959	93.38
24.5	117,958,525	553,252	0.0047	0.9953	92.99
25.5	115,060,815	627,186	0.0055	0.9945	92.56
26.5	111,335,264	964,155	0.0087	0.9913	92.05
27.5	107,376,232	622,013	0.0058	0.9942	91.26
28.5	101,610,000	890,495	0.0088	0.9912	90.73
29.5	91,059,537	794,080	0.0087	0.9913	89.93
30.5	82,712,547	559,999	0.0068	0.9932	89.15
31.5	76,003,242	351,309	0.0046	0.9954	88.54
32.5	60,399,155	389,197	0.0064	0.9936	88.14
33.5	58,129,577	345,565	0.0059	0.9941	87.57
34.5	53,921,047	294,679	0.0055	0.9945	87.05
35.5	50,254,305	474,747	0.0094	0.9906	86.57
36.5	48,413,279	448,234	0.0072	0.9928	85.75
37.5	46,676,518	408,627	0.0088	0.9912	85.14
38.5	45,253,398	291,683	0.0064	0.9936	84.39

MANITOBA HYDRO

ACCOUNT 3100U - OTHER STATION EQUIPMENT

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1927-2010			EXPERIENCE BAND 1884-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
39.5	39,848,031	333,319	0.0084	0.9916	83.85	
40.5	38,256,337	294,523	0.0077	0.9923	83.15	
41.5	36,702,096	311,030	0.0085	0.9915	82.51	
42.5	33,393,701	301,922	0.0090	0.9910	81.81	
43.5	27,294,614	659,639	0.0242	0.9758	81.07	
44.5	24,548,558	162,750	0.0066	0.9934	79.11	
45.5	23,682,108	236,108	0.0100	0.9900	78.58	
46.5	22,844,079	315,951	0.0138	0.9862	77.80	
47.5	21,613,196	164,153	0.0076	0.9924	76.72	
48.5	20,402,230	149,898	0.0073	0.9927	76.14	
49.5	18,956,874	258,133	0.0136	0.9864	75.58	
50.5	18,203,015	260,457	0.0143	0.9857	74.55	
51.5	17,007,042	362,542	0.0213	0.9787	73.49	
52.5	15,653,171	120,251	0.0077	0.9923	71.92	
53.5	15,149,636	84,300	0.0056	0.9944	71.37	
54.5	14,144,724	146,382	0.0103	0.9897	70.97	
55.5	13,069,334	228,087	0.0175	0.9825	70.24	
56.5	12,612,427	153,350	0.0122	0.9878	69.01	
57.5	1,627,753	21,695	0.0133	0.9867	68.17	
58.5	951,849	17,004	0.0179	0.9821	67.26	
59.5	797,079	14,296	0.0179	0.9821	66.06	
60.5	278,421	3,993	0.0143	0.9857	64.88	
61.5	194,106	3,769	0.0194	0.9806	63.95	
62.5	187,972	2,998	0.0160	0.9840	62.70	
63.5	173,257	2,937	0.0170	0.9830	61.70	
64.5	168,137	5,394	0.0321	0.9679	60.66	
65.5	140,427	6,027	0.0429	0.9571	58.71	
66.5	125,693	1,810	0.0144	0.9856	56.19	
67.5	122,402	3,874	0.0316	0.9684	55.38	
68.5	112,102	1,825	0.0163	0.9837	53.63	
69.5	107,239	34,228	0.3192	0.6808	52.76	
70.5	71,753	1,874	0.0261	0.9739	35.92	
71.5	65,341	2,408	0.0369	0.9631	34.98	
72.5	62,933	2,653	0.0422	0.9578	33.69	
73.5	47,427	2,431	0.0513	0.9487	32.27	
74.5	44,996	2,123	0.0472	0.9528	30.62	
75.5	42,211	803	0.0190	0.9810	29.17	
76.5	39,400	1,288	0.0327	0.9673	28.62	
77.5	38,112	1,445	0.0379	0.9621	27.68	
78.5	22,505	765	0.0340	0.9660	26.63	


MANITOBA HYDRO

ACCOUNT 3100U - OTHER STATION EQUIPMENT

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1927-2010			EXPERIENCE BAND 1884-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
79.5	2,393	450	0.1880	0.8120	25.73	
80.5	1,943	379	0.1953	0.8047	20.89	
81.5					16.81	

MANITOBA HYDRO
ACCOUNT 3100V - ELECTRONIC EQUIPMENT AND BATTERIES
ORIGINAL AND SMOOTH SURVIVOR CURVES

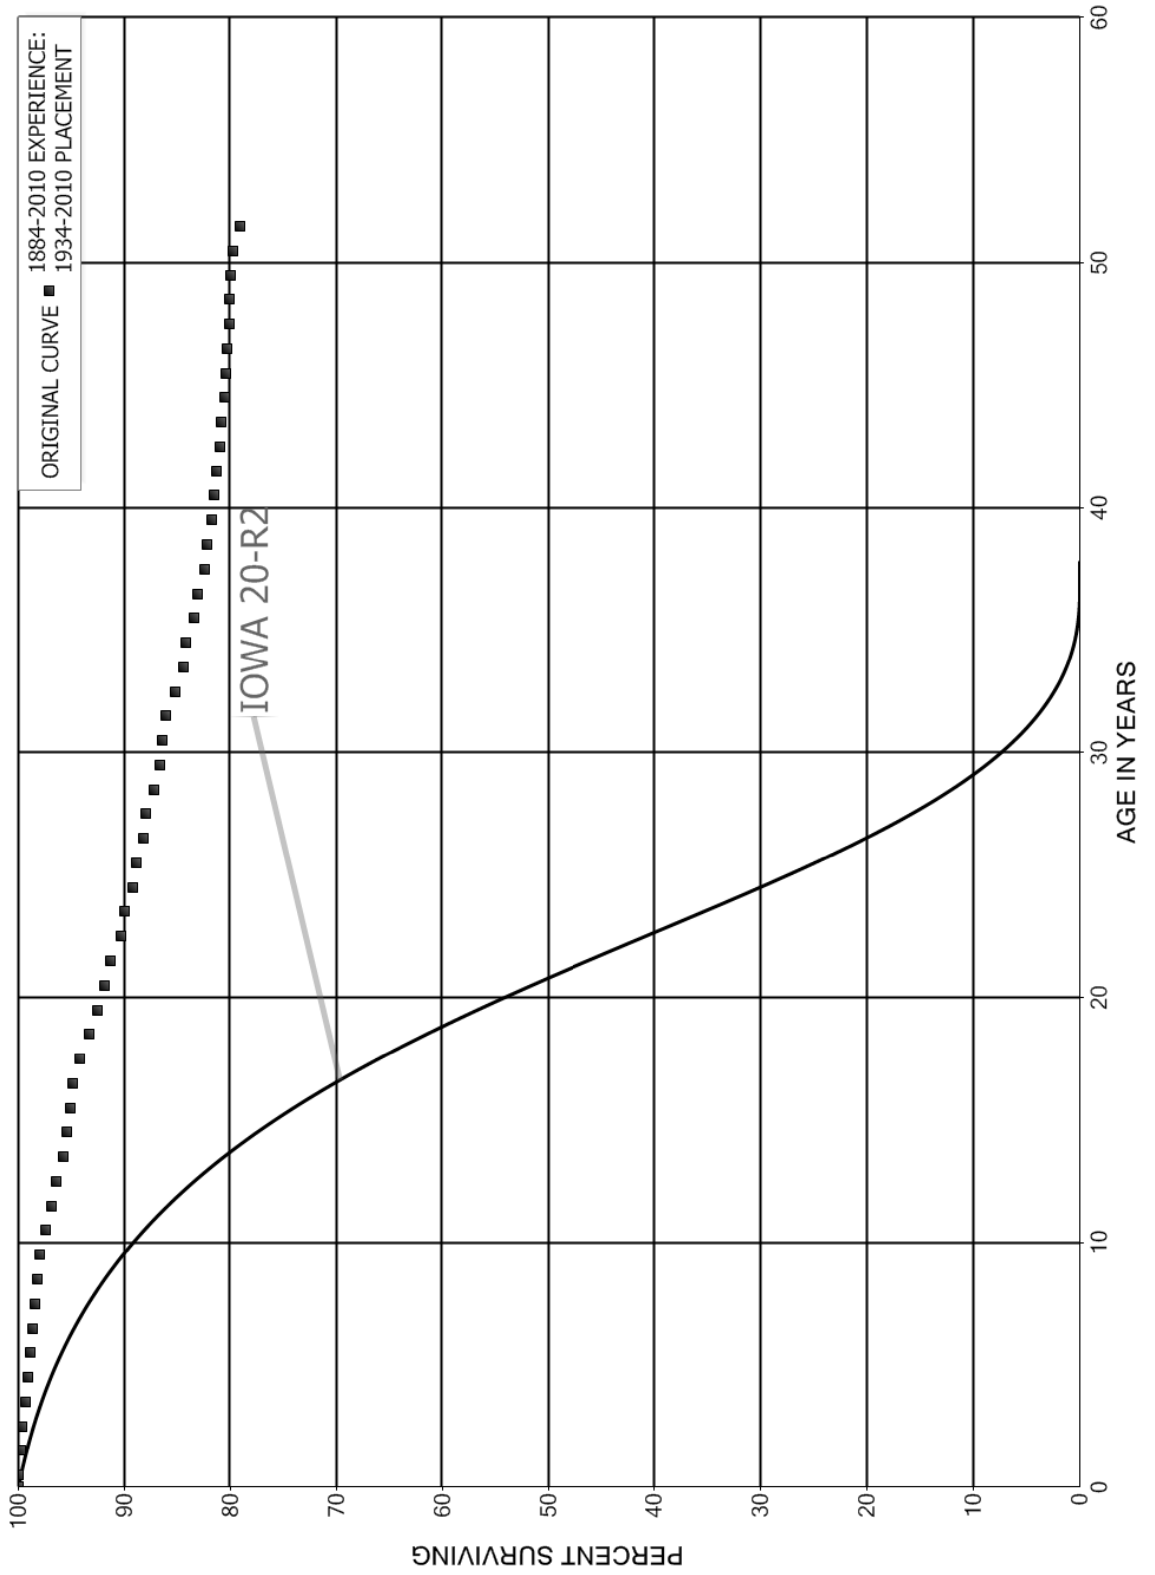

MANITOBA HYDRO

ACCOUNT 3100V - ELECTRONIC EQUIPMENT AND BATTERIES

ORIGINAL LIFE TABLE

PLACEMENT BAND 1934-2010			EXPERIENCE BAND 1884-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
0.0	167,118,445	139,315	0.0008	0.9992	100.00	
0.5	157,626,248	245,861	0.0016	0.9984	99.92	
1.5	146,594,864	282,404	0.0019	0.9981	99.76	
2.5	131,071,953	430,614	0.0033	0.9967	99.57	
3.5	117,586,366	199,457	0.0017	0.9983	99.24	
4.5	109,252,494	266,615	0.0024	0.9976	99.07	
5.5	104,522,107	225,238	0.0022	0.9978	98.83	
6.5	99,217,726	253,147	0.0026	0.9974	98.62	
7.5	94,277,902	146,088	0.0015	0.9985	98.37	
8.5	89,668,598	232,929	0.0026	0.9974	98.21	
9.5	87,476,319	459,667	0.0053	0.9947	97.96	
10.5	83,859,431	514,066	0.0061	0.9939	97.44	
11.5	76,042,016	347,016	0.0046	0.9954	96.85	
12.5	69,779,637	477,568	0.0068	0.9932	96.41	
13.5	54,061,806	220,965	0.0041	0.9959	95.75	
14.5	50,602,218	166,947	0.0033	0.9967	95.35	
15.5	46,634,646	120,391	0.0026	0.9974	95.04	
16.5	45,489,637	310,467	0.0068	0.9932	94.79	
17.5	41,221,986	371,126	0.0090	0.9910	94.15	
18.5	38,796,231	334,158	0.0086	0.9914	93.30	
19.5	36,988,424	275,720	0.0075	0.9925	92.50	
20.5	32,232,621	173,874	0.0054	0.9946	91.81	
21.5	28,174,815	314,378	0.0112	0.9888	91.31	
22.5	26,747,116	115,157	0.0043	0.9957	90.29	
23.5	24,661,588	188,275	0.0076	0.9924	89.90	
24.5	23,200,520	97,461	0.0042	0.9958	89.22	
25.5	22,422,504	181,446	0.0081	0.9919	88.84	
26.5	21,442,205	53,729	0.0025	0.9975	88.12	
27.5	20,960,873	184,990	0.0088	0.9912	87.90	
28.5	20,414,527	115,007	0.0056	0.9944	87.13	
29.5	19,145,161	45,701	0.0024	0.9976	86.64	
30.5	18,015,227	74,599	0.0041	0.9959	86.43	
31.5	16,959,875	178,564	0.0105	0.9895	86.07	
32.5	15,140,094	131,518	0.0087	0.9913	85.17	
33.5	14,678,896	51,636	0.0035	0.9965	84.43	
34.5	14,179,345	118,334	0.0083	0.9917	84.13	
35.5	13,659,321	55,473	0.0041	0.9959	83.43	
36.5	13,448,866	110,803	0.0082	0.9918	83.09	
37.5	13,211,833	37,757	0.0029	0.9971	82.40	
38.5	13,100,823	67,588	0.0052	0.9948	82.17	


MANITOBA HYDRO

ACCOUNT 3100V - ELECTRONIC EQUIPMENT AND BATTERIES


ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1934-2010			EXPERIENCE BAND 1884-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
39.5	12,566,828	35,429	0.0028	0.9972	81.74	
40.5	12,452,761	33,797	0.0027	0.9973	81.51	
41.5	12,291,313	57,251	0.0047	0.9953	81.29	
42.5	12,130,808	17,602	0.0015	0.9985	80.91	
43.5	11,903,300	38,384	0.0032	0.9968	80.80	
44.5	11,762,260	28,252	0.0024	0.9976	80.54	
45.5	11,720,334	14,748	0.0013	0.9987	80.34	
46.5	11,705,551	19,960	0.0017	0.9983	80.24	
47.5	11,678,177	9,419	0.0008	0.9992	80.10	
48.5	11,598,329	14,455	0.0012	0.9988	80.04	
49.5	6,934,992	14,392	0.0021	0.9979	79.94	
50.5	6,911,415	56,837	0.0082	0.9918	79.77	
51.5	6,794,555	28,537	0.0042	0.9958	79.12	
52.5	6,742,657	81,929	0.0122	0.9878	78.79	
53.5	6,636,575	29,826	0.0045	0.9955	77.83	
54.5	6,561,721	12,916	0.0020	0.9980	77.48	
55.5	6,519,916	16,858	0.0026	0.9974	77.33	
56.5	6,463,593	62,119	0.0096	0.9904	77.13	
57.5	167		0.0000	1.0000	76.38	
58.5					76.38	


MANITOBA HYDRO
ACCOUNT 3200M - SYNCHRONOUS CONDENSERS AND UNIT TRANSFORMERS
SMOOTH SURVIVOR CURVE

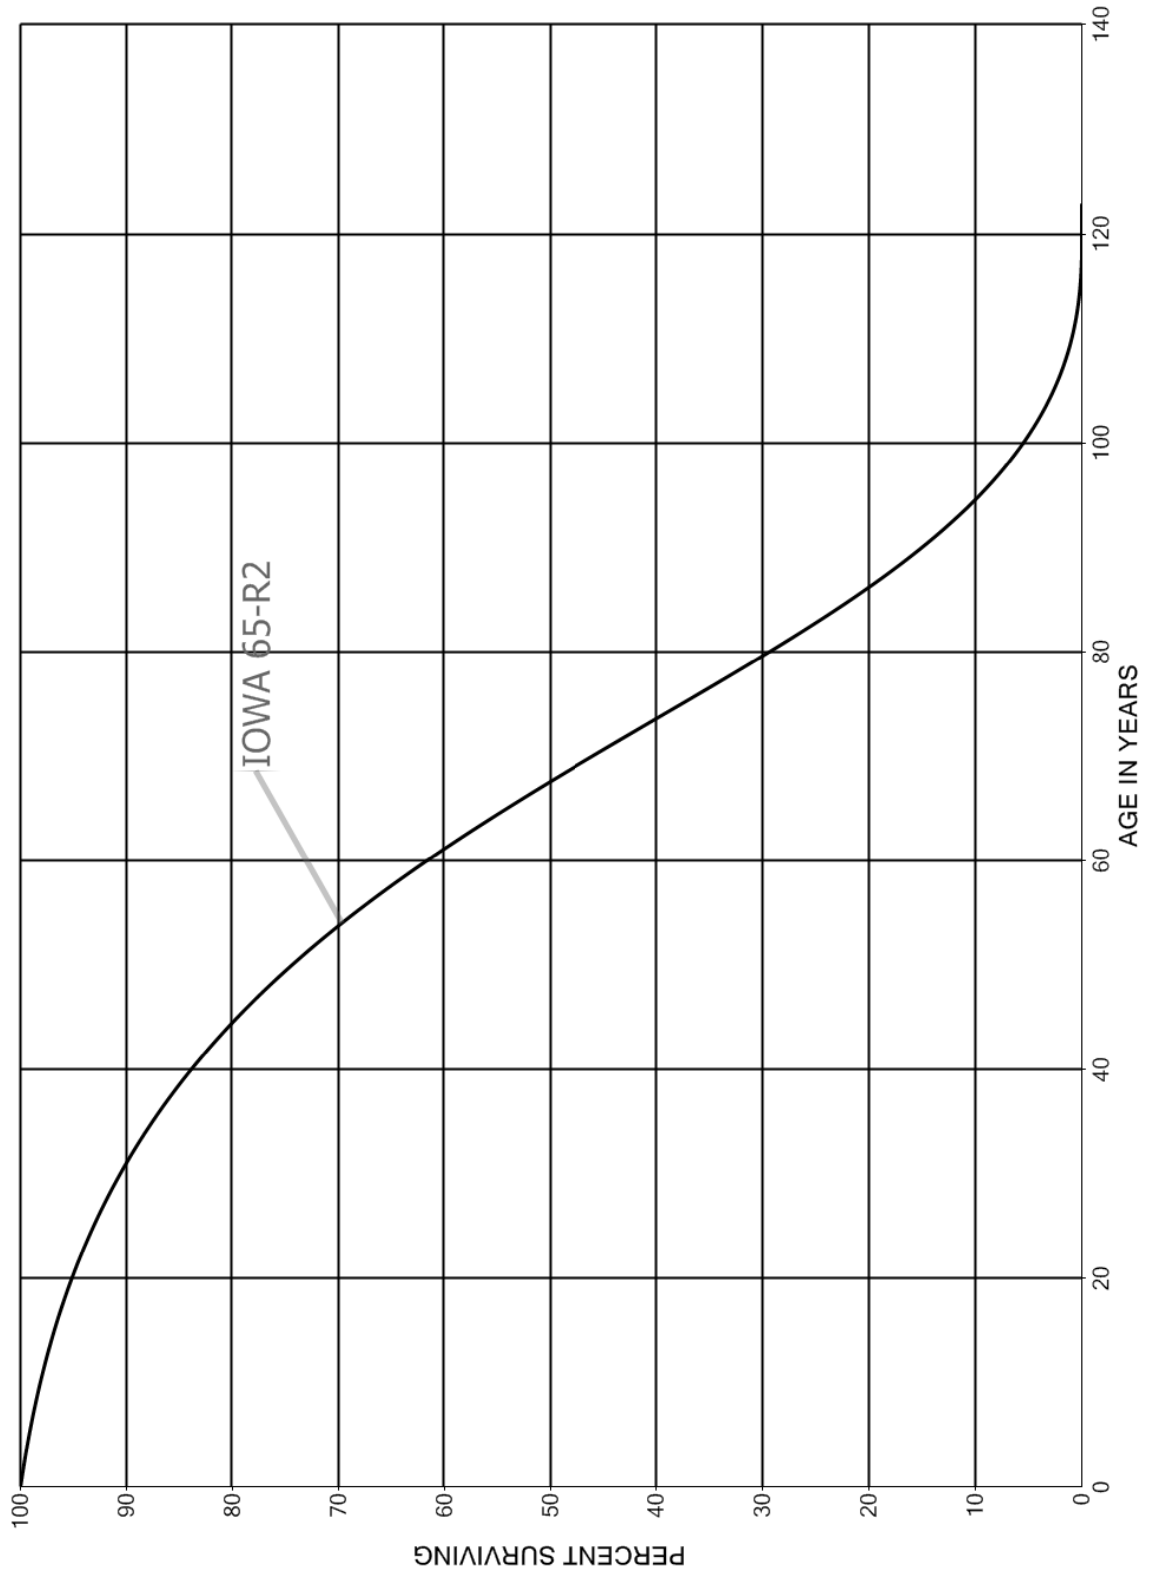

MANITOBA HYDRO
ACCOUNT 3200N - SYNCHRONOUS CONDENSER OVERHAULS
SMOOTH SURVIVOR CURVE

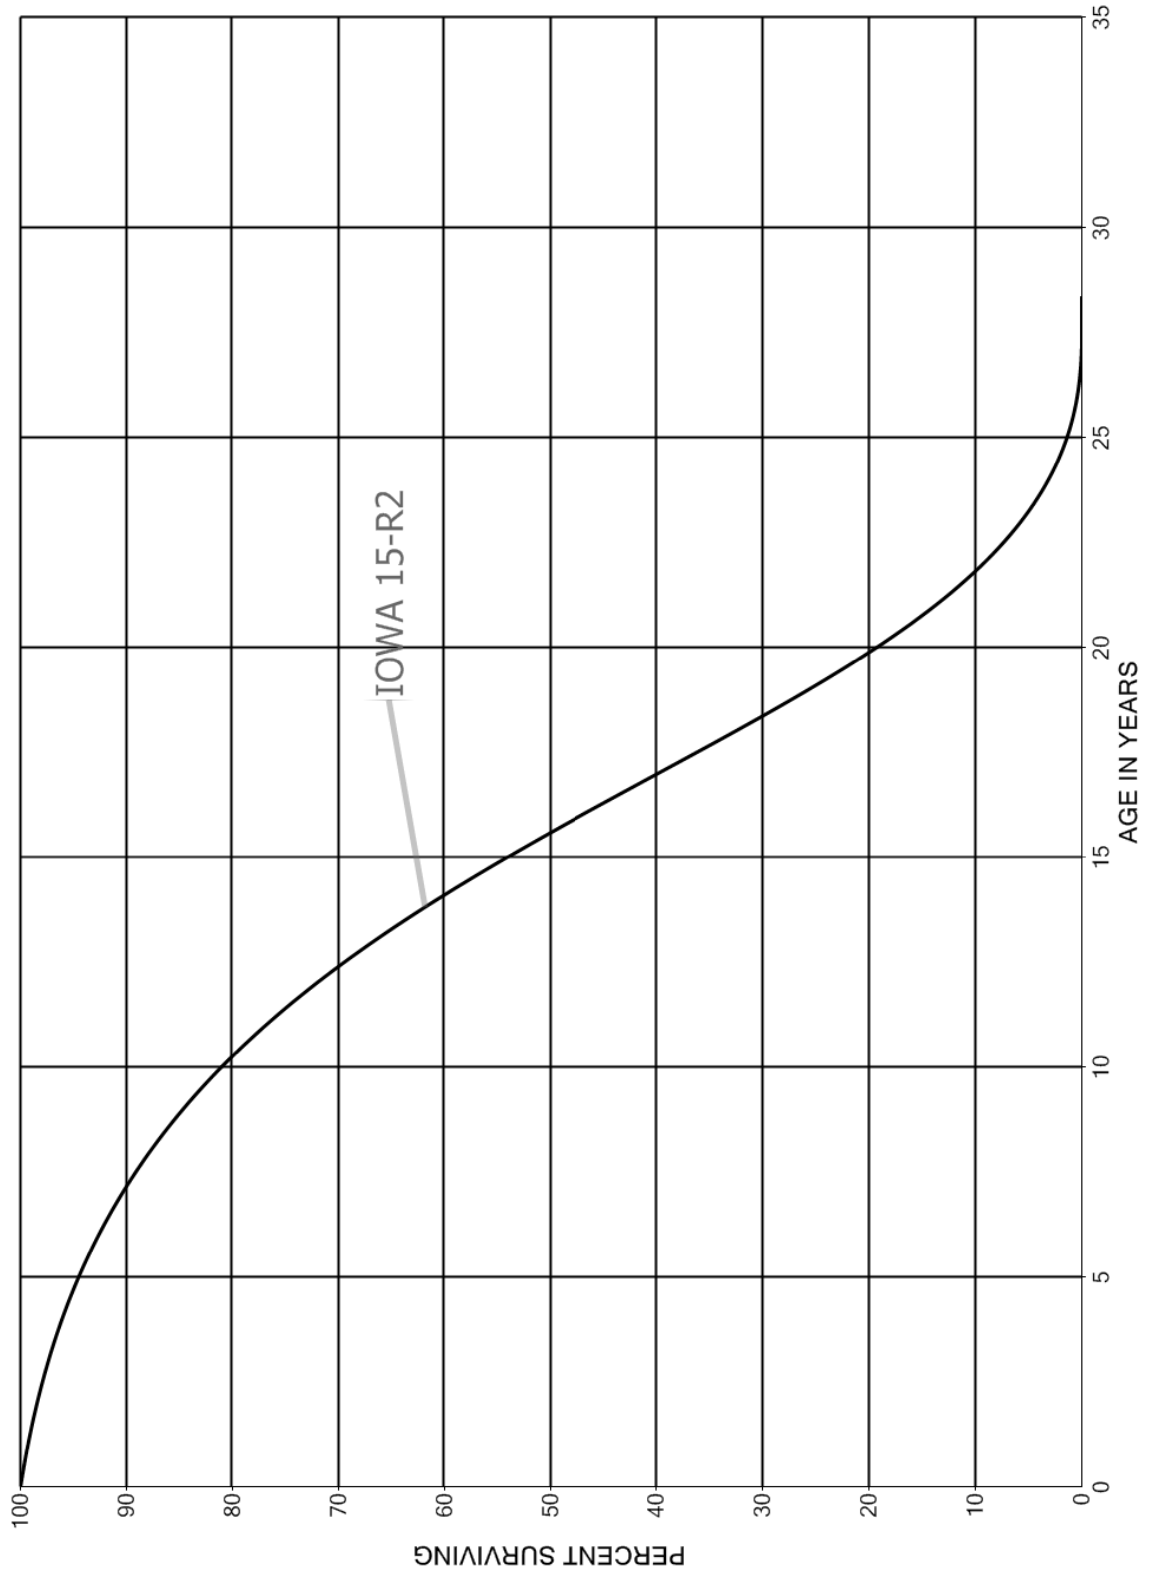

MANITOBA HYDRO
ACCOUNT 3200P - HVDC CONVERTER EQUIPMENT
ORIGINAL AND SMOOTH SURVIVOR CURVES

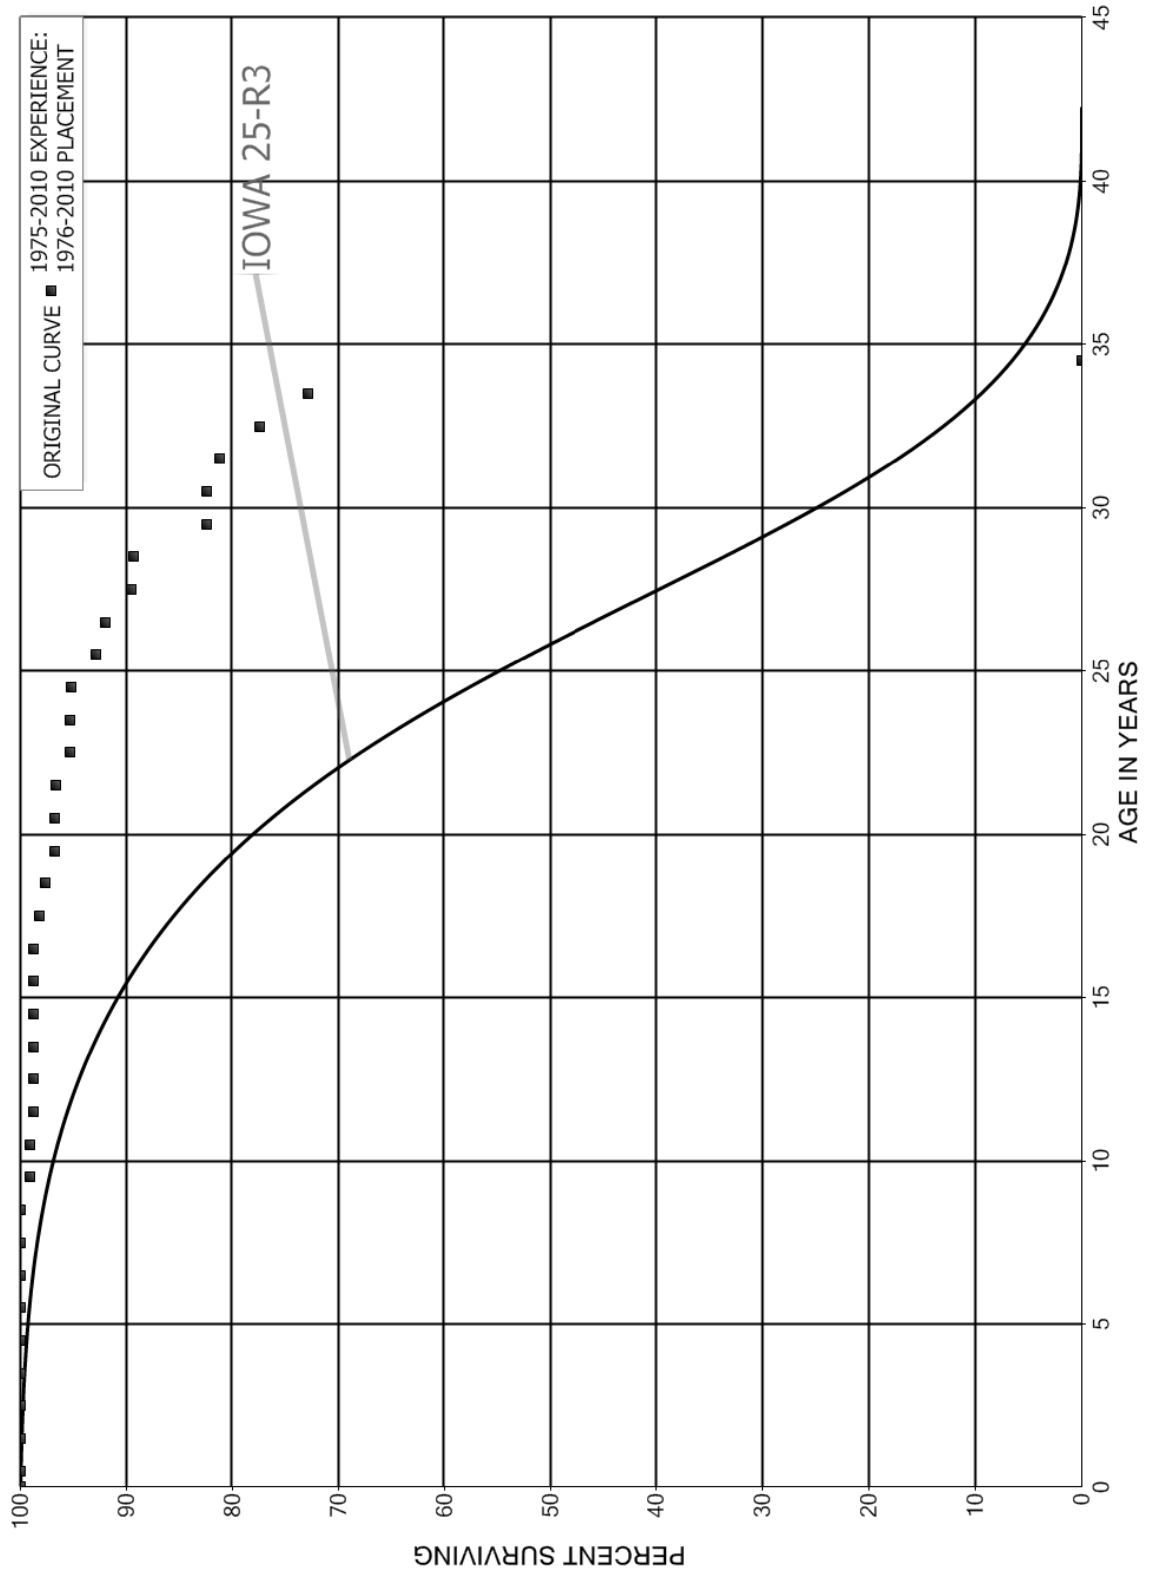


MANITOBA HYDRO

ACCOUNT 3200P - HVDC CONVERTER EQUIPMENT

ORIGINAL LIFE TABLE

PLACEMENT BAND 1976-2010			EXPERIENCE BAND 1975-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	252,697,195	11,323	0.0000	1.0000	100.00
0.5	251,460,523	28,577	0.0001	0.9999	100.00
1.5	244,953,820		0.0000	1.0000	99.98
2.5	232,841,977		0.0000	1.0000	99.98
3.5	227,098,152		0.0000	1.0000	99.98
4.5	219,206,199		0.0000	1.0000	99.98
5.5	178,511,473	15,771	0.0001	0.9999	99.98
6.5	165,669,158	61,463	0.0004	0.9996	99.98
7.5	156,607,188	341	0.0000	1.0000	99.94
8.5	149,787,591	1,343,007	0.0090	0.9910	99.94
9.5	142,453,998		0.0000	1.0000	99.04
10.5	138,275,041	451,215	0.0033	0.9967	99.04
11.5	135,209,306	17,198	0.0001	0.9999	98.72
12.5	130,540,713		0.0000	1.0000	98.71
13.5	115,900,340		0.0000	1.0000	98.71
14.5	111,521,184	4,562	0.0000	1.0000	98.71
15.5	92,086,823	10,872	0.0001	0.9999	98.70
16.5	92,014,717	464,725	0.0051	0.9949	98.69
17.5	90,658,159	576,041	0.0064	0.9936	98.19
18.5	85,842,803	762,534	0.0089	0.9911	97.57
19.5	83,921,856	176	0.0000	1.0000	96.70
20.5	83,265,829	83,414	0.0010	0.9990	96.70
21.5	82,265,260	1,133,721	0.0138	0.9862	96.60
22.5	80,143,230	545	0.0000	1.0000	95.27
23.5	79,560,937	112,388	0.0014	0.9986	95.27
24.5	79,216,150	1,935,642	0.0244	0.9756	95.14
25.5	61,721,844	606,307	0.0098	0.9902	92.81
26.5	44,925,027	1,180,495	0.0263	0.9737	91.90
27.5	43,690,615	103,951	0.0024	0.9976	89.49
28.5	42,916,654	3,298,617	0.0769	0.9231	89.27
29.5	39,465,014		0.0000	1.0000	82.41
30.5	39,441,126	601,989	0.0153	0.9847	82.41
31.5	38,835,426	1,778,445	0.0458	0.9542	81.15
32.5	4,122,349	243,900	0.0592	0.9408	77.44
33.5	3,878,449	3,878,449	1.0000		72.86
34.5					

MANITOBA HYDRO
ACCOUNT 3200S - HVDC SERIALIZED EQUIPMENT
ORIGINAL AND SMOOTH SURVIVOR CURVES

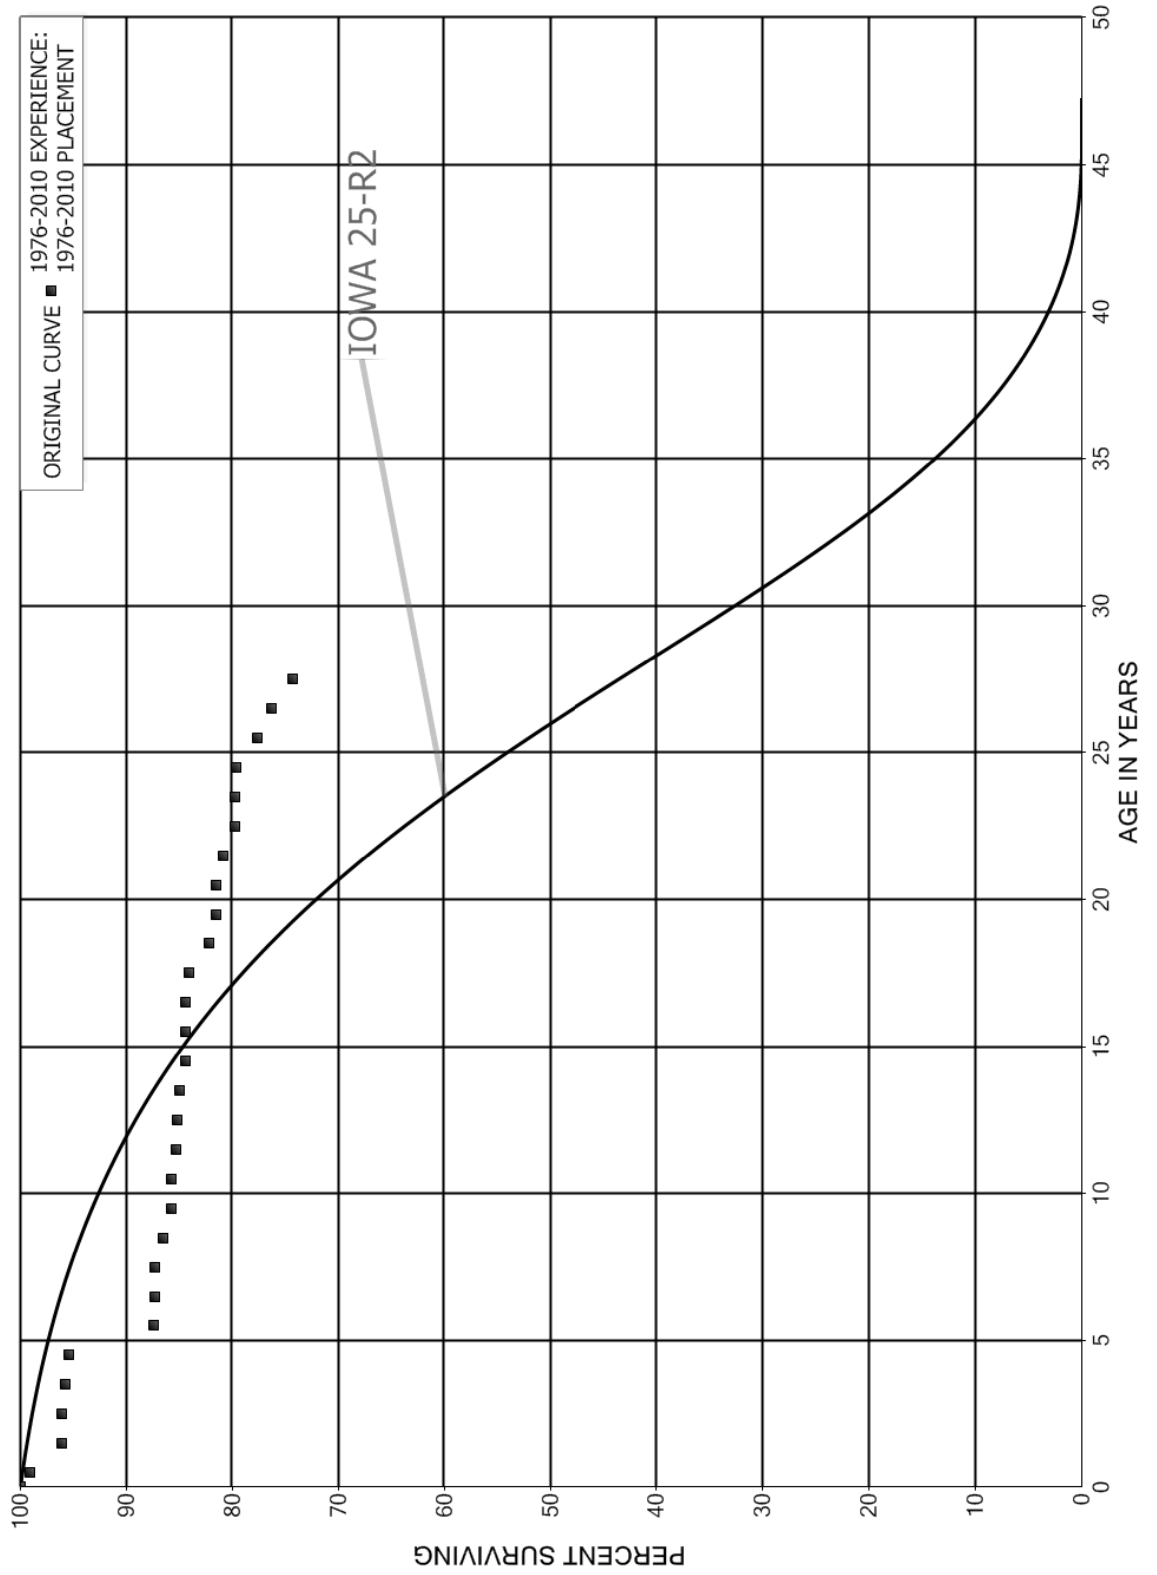


MANITOBA HYDRO

ACCOUNT 3200S - HVDC SERIALIZED EQUIPMENT

ORIGINAL LIFE TABLE

PLACEMENT BAND 1976-2010			EXPERIENCE BAND 1976-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	823,063,567	7,883,675	0.0096	0.9904	100.00
0.5	798,886,362	23,888,005	0.0299	0.9701	99.04
1.5	759,176,277	42,304	0.0001	0.9999	96.08
2.5	724,658,268	2,622,234	0.0036	0.9964	96.08
3.5	714,621,251	2,181,532	0.0031	0.9969	95.73
4.5	686,239,186	58,152,678	0.0847	0.9153	95.44
5.5	570,261,719	82,054	0.0001	0.9999	87.35
6.5	534,712,538	175,165	0.0003	0.9997	87.34
7.5	493,636,839	4,691,317	0.0095	0.9905	87.31
8.5	465,525,303	3,827,489	0.0082	0.9918	86.48
9.5	437,184,829		0.0000	1.0000	85.77
10.5	415,627,263	2,110,935	0.0051	0.9949	85.77
11.5	403,024,346	844,000	0.0021	0.9979	85.33
12.5	388,924,156	750,000	0.0019	0.9981	85.15
13.5	346,449,992	2,250,000	0.0065	0.9935	84.99
14.5	332,762,316	13,002	0.0000	1.0000	84.44
15.5	277,375,583	30,983	0.0001	0.9999	84.43
16.5	277,170,086	1,324,437	0.0048	0.9952	84.42
17.5	273,303,978	5,871,708	0.0215	0.9785	84.02
18.5	250,018,190	2,173,176	0.0087	0.9913	82.21
19.5	244,543,610	502	0.0000	1.0000	81.50
20.5	242,673,974	2,115,726	0.0087	0.9913	81.50
21.5	237,944,412	3,231,036	0.0136	0.9864	80.79
22.5	231,896,757	1,553	0.0000	1.0000	79.69
23.5	230,237,258	320,300	0.0014	0.9986	79.69
24.5	229,254,637	5,516,461	0.0241	0.9759	79.58
25.5	179,396,940	3,151,939	0.0176	0.9824	77.67
26.5	130,103,044	3,364,337	0.0259	0.9741	76.30
27.5	126,585,047	5,721,255	0.0452	0.9548	74.33
28.5	118,954,305	9,400,856	0.0790	0.9210	70.97
29.5	109,117,343		0.0000	1.0000	65.36
30.5	109,049,264	5,457,242	0.0500	0.9500	65.36
31.5	103,581,446	5,068,459	0.0489	0.9511	62.09
32.5	15,241,922	1,695,100	0.1112	0.8888	59.05
33.5	13,546,822	12,884,123	0.9511	0.0489	52.48
34.5					2.57

MANITOBA HYDRO
ACCOUNT 3200U - HVDC ACCESSORY STATION EQUIPMENT
ORIGINAL AND SMOOTH SURVIVOR CURVES

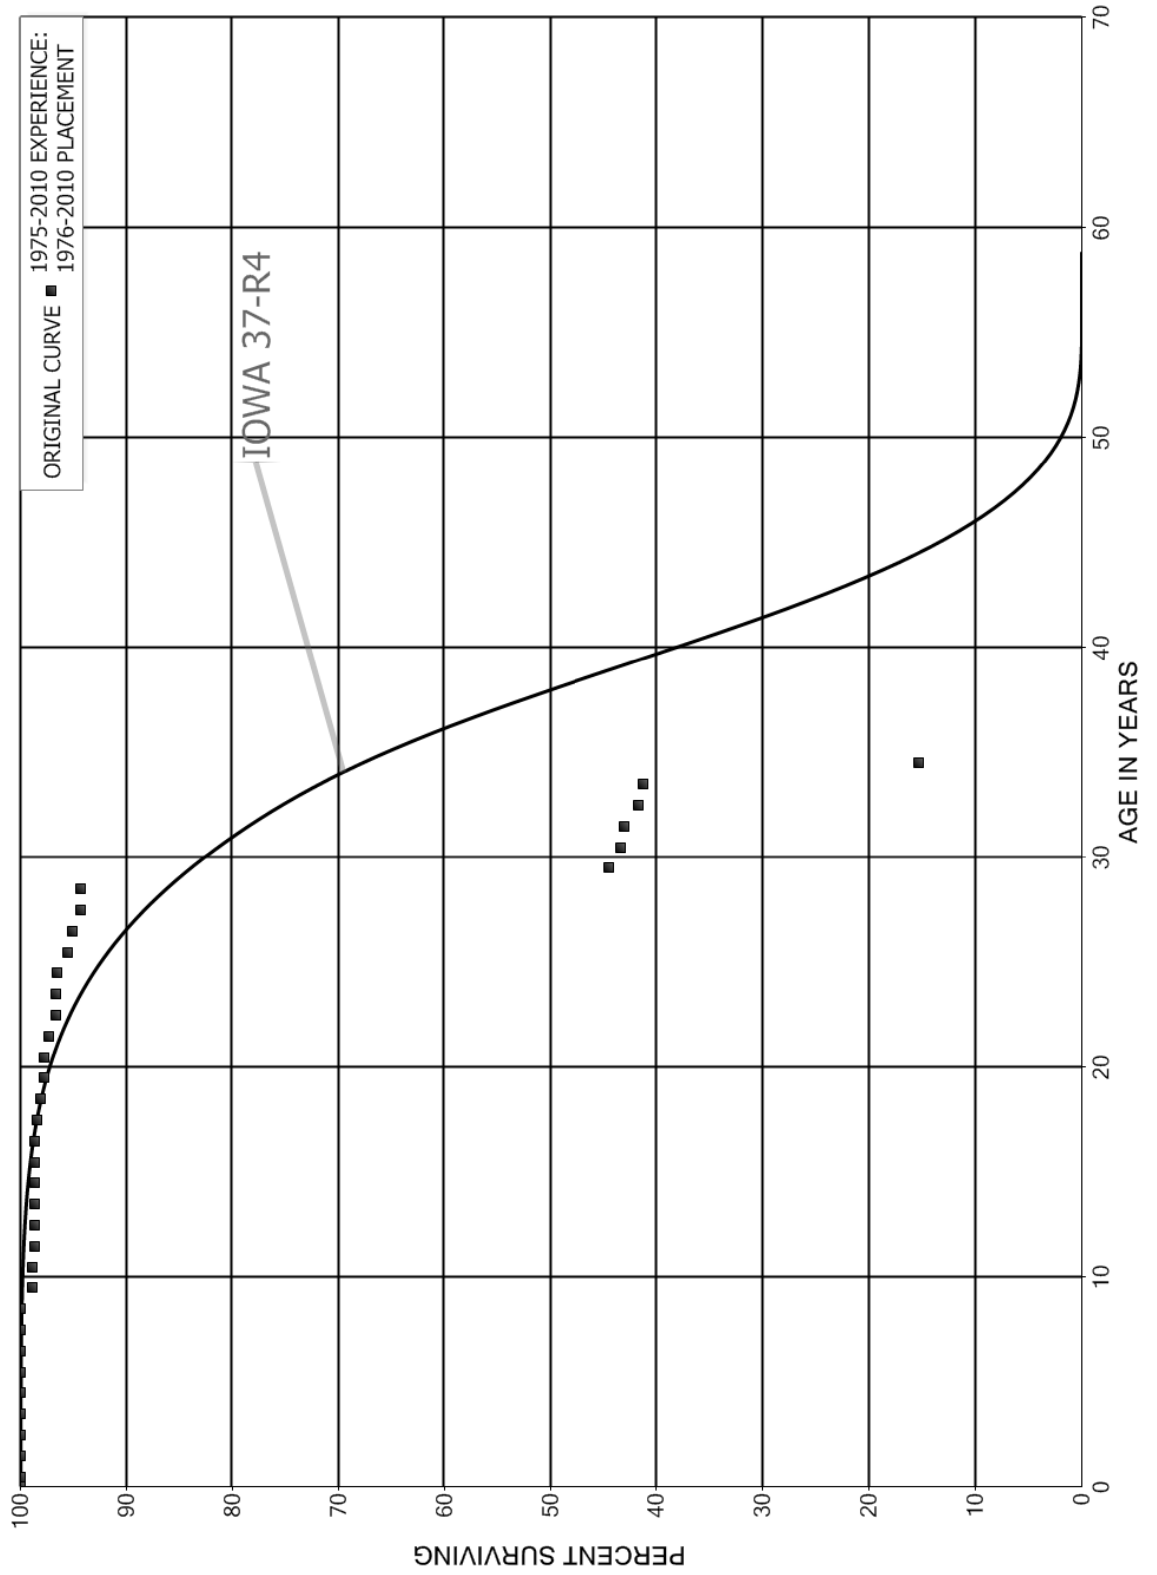


MANITOBA HYDRO

ACCOUNT 3200U - HVDC ACCESSORY STATION EQUIPMENT

ORIGINAL LIFE TABLE

PLACEMENT BAND 1976-2010			EXPERIENCE BAND 1975-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	71,135,950	11,504	0.0002	0.9998	100.00
0.5	58,262,946	7,147	0.0001	0.9999	99.98
1.5	56,635,604		0.0000	1.0000	99.97
2.5	53,606,401		0.0000	1.0000	99.97
3.5	52,169,857		0.0000	1.0000	99.97
4.5	50,196,059		0.0000	1.0000	99.97
5.5	39,582,350	3,944	0.0001	0.9999	99.97
6.5	36,370,455	15,372	0.0004	0.9996	99.96
7.5	34,104,034	85	0.0000	1.0000	99.92
8.5	32,398,436	335,890	0.0104	0.9896	99.92
9.5	30,564,286		0.0000	1.0000	98.88
10.5	40,566,051	112,850	0.0028	0.9972	98.88
11.5	39,799,303	4,301	0.0001	0.9999	98.61
12.5	63,979,721		0.0000	1.0000	98.60
13.5	60,318,127	2,494	0.0000	1.0000	98.60
14.5	59,220,396	1,141	0.0000	1.0000	98.59
15.5	54,359,814	2,719	0.0001	0.9999	98.59
16.5	54,341,780	116,229	0.0021	0.9979	98.59
17.5	54,002,501	144,069	0.0027	0.9973	98.38
18.5	44,873,289	190,712	0.0043	0.9957	98.11
19.5	44,392,855	44	0.0000	1.0000	97.70
20.5	44,228,781	165,745	0.0037	0.9963	97.70
21.5	43,833,653	322,343	0.0074	0.9926	97.33
22.5	43,264,132	136	0.0000	1.0000	96.61
23.5	43,118,499	28,109	0.0007	0.9993	96.61
24.5	43,032,267	484,109	0.0112	0.9888	96.55
25.5	40,145,702	154,728	0.0039	0.9961	95.46
26.5	35,941,687	295,245	0.0082	0.9918	95.10
27.5	35,632,957	25,999	0.0007	0.9993	94.32
28.5	35,439,388	18,761,979	0.5294	0.4706	94.25
29.5	16,639,137	395,764	0.0238	0.9762	44.35
30.5	16,237,399	150,559	0.0093	0.9907	43.30
31.5	16,085,912	497,109	0.0309	0.9691	42.90
32.5	5,862,963	61,000	0.0104	0.9896	41.57
33.5	5,801,963	3,645,642	0.6283	0.3717	41.14
34.5					15.29

MANITOBA HYDRO
ACCOUNT 3200V - HVDC ELECTRONIC EQUIPMENT AND BATTERIES
ORIGINAL AND SMOOTH SURVIVOR CURVES

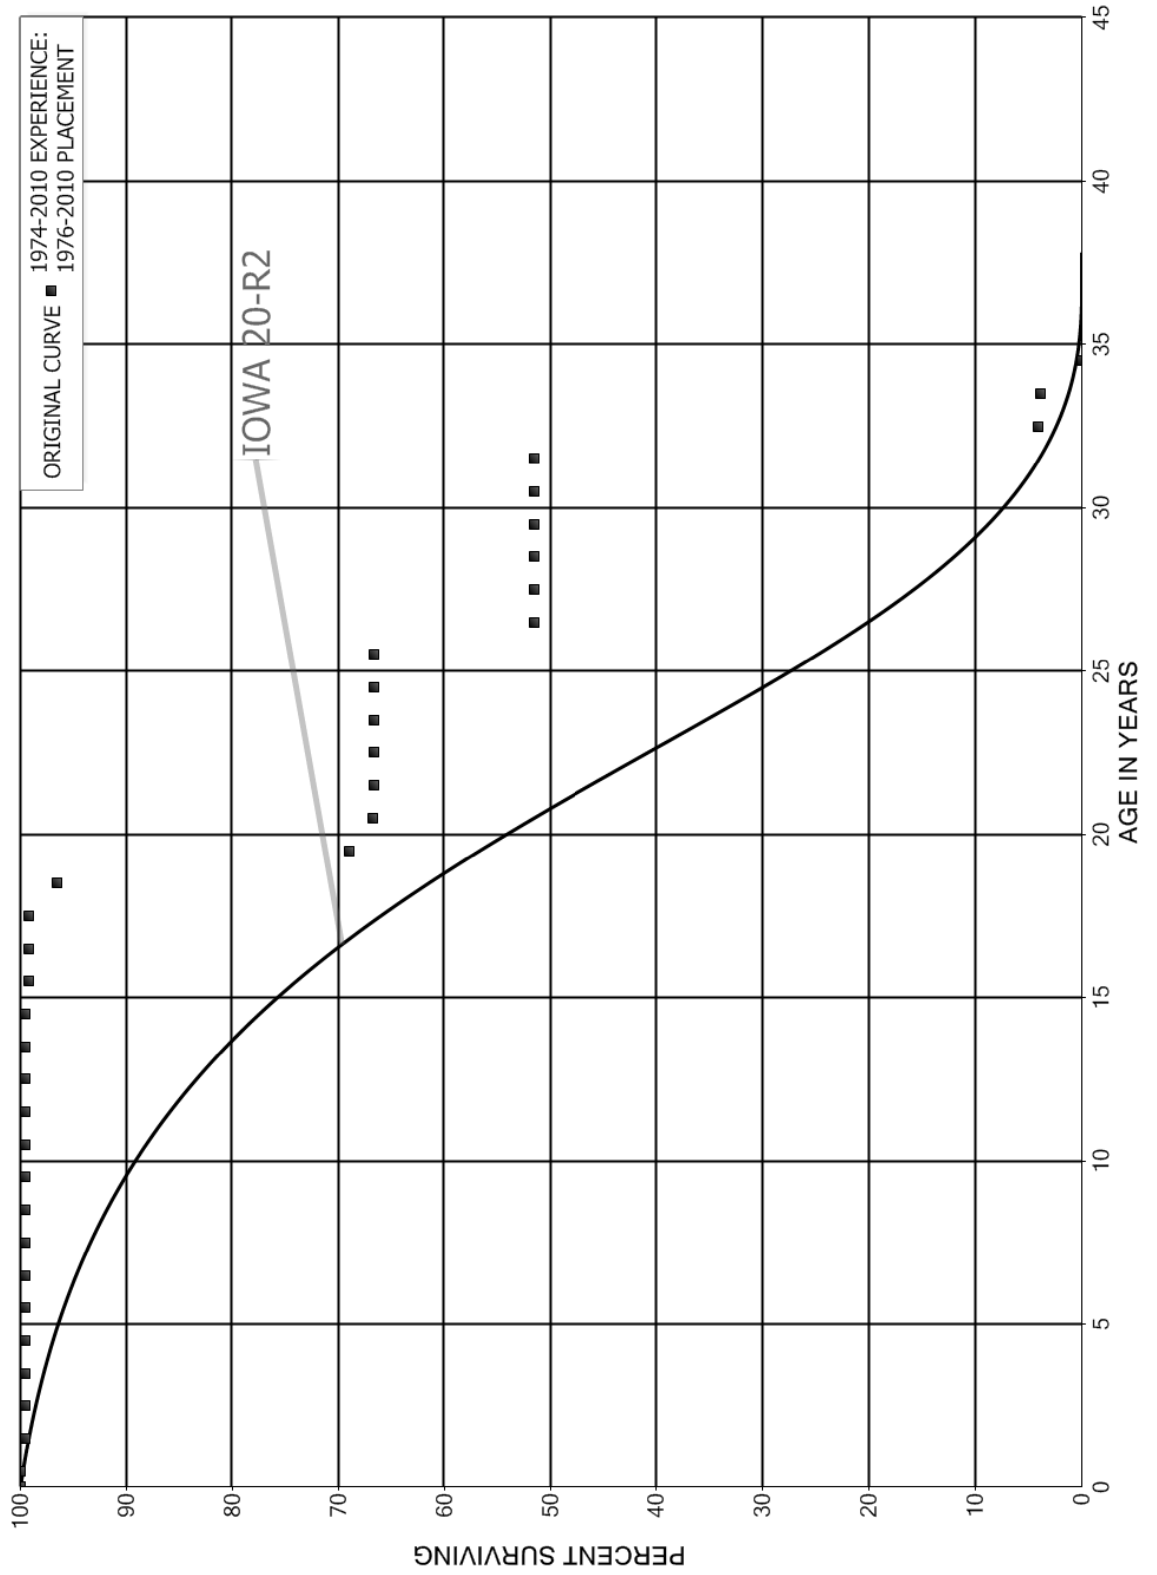


MANITOBA HYDRO

ACCOUNT 3200V - HVDC ELECTRONIC EQUIPMENT AND BATTERIES


ORIGINAL LIFE TABLE

PLACEMENT BAND 1976-2010			EXPERIENCE BAND 1974-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
0.0	12,914,421	1	0.0000	1.0000	100.00	
0.5	12,674,912	64,502	0.0051	0.9949	100.00	
1.5	12,295,858		0.0000	1.0000	99.49	
2.5	12,234,909		0.0000	1.0000	99.49	
3.5	12,170,255		0.0000	1.0000	99.49	
4.5	12,010,848		0.0000	1.0000	99.49	
5.5	10,382,590		0.0000	1.0000	99.49	
6.5	10,382,590		0.0000	1.0000	99.49	
7.5	10,347,988		0.0000	1.0000	99.49	
8.5	10,325,052		0.0000	1.0000	99.49	
9.5	10,284,032		0.0000	1.0000	99.49	
10.5	16,107,632		0.0000	1.0000	99.49	
11.5	16,078,405		0.0000	1.0000	99.49	
12.5	15,897,389		0.0000	1.0000	99.49	
13.5	12,377,269	70	0.0000	1.0000	99.49	
14.5	12,132,875	33,420	0.0028	0.9972	99.49	
15.5	12,079,591		0.0000	1.0000	99.22	
16.5	12,038,671		0.0000	1.0000	99.22	
17.5	11,143,426	300,592	0.0270	0.9730	99.22	
18.5	10,282,634	2,938,234	0.2857	0.7143	96.54	
19.5	7,010,058	226,415	0.0323	0.9677	68.95	
20.5	6,444,285	5,829	0.0009	0.9991	66.73	
21.5	5,590,232		0.0000	1.0000	66.67	
22.5	5,590,232		0.0000	1.0000	66.67	
23.5	5,561,491		0.0000	1.0000	66.67	
24.5	5,306,681		0.0000	1.0000	66.67	
25.5	4,639,083	1,055,413	0.2275	0.7725	66.67	
26.5	3,583,670		0.0000	1.0000	51.50	
27.5	3,583,670		0.0000	1.0000	51.50	
28.5	3,583,670		0.0000	1.0000	51.50	
29.5	3,583,670	2,477	0.0007	0.9993	51.50	
30.5	3,581,192		0.0000	1.0000	51.46	
31.5	3,581,192	3,295,601	0.9203	0.0797	51.46	
32.5	285,591	16,891	0.0591	0.9409	4.10	
33.5	268,700	268,700	1.0000		3.86	
34.5						


MANITOBA HYDRO
ACCOUNT 4000A - UNDERGROUND DUCT AND CONDUIT - CONCRETE
SMOOTH SURVIVOR CURVE

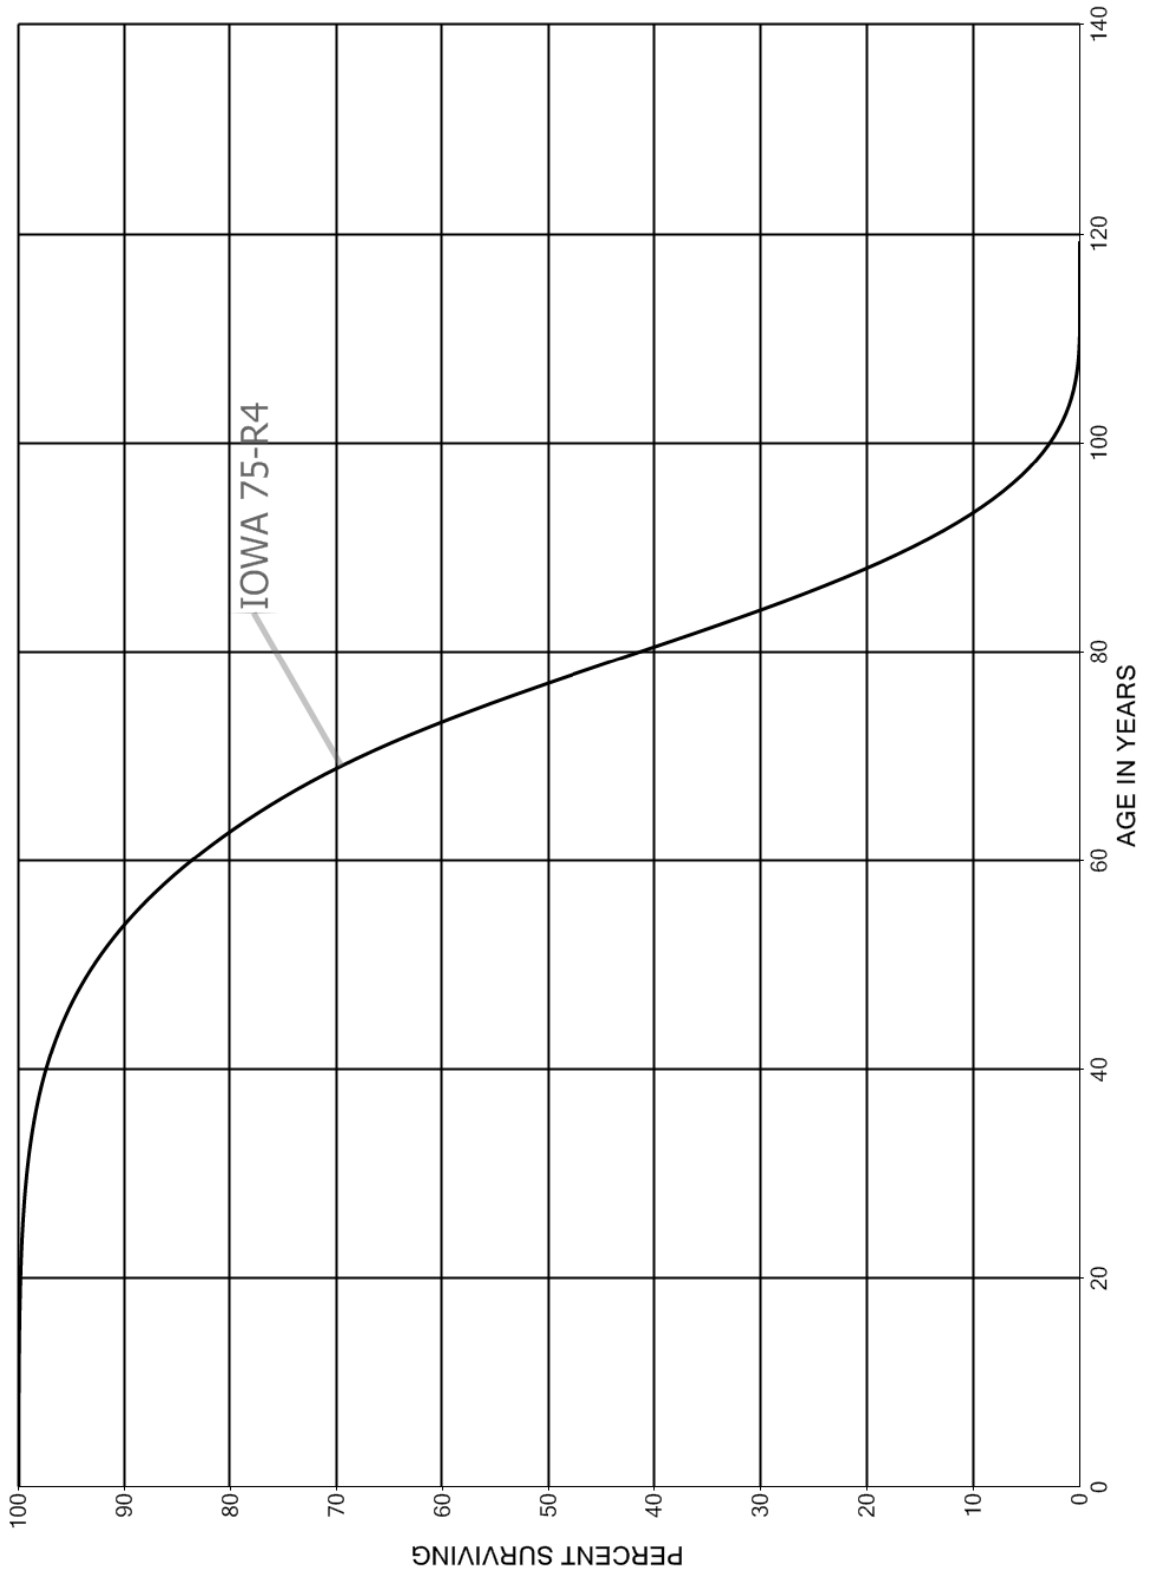

MANITOBA HYDRO
ACCOUNT 4000C - UNDERGROUND DUCT - ROOF
SMOOTH SURVIVOR CURVE

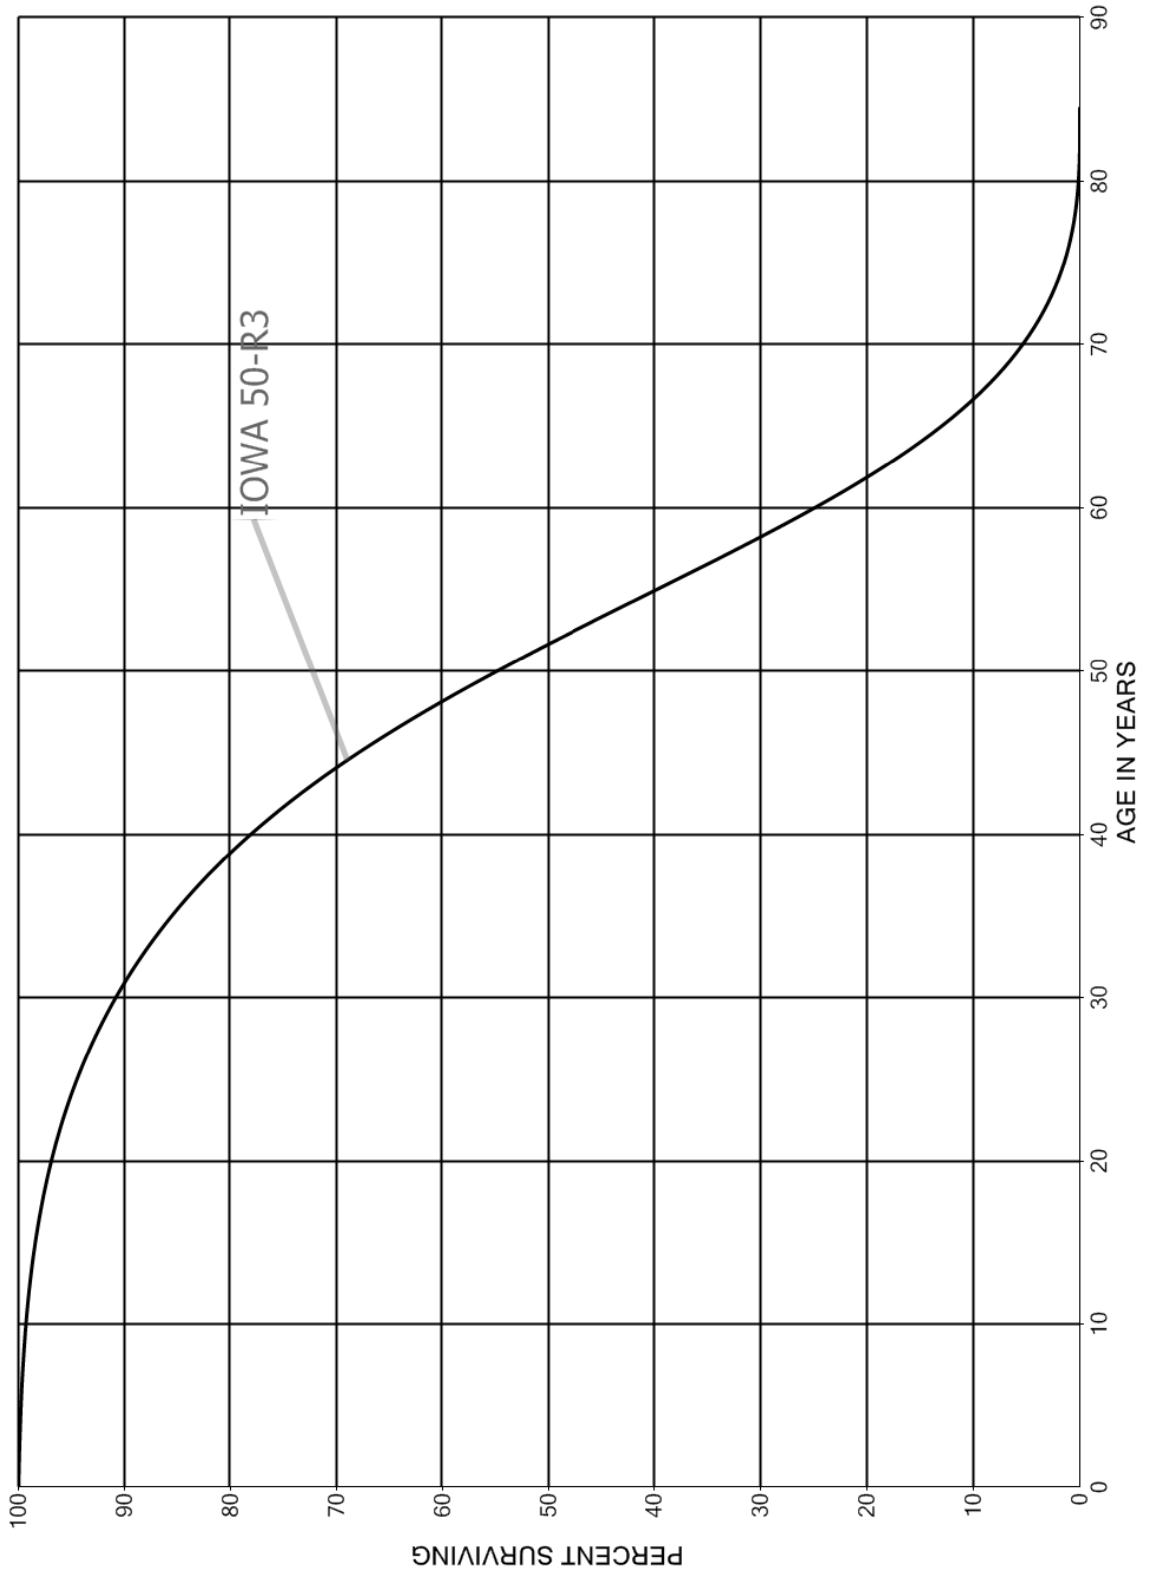

MANITOBA HYDRO
ACCOUNT 4000G - METAL TOWERS
ORIGINAL AND SMOOTH SURVIVOR CURVES

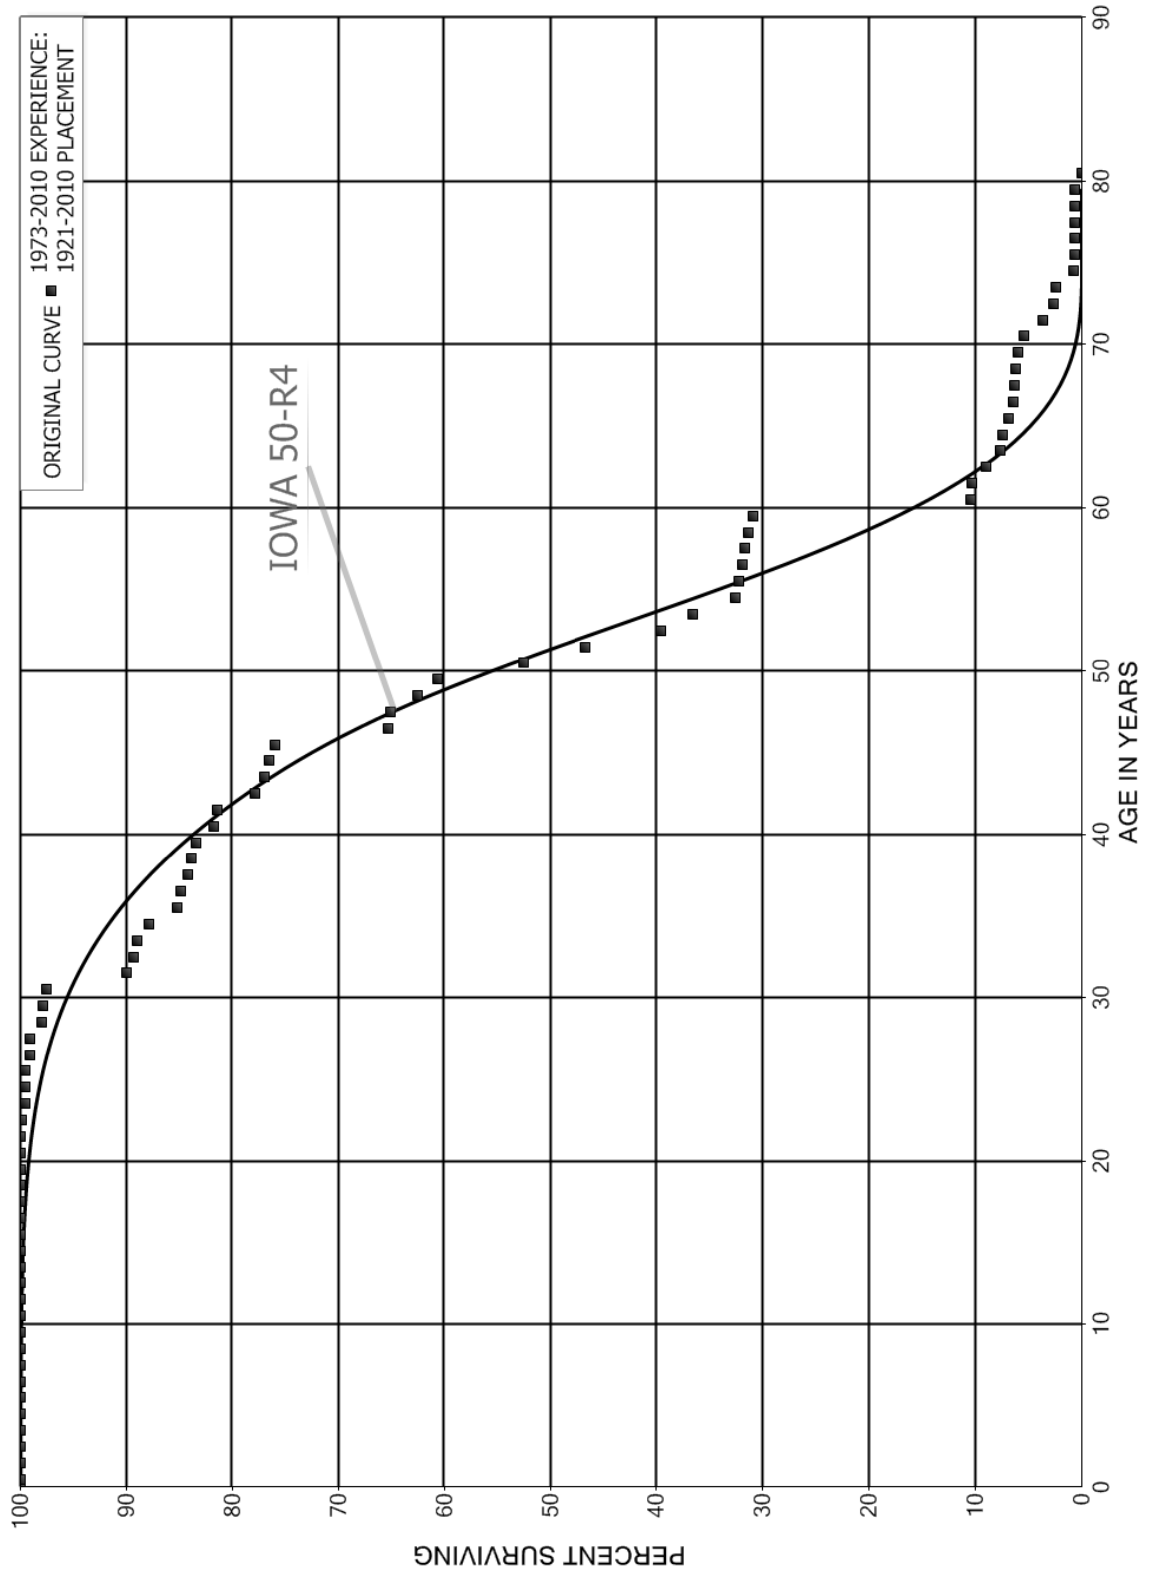

MANITOBA HYDRO

ACCOUNT 4000G - METAL TOWERS

ORIGINAL LIFE TABLE

PLACEMENT BAND 1921-2010			EXPERIENCE BAND 1973-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	4,211,791		0.0000	1.0000	100.00
0.5	4,015,619		0.0000	1.0000	100.00
1.5	4,015,619		0.0000	1.0000	100.00
2.5	4,363,542	0	0.0000	1.0000	100.00
3.5	3,789,940	3	0.0000	1.0000	100.00
4.5	3,763,543	54	0.0000	1.0000	100.00
5.5	3,739,918	0	0.0000	1.0000	100.00
6.5	3,473,723	1	0.0000	1.0000	100.00
7.5	3,464,763	23	0.0000	1.0000	100.00
8.5	2,152,332	134	0.0001	0.9999	100.00
9.5	2,154,356	0	0.0000	1.0000	99.99
10.5	2,097,059	181	0.0001	0.9999	99.99
11.5	2,098,698	3	0.0000	1.0000	99.98
12.5	2,064,053	4	0.0000	1.0000	99.98
13.5	1,869,203	105	0.0001	0.9999	99.98
14.5	587,664	89	0.0002	0.9998	99.98
15.5	592,383	28	0.0000	1.0000	99.96
16.5	593,465	113	0.0002	0.9998	99.96
17.5	687,498	98	0.0001	0.9999	99.94
18.5	688,303	62	0.0001	0.9999	99.92
19.5	706,930	59	0.0001	0.9999	99.91
20.5	717,183	40	0.0001	0.9999	99.91
21.5	763,228	814	0.0011	0.9989	99.90
22.5	796,458	2,145	0.0027	0.9973	99.79
23.5	835,761	226	0.0003	0.9997	99.53
24.5	853,076	316	0.0004	0.9996	99.50
25.5	871,999	3,032	0.0035	0.9965	99.46
26.5	870,123	737	0.0008	0.9992	99.12
27.5	870,994	9,630	0.0111	0.9889	99.03
28.5	861,701	1,051	0.0012	0.9988	97.94
29.5	862,392	2,730	0.0032	0.9968	97.82
30.5	859,951	66,746	0.0776	0.9224	97.51
31.5	911,502	7,128	0.0078	0.9922	89.94
32.5	881,266	2,494	0.0028	0.9972	89.24
33.5	886,347	11,884	0.0134	0.9866	88.98
34.5	882,192	26,756	0.0303	0.9697	87.79
35.5	856,612	2,726	0.0032	0.9968	85.13
36.5	857,690	7,115	0.0083	0.9917	84.86
37.5	801,531	3,116	0.0039	0.9961	84.15
38.5	798,864	4,084	0.0051	0.9949	83.83


MANITOBA HYDRO

ACCOUNT 4000G - METAL TOWERS

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1921-2010			EXPERIENCE BAND 1973-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
39.5	794,816	15,824	0.0199	0.9801	83.40	
40.5	518,556	2,507	0.0048	0.9952	81.74	
41.5	517,271	22,052	0.0426	0.9574	81.34	
42.5	505,843	5,671	0.0112	0.9888	77.87	
43.5	489,715	3,455	0.0071	0.9929	77.00	
44.5	466,666	3,307	0.0071	0.9929	76.46	
45.5	473,109	66,088	0.1397	0.8603	75.92	
46.5	395,398	1,239	0.0031	0.9969	65.31	
47.5	393,261	15,823	0.0402	0.9598	65.11	
48.5	374,730	11,343	0.0303	0.9697	62.49	
49.5	362,635	48,713	0.1343	0.8657	60.60	
50.5	313,153	34,935	0.1116	0.8884	52.46	
51.5	265,976	40,760	0.1532	0.8468	46.60	
52.5	224,707	16,738	0.0745	0.9255	39.46	
53.5	206,344	22,711	0.1101	0.8899	36.52	
54.5	183,313	1,550	0.0085	0.9915	32.50	
55.5	159,686	1,896	0.0119	0.9881	32.23	
56.5	157,630	1,074	0.0068	0.9932	31.85	
57.5	154,380	1,595	0.0103	0.9897	31.63	
58.5	152,467	2,467	0.0162	0.9838	31.30	
59.5	150,000	99,511	0.6634	0.3366	30.79	
60.5	50,489	623	0.0123	0.9877	10.37	
61.5	49,866	6,243	0.1252	0.8748	10.24	
62.5	43,624	6,356	0.1457	0.8543	8.96	
63.5	37,268	1,028	0.0276	0.9724	7.65	
64.5	36,240	3,070	0.0847	0.9153	7.44	
65.5	33,170	2,251	0.0679	0.9321	6.81	
66.5	30,919	343	0.0111	0.9889	6.35	
67.5	30,576	320	0.0105	0.9895	6.28	
68.5	30,256	1,155	0.0382	0.9618	6.21	
69.5	29,101	2,896	0.0995	0.9005	5.97	
70.5	26,205	8,474	0.3234	0.6766	5.38	
71.5	17,731	4,856	0.2739	0.7261	3.64	
72.5	12,875	1,311	0.1019	0.8981	2.64	
73.5	11,563	8,140	0.7040	0.2960	2.37	
74.5	3,423	273	0.0797	0.9203	0.70	
75.5	3,150	176	0.0560	0.9440	0.65	
76.5	2,974	5	0.0018	0.9982	0.61	
77.5	2,969	77	0.0261	0.9739	0.61	
78.5	2,891	158	0.0547	0.9453	0.59	
79.5	2,733	2,733	1.0000		0.56	
80.5						

MANITOBA HYDRO
ACCOUNT 4000J - POLES AND FIXTURES
ORIGINAL AND SMOOTH SURVIVOR CURVES

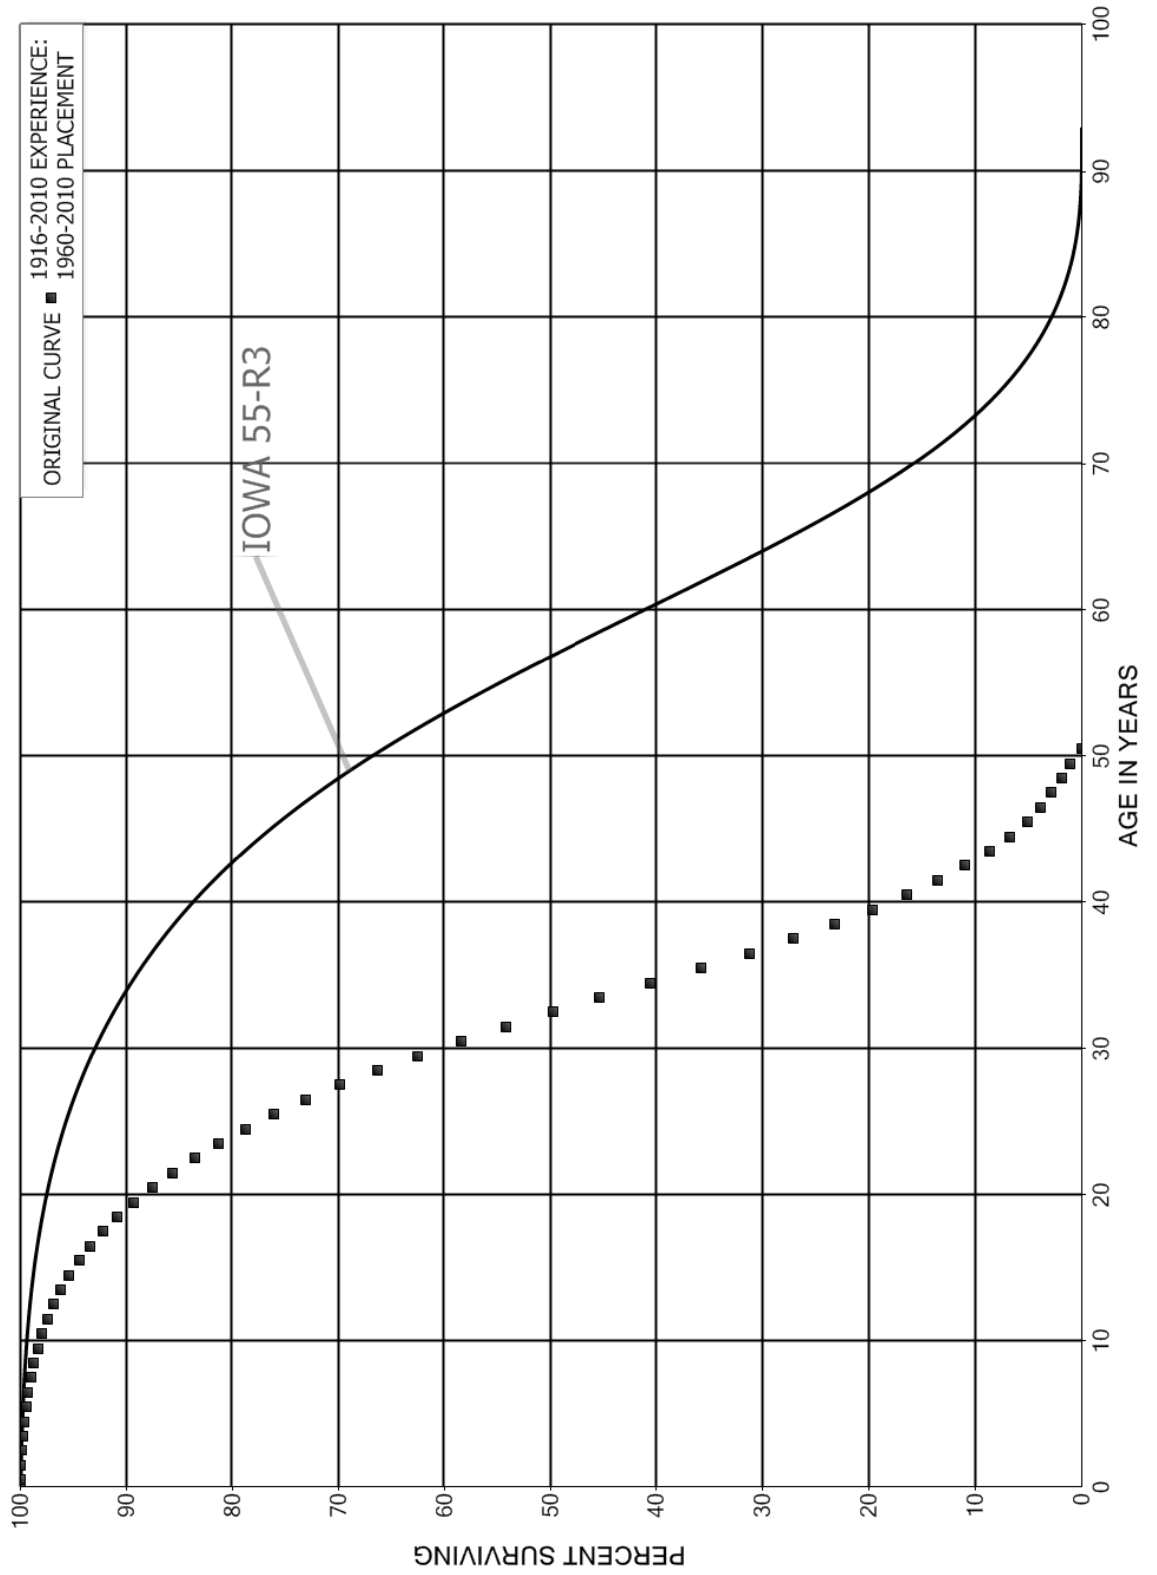

MANITOBA HYDRO

ACCOUNT 4000J - POLES AND FIXTURES

ORIGINAL LIFE TABLE

PLACEMENT BAND 1960-2010			EXPERIENCE BAND 1916-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
0.0	640,302,274	161,906	0.0003	0.9997	100.00	
0.5	609,761,195	375,907	0.0006	0.9994	99.97	
1.5	576,567,933	462,125	0.0008	0.9992	99.91	
2.5	548,125,828	563,046	0.0010	0.9990	99.83	
3.5	522,264,045	669,927	0.0013	0.9987	99.73	
4.5	496,987,564	793,823	0.0016	0.9984	99.60	
5.5	469,904,027	927,817	0.0020	0.9980	99.44	
6.5	440,102,196	1,066,411	0.0024	0.9976	99.25	
7.5	393,251,723	1,165,684	0.0030	0.9970	99.01	
8.5	370,972,791	1,324,158	0.0036	0.9964	98.71	
9.5	349,527,336	1,501,496	0.0043	0.9957	98.36	
10.5	324,397,893	1,647,860	0.0051	0.9949	97.94	
11.5	292,467,078	1,772,685	0.0061	0.9939	97.44	
12.5	262,987,600	1,876,403	0.0071	0.9929	96.85	
13.5	242,899,446	2,008,133	0.0083	0.9917	96.16	
14.5	217,749,581	2,111,967	0.0097	0.9903	95.36	
15.5	199,746,647	2,233,780	0.0112	0.9888	94.44	
16.5	181,525,566	2,308,134	0.0127	0.9873	93.38	
17.5	164,385,453	2,422,722	0.0147	0.9853	92.20	
18.5	147,210,072	2,550,206	0.0173	0.9827	90.84	
19.5	135,706,010	2,629,010	0.0194	0.9806	89.26	
20.5	126,090,036	2,729,219	0.0216	0.9784	87.53	
21.5	114,969,094	2,782,703	0.0242	0.9758	85.64	
22.5	104,461,117	2,849,021	0.0273	0.9727	83.57	
23.5	94,584,155	2,918,701	0.0309	0.9691	81.29	
24.5	84,216,420	2,920,508	0.0347	0.9653	78.78	
25.5	74,340,118	2,922,194	0.0393	0.9607	76.05	
26.5	65,411,749	2,917,845	0.0446	0.9554	73.06	
27.5	56,105,577	2,833,015	0.0505	0.9495	69.80	
28.5	48,391,317	2,774,021	0.0573	0.9427	66.27	
29.5	41,311,092	2,669,644	0.0646	0.9354	62.48	
30.5	34,483,495	2,530,869	0.0734	0.9266	58.44	
31.5	28,796,064	2,333,014	0.0810	0.9190	54.15	
32.5	23,740,269	2,127,395	0.0896	0.9104	49.76	
33.5	17,645,785	1,853,768	0.1051	0.8949	45.30	
34.5	12,807,327	1,523,847	0.1190	0.8810	40.54	
35.5	9,296,076	1,181,665	0.1271	0.8729	35.72	
36.5	6,828,335	890,887	0.1305	0.8695	31.18	
37.5	5,067,957	728,380	0.1437	0.8563	27.11	
38.5	3,663,916	564,738	0.1541	0.8459	23.21	


MANITOBA HYDRO

ACCOUNT 4000J - POLES AND FIXTURES

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1960-2010			EXPERIENCE BAND 1916-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
39.5	2,631,352	437,363	0.1662	0.8338	19.64
40.5	1,858,717	330,611	0.1779	0.8221	16.37
41.5	1,274,391	240,883	0.1890	0.8110	13.46
42.5	846,515	174,642	0.2063	0.7937	10.92
43.5	555,136	125,899	0.2268	0.7732	8.66
44.5	348,467	83,727	0.2403	0.7597	6.70
45.5	202,143	50,808	0.2513	0.7487	5.09
46.5	110,860	28,075	0.2532	0.7468	3.81
47.5	59,795	20,340	0.3402	0.6598	2.85
48.5	21,103	9,296	0.4405	0.5595	1.88
49.5	1,439	1,439	1.0000		1.05
50.5					

MANITOBA HYDRO
ACCOUNT 4000L - OVERHEAD CONDUCTOR AND DEVICES
ORIGINAL AND SMOOTH SURVIVOR CURVES

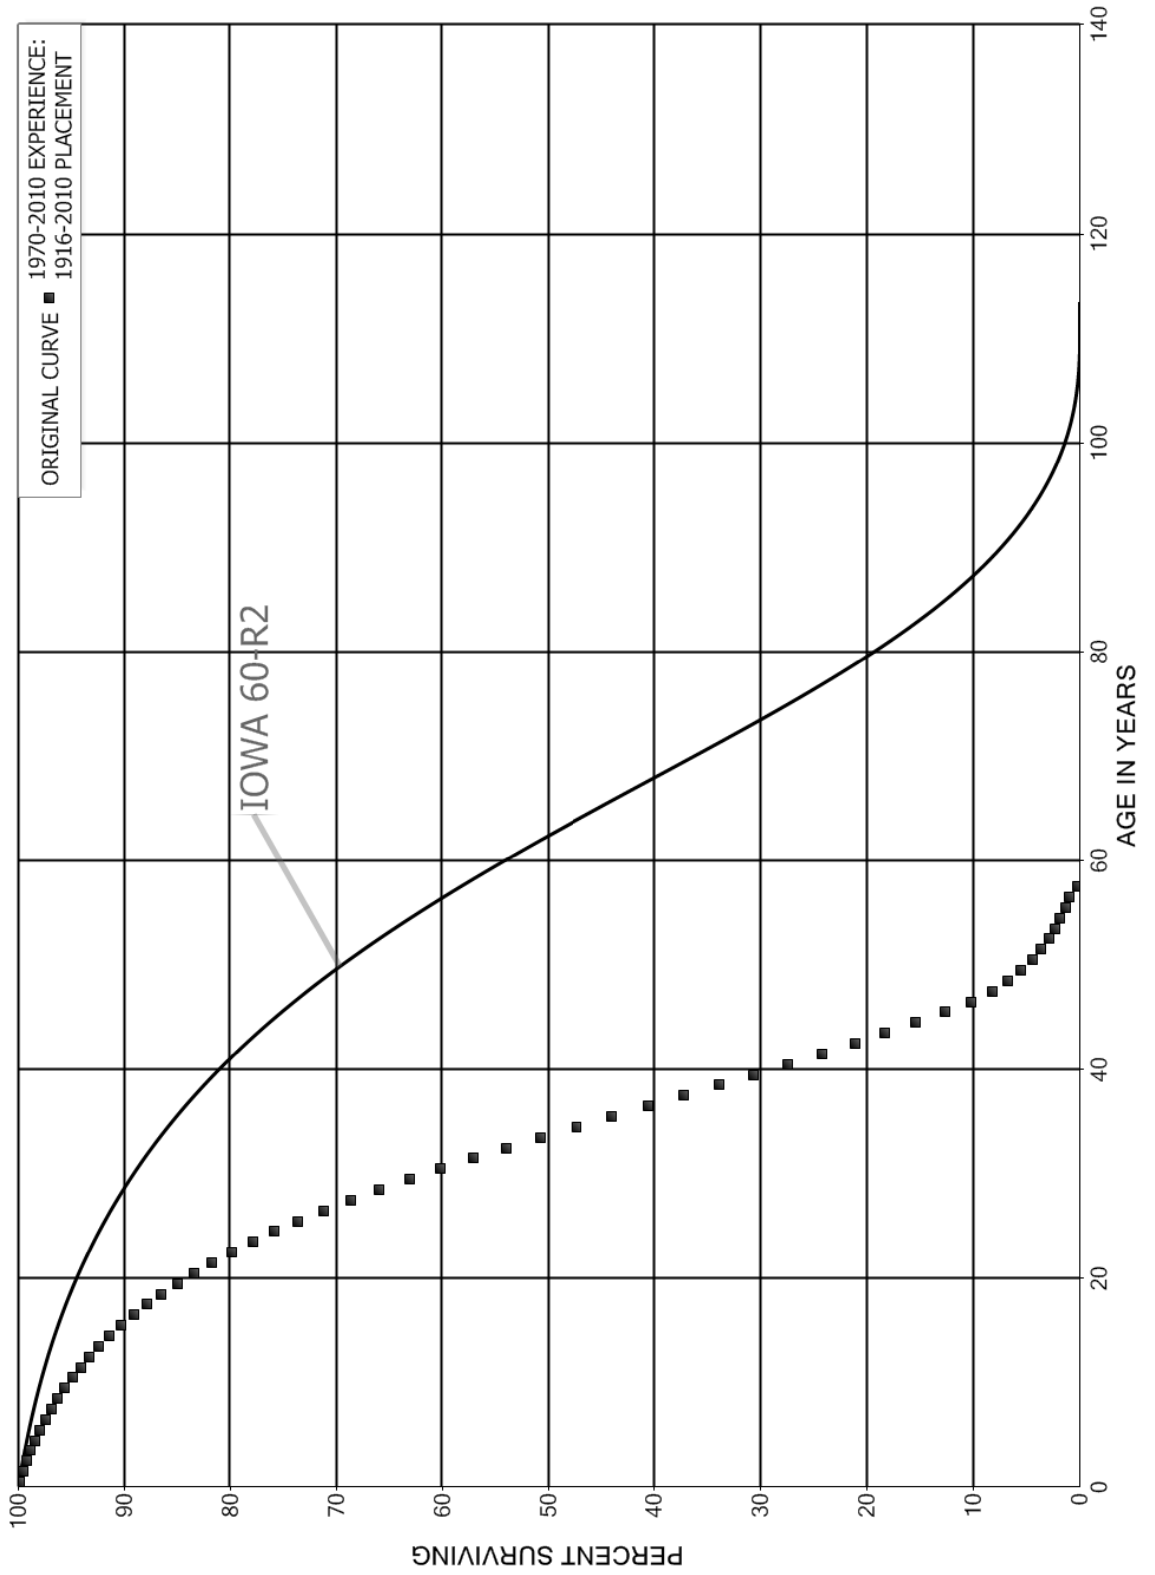

MANITOBA HYDRO

ACCOUNT 4000L - OVERHEAD CONDUCTOR AND DEVICES

ORIGINAL LIFE TABLE

PLACEMENT BAND 1916-2010			EXPERIENCE BAND 1970-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	680,302,669	999,865	0.0015	0.9985	100.00
0.5	649,714,090	2,052,258	0.0032	0.9968	99.85
1.5	614,887,051	2,158,731	0.0035	0.9965	99.54
2.5	585,242,617	2,278,794	0.0039	0.9961	99.19
3.5	557,871,658	2,367,474	0.0042	0.9958	98.80
4.5	530,779,166	2,486,640	0.0047	0.9953	98.38
5.5	501,441,421	2,586,868	0.0052	0.9948	97.92
6.5	468,959,768	2,664,137	0.0057	0.9943	97.42
7.5	421,532,147	2,631,021	0.0062	0.9938	96.86
8.5	398,451,287	2,715,963	0.0068	0.9932	96.26
9.5	375,811,202	2,805,286	0.0075	0.9925	95.60
10.5	349,050,733	2,842,387	0.0081	0.9919	94.89
11.5	314,737,182	2,835,785	0.0090	0.9910	94.12
12.5	283,518,795	2,814,215	0.0099	0.9901	93.27
13.5	262,393,569	2,832,006	0.0108	0.9892	92.34
14.5	237,667,918	2,814,991	0.0118	0.9882	91.35
15.5	220,132,761	2,853,354	0.0130	0.9870	90.26
16.5	203,846,819	2,890,540	0.0142	0.9858	89.09
17.5	186,412,988	2,901,064	0.0156	0.9844	87.83
18.5	169,282,392	2,916,231	0.0172	0.9828	86.46
19.5	156,372,680	2,930,161	0.0187	0.9813	84.97
20.5	145,502,171	2,984,642	0.0205	0.9795	83.38
21.5	132,848,949	2,981,806	0.0224	0.9776	81.67
22.5	121,510,131	2,982,564	0.0245	0.9755	79.84
23.5	110,702,841	2,966,113	0.0268	0.9732	77.88
24.5	100,232,486	2,938,146	0.0293	0.9707	75.79
25.5	89,576,170	2,890,848	0.0323	0.9677	73.57
26.5	80,005,396	2,840,953	0.0355	0.9645	71.20
27.5	70,632,502	2,773,334	0.0393	0.9607	68.67
28.5	62,788,727	2,731,227	0.0435	0.9565	65.97
29.5	55,911,792	2,638,335	0.0472	0.9528	63.10
30.5	49,313,544	2,525,359	0.0512	0.9488	60.12
31.5	43,398,386	2,365,921	0.0545	0.9455	57.05
32.5	37,674,627	2,248,758	0.0597	0.9403	53.94
33.5	31,541,675	2,111,691	0.0669	0.9331	50.72
34.5	26,308,363	1,892,165	0.0719	0.9281	47.32
35.5	22,033,182	1,691,048	0.0768	0.9232	43.92
36.5	18,437,918	1,545,495	0.0838	0.9162	40.55
37.5	15,565,308	1,389,209	0.0893	0.9107	37.15
38.5	13,106,740	1,251,677	0.0955	0.9045	33.83


MANITOBA HYDRO

ACCOUNT 4000L - OVERHEAD CONDUCTOR AND DEVICES

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1916-2010			EXPERIENCE BAND 1970-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
39.5	11,082,936	1,167,122	0.1053	0.8947	30.60
40.5	9,202,728	1,095,223	0.1190	0.8810	27.38
41.5	7,554,361	949,743	0.1257	0.8743	24.12
42.5	6,226,544	843,551	0.1355	0.8645	21.09
43.5	4,882,498	753,402	0.1543	0.8457	18.23
44.5	3,734,952	678,595	0.1817	0.8183	15.42
45.5	2,720,057	527,442	0.1939	0.8061	12.62
46.5	1,973,992	380,724	0.1929	0.8071	10.17
47.5	1,441,361	262,389	0.1820	0.8180	8.21
48.5	992,105	182,838	0.1843	0.8157	6.71
49.5	628,310	119,039	0.1895	0.8105	5.48
50.5	399,939	74,582	0.1865	0.8135	4.44
51.5	250,630	50,224	0.2004	0.7996	3.61
52.5	151,751	29,767	0.1962	0.8038	2.89
53.5	115,716	24,568	0.2123	0.7877	2.32
54.5	71,656	22,598	0.3154	0.6846	1.83
55.5	25,216	6,979	0.2768	0.7232	1.25
56.5	4,990	3,959	0.7933	0.2067	0.91
57.5					0.19

MANITOBA HYDRO
ACCOUNT 4000M - UNDERGROUND CABLE AND DEVICES - 66 KV
ORIGINAL AND SMOOTH SURVIVOR CURVES

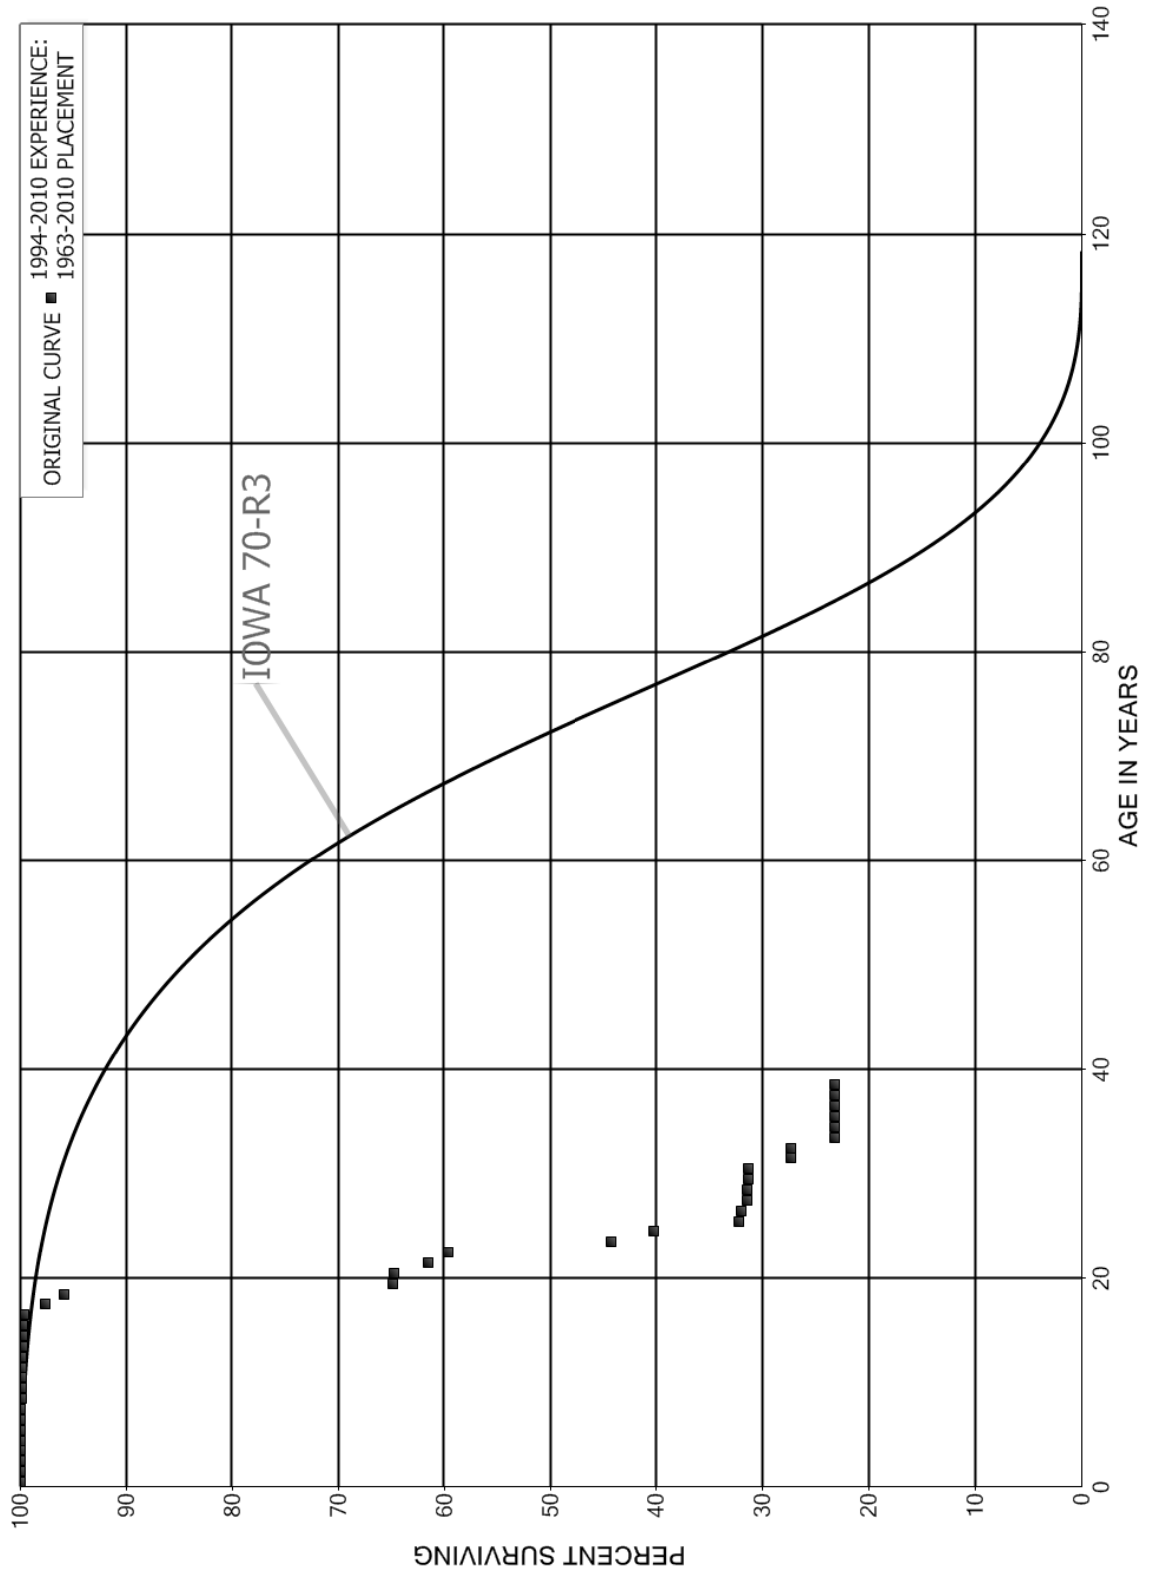


MANITOBA HYDRO

ACCOUNT 4000M - UNDERGROUND CABLE AND DEVICES - 66 KV

ORIGINAL LIFE TABLE

PLACEMENT BAND 1963-2010			EXPERIENCE BAND 1994-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
0.0	18,959,677	257	0.0000	1.0000	100.00	
0.5	19,248,950	6,555	0.0003	0.9997	100.00	
1.5	18,879,075	1,127	0.0001	0.9999	99.96	
2.5	18,610,960	3,906	0.0002	0.9998	99.96	
3.5	12,711,693	180	0.0000	1.0000	99.94	
4.5	12,646,550	358	0.0000	1.0000	99.94	
5.5	12,411,977	2,862	0.0002	0.9998	99.93	
6.5	12,090,509	515	0.0000	1.0000	99.91	
7.5	2,098,088	674	0.0003	0.9997	99.91	
8.5	2,090,799	199	0.0001	0.9999	99.87	
9.5	2,090,600	16	0.0000	1.0000	99.86	
10.5	2,090,583	1,177	0.0006	0.9994	99.86	
11.5	2,088,155	147	0.0001	0.9999	99.81	
12.5	630,094	289	0.0005	0.9995	99.80	
13.5	454,121	15	0.0000	1.0000	99.75	
14.5	414,257	14	0.0000	1.0000	99.75	
15.5	424,376	604	0.0014	0.9986	99.75	
16.5	668,172	13,205	0.0198	0.9802	99.61	
17.5	295,463	5,373	0.0182	0.9818	97.64	
18.5	266,964	86,425	0.3237	0.6763	95.86	
19.5	156,546	200	0.0013	0.9987	64.83	
20.5	267,793	13,420	0.0501	0.9499	64.75	
21.5	279,788	8,372	0.0299	0.9701	61.50	
22.5	322,562	83,931	0.2602	0.7398	59.66	
23.5	235,072	21,192	0.0901	0.9099	44.14	
24.5	213,880	42,309	0.1978	0.8022	40.16	
25.5	171,571	1,283	0.0075	0.9925	32.21	
26.5	170,288	3,326	0.0195	0.9805	31.97	
27.5	166,962	40	0.0002	0.9998	31.35	
28.5	166,922	204	0.0012	0.9988	31.34	
29.5	166,718	0	0.0000	1.0000	31.30	
30.5	222,382	28,215	0.1269	0.8731	31.30	
31.5	194,166	639	0.0033	0.9967	27.33	
32.5	185,055	27,676	0.1496	0.8504	27.24	
33.5	21,450	2	0.0001	0.9999	23.17	
34.5	21,221		0.0000	1.0000	23.16	
35.5	21,221		0.0000	1.0000	23.16	
36.5	21,221		0.0000	1.0000	23.16	
37.5	800		0.0000	1.0000	23.16	
38.5					23.16	

MANITOBA HYDRO
ACCOUNT 4000N - UNDERGROUND CABLE AND DEVICES - PRIMARY
ORIGINAL AND SMOOTH SURVIVOR CURVES

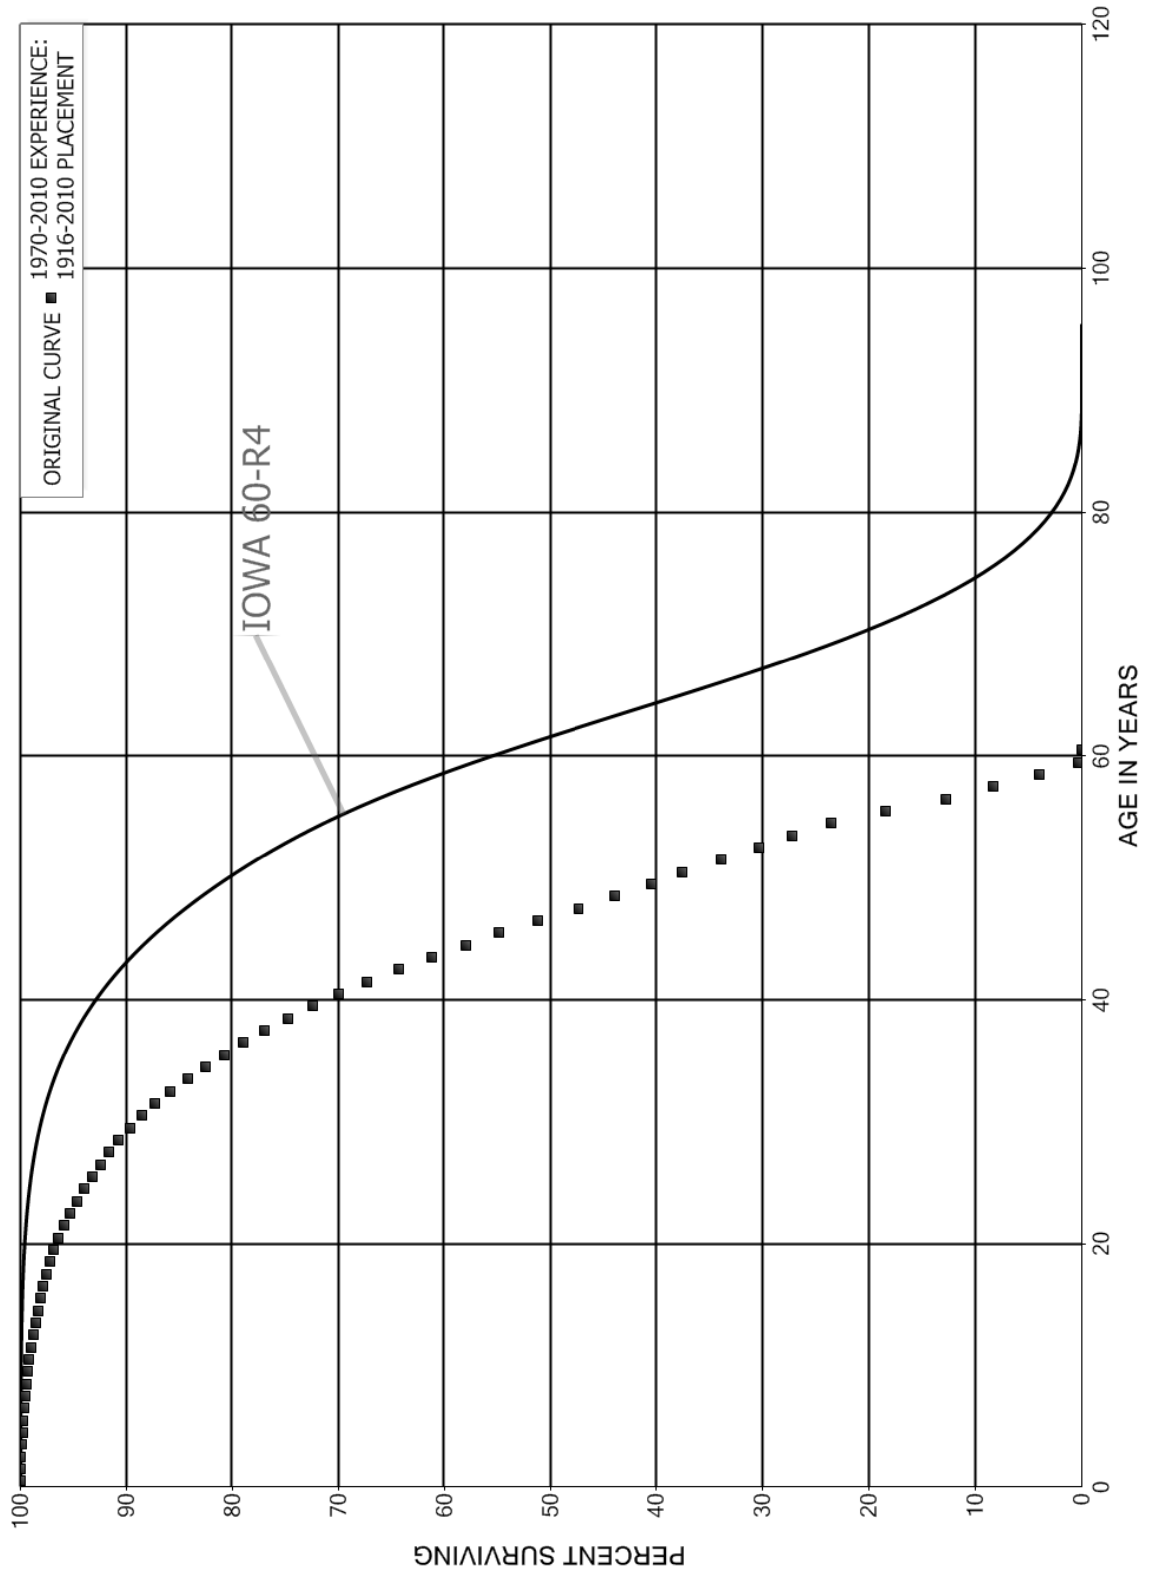

MANITOBA HYDRO

ACCOUNT 4000N - UNDERGROUND CABLE AND DEVICES - PRIMARY

ORIGINAL LIFE TABLE

PLACEMENT BAND 1916-2010			EXPERIENCE BAND 1970-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	261,179,152	44,001	0.0002	0.9998	100.00
0.5	243,178,672	95,067	0.0004	0.9996	99.98
1.5	219,352,629	100,281	0.0005	0.9995	99.94
2.5	202,201,044	109,465	0.0005	0.9995	99.90
3.5	189,673,296	123,481	0.0007	0.9993	99.84
4.5	176,048,635	131,884	0.0007	0.9993	99.78
5.5	161,977,709	137,105	0.0008	0.9992	99.70
6.5	151,885,552	150,814	0.0010	0.9990	99.62
7.5	144,131,695	163,967	0.0011	0.9989	99.52
8.5	136,712,041	180,998	0.0013	0.9987	99.41
9.5	127,306,860	191,677	0.0015	0.9985	99.28
10.5	114,600,744	196,133	0.0017	0.9983	99.13
11.5	103,434,835	203,391	0.0020	0.9980	98.96
12.5	96,578,995	217,796	0.0023	0.9977	98.76
13.5	88,315,517	206,678	0.0023	0.9977	98.54
14.5	83,365,304	199,353	0.0024	0.9976	98.31
15.5	76,244,407	205,988	0.0027	0.9973	98.07
16.5	71,370,963	213,185	0.0030	0.9970	97.81
17.5	68,034,972	231,541	0.0034	0.9966	97.52
18.5	64,606,441	255,073	0.0039	0.9961	97.19
19.5	60,030,451	281,626	0.0047	0.9953	96.80
20.5	54,082,815	297,649	0.0055	0.9945	96.35
21.5	50,364,746	304,149	0.0060	0.9940	95.82
22.5	39,913,998	264,083	0.0066	0.9934	95.24
23.5	32,984,936	242,581	0.0074	0.9926	94.61
24.5	30,925,877	242,919	0.0079	0.9921	93.91
25.5	27,793,456	226,850	0.0082	0.9918	93.17
26.5	26,372,233	231,039	0.0088	0.9912	92.41
27.5	24,307,693	246,897	0.0102	0.9898	91.60
28.5	22,968,865	259,334	0.0113	0.9887	90.67
29.5	20,893,256	269,812	0.0129	0.9871	89.65
30.5	18,080,223	256,861	0.0142	0.9858	88.49
31.5	15,360,683	252,533	0.0164	0.9836	87.24
32.5	12,281,068	227,968	0.0186	0.9814	85.80
33.5	9,682,902	194,763	0.0201	0.9799	84.21
34.5	6,509,614	138,576	0.0213	0.9787	82.52
35.5	4,993,397	114,879	0.0230	0.9770	80.76
36.5	3,792,709	94,320	0.0249	0.9751	78.90
37.5	2,917,326	83,664	0.0287	0.9713	76.94
38.5	2,238,578	70,429	0.0315	0.9685	74.73


MANITOBA HYDRO

ACCOUNT 4000N - UNDERGROUND CABLE AND DEVICES - PRIMARY

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1916-2010			EXPERIENCE BAND 1970-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
39.5	1,632,986	55,013	0.0337	0.9663	72.38	
40.5	1,249,769	47,780	0.0382	0.9618	69.94	
41.5	989,683	44,158	0.0446	0.9554	67.27	
42.5	655,588	31,655	0.0483	0.9517	64.27	
43.5	384,285	20,523	0.0534	0.9466	61.16	
44.5	225,684	11,916	0.0528	0.9472	57.90	
45.5	133,475	8,958	0.0671	0.9329	54.84	
46.5	103,447	7,794	0.0753	0.9247	51.16	
47.5	92,428	6,681	0.0723	0.9277	47.31	
48.5	20,345	1,623	0.0798	0.9202	43.89	
49.5	17,300	1,253	0.0725	0.9275	40.38	
50.5	14,663	1,429	0.0975	0.9025	37.46	
51.5	12,182	1,252	0.1027	0.8973	33.81	
52.5	10,175	1,072	0.1054	0.8946	30.33	
53.5	6,654	883	0.1327	0.8673	27.14	
54.5	5,417	1,192	0.2201	0.7799	23.54	
55.5	3,606	1,104	0.3063	0.6937	18.36	
56.5	2,143	756	0.3526	0.6474	12.73	
57.5	1,130	593	0.5249	0.4751	8.24	
58.5	377	351	0.9299	0.0701	3.92	
59.5	6	6	1.0000		0.27	
60.5						

MANITOBA HYDRO
ACCOUNT 4000P - UNDERGROUND CABLE AND DEVICES - SECONDARY
ORIGINAL AND SMOOTH SURVIVOR CURVES

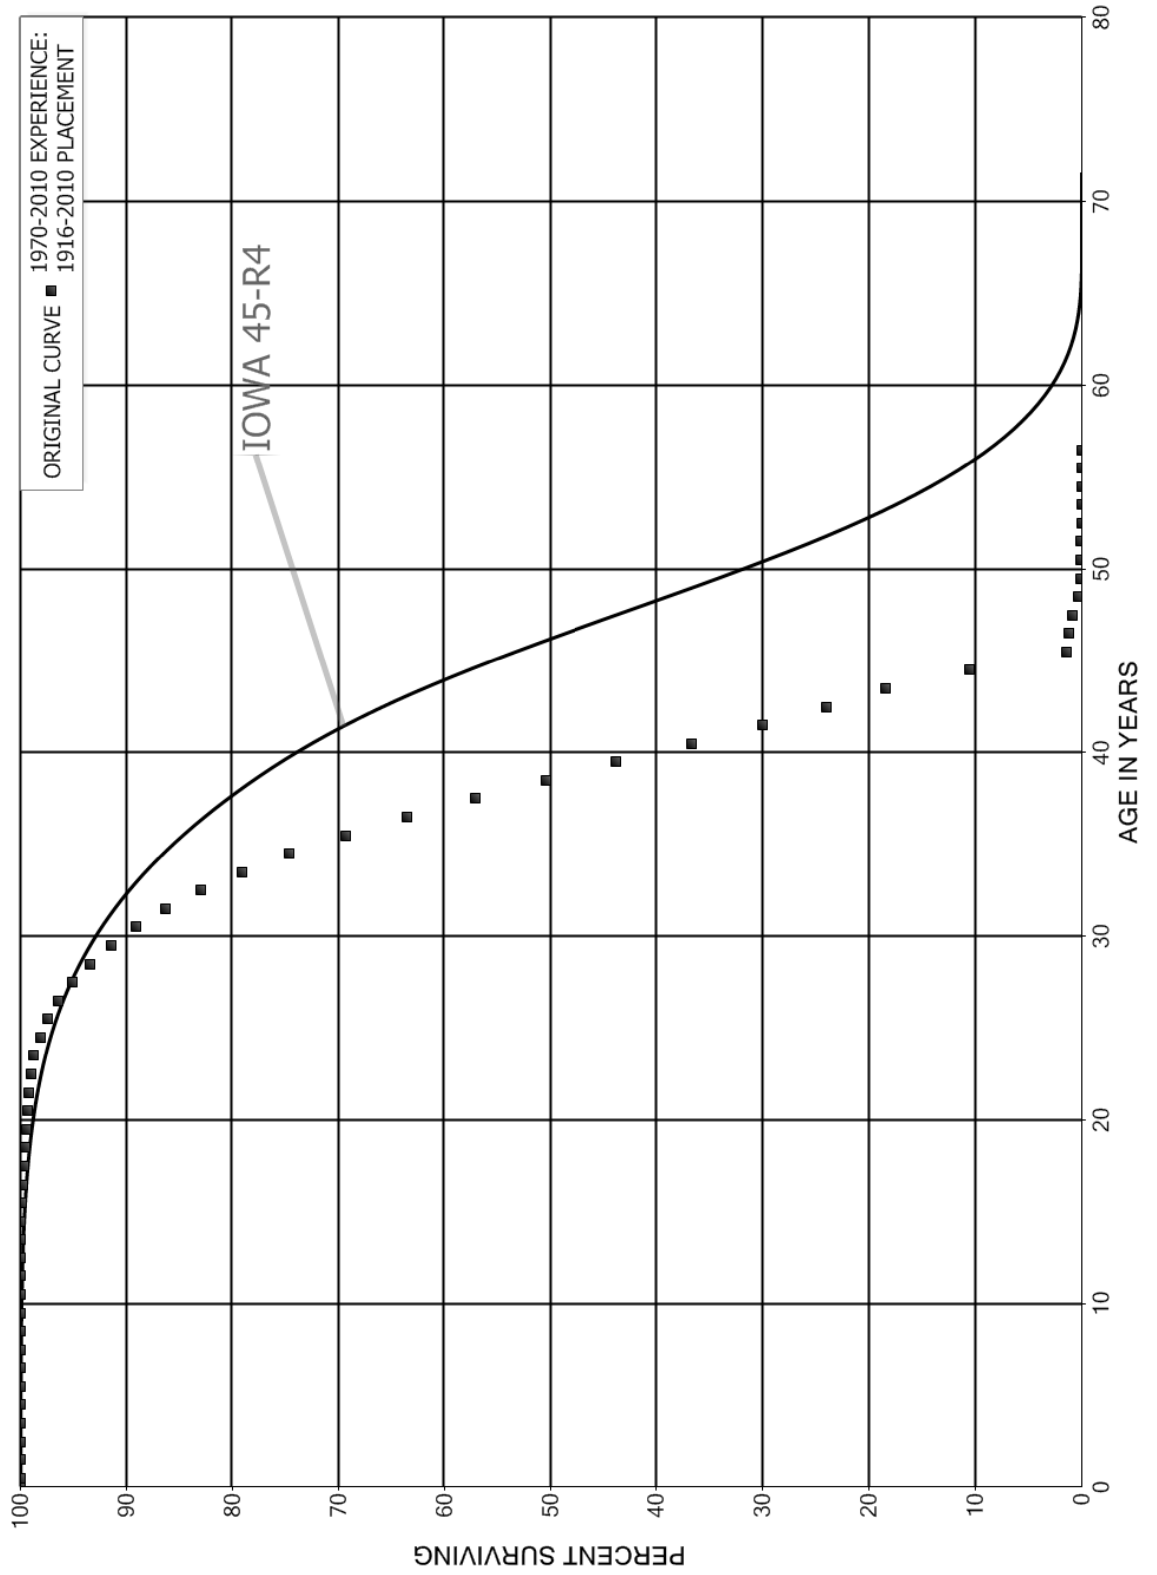

MANITOBA HYDRO

ACCOUNT 4000P - UNDERGROUND CABLE AND DEVICES - SECONDARY

ORIGINAL LIFE TABLE

PLACEMENT BAND 1916-2010			EXPERIENCE BAND 1970-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	196,894,665		0.0000	1.0000	100.00
0.5	182,163,616		0.0000	1.0000	100.00
1.5	162,683,357		0.0000	1.0000	100.00
2.5	148,671,534		0.0000	1.0000	100.00
3.5	138,466,497		0.0000	1.0000	100.00
4.5	127,377,363		0.0000	1.0000	100.00
5.5	115,932,815		0.0000	1.0000	100.00
6.5	107,754,795		0.0000	1.0000	100.00
7.5	101,485,667	1	0.0000	1.0000	100.00
8.5	96,370,037	27	0.0000	1.0000	100.00
9.5	89,857,589	253	0.0000	1.0000	100.00
10.5	81,007,673	1,373	0.0000	1.0000	100.00
11.5	73,234,846	4,730	0.0001	0.9999	100.00
12.5	68,507,555	13,374	0.0002	0.9998	99.99
13.5	62,769,778	29,453	0.0005	0.9995	99.97
14.5	59,356,736	42,392	0.0007	0.9993	99.93
15.5	54,363,029	48,433	0.0009	0.9991	99.85
16.5	50,965,317	53,367	0.0010	0.9990	99.76
17.5	48,663,528	51,999	0.0011	0.9989	99.66
18.5	46,300,971	50,549	0.0011	0.9989	99.55
19.5	43,114,230	48,919	0.0011	0.9989	99.45
20.5	38,933,907	57,565	0.0015	0.9985	99.33
21.5	36,369,627	69,171	0.0019	0.9981	99.19
22.5	28,822,119	92,594	0.0032	0.9968	99.00
23.5	23,787,100	135,127	0.0057	0.9943	98.68
24.5	22,296,009	174,233	0.0078	0.9922	98.12
25.5	19,949,688	205,166	0.0103	0.9897	97.35
26.5	18,840,185	247,124	0.0131	0.9869	96.35
27.5	17,195,129	303,852	0.0177	0.9823	95.09
28.5	16,053,803	341,697	0.0213	0.9787	93.41
29.5	14,314,512	376,628	0.0263	0.9737	91.42
30.5	11,984,300	369,096	0.0308	0.9692	89.01
31.5	9,741,101	379,384	0.0389	0.9611	86.27
32.5	7,256,770	337,357	0.0465	0.9535	82.91
33.5	5,223,556	290,442	0.0556	0.9444	79.06
34.5	2,930,754	209,079	0.0713	0.9287	74.66
35.5	1,878,422	159,241	0.0848	0.9152	69.33
36.5	1,135,339	114,984	0.1013	0.8987	63.46
37.5	666,829	77,872	0.1168	0.8832	57.03
38.5	373,593	49,663	0.1329	0.8671	50.37


MANITOBA HYDRO

ACCOUNT 4000P - UNDERGROUND CABLE AND DEVICES - SECONDARY


ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1916-2010			EXPERIENCE BAND 1970-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
39.5	177,441	28,712	0.1618	0.8382	43.67	
40.5	85,334	15,459	0.1812	0.8188	36.61	
41.5	43,373	8,713	0.2009	0.7991	29.98	
42.5	14,078	3,279	0.2329	0.7671	23.95	
43.5	2,072	887	0.4282	0.5718	18.38	
44.5	502	434	0.8651	0.1349	10.51	
45.5	239	45	0.1896	0.8104	1.42	
46.5	402	104	0.2593	0.7407	1.15	
47.5	323	196	0.6064	0.3936	0.85	
48.5	144	116	0.8059	0.1941	0.33	
49.5	40	21	0.5210	0.4790	0.07	
50.5	29	15	0.5009	0.4991	0.03	
51.5	22	11	0.5072	0.4928	0.02	
52.5	19	9	0.4602	0.5398	0.01	
53.5	456	8	0.0178	0.9822	0.00	
54.5	448	346	0.7719	0.2281	0.00	
55.5	102	102	1.0000		0.00	
56.5						


MANITOBA HYDRO
ACCOUNT 4000Q - SERIALIZED EQUIPMENT - OVERHEAD
SMOOTH SURVIVOR CURVE

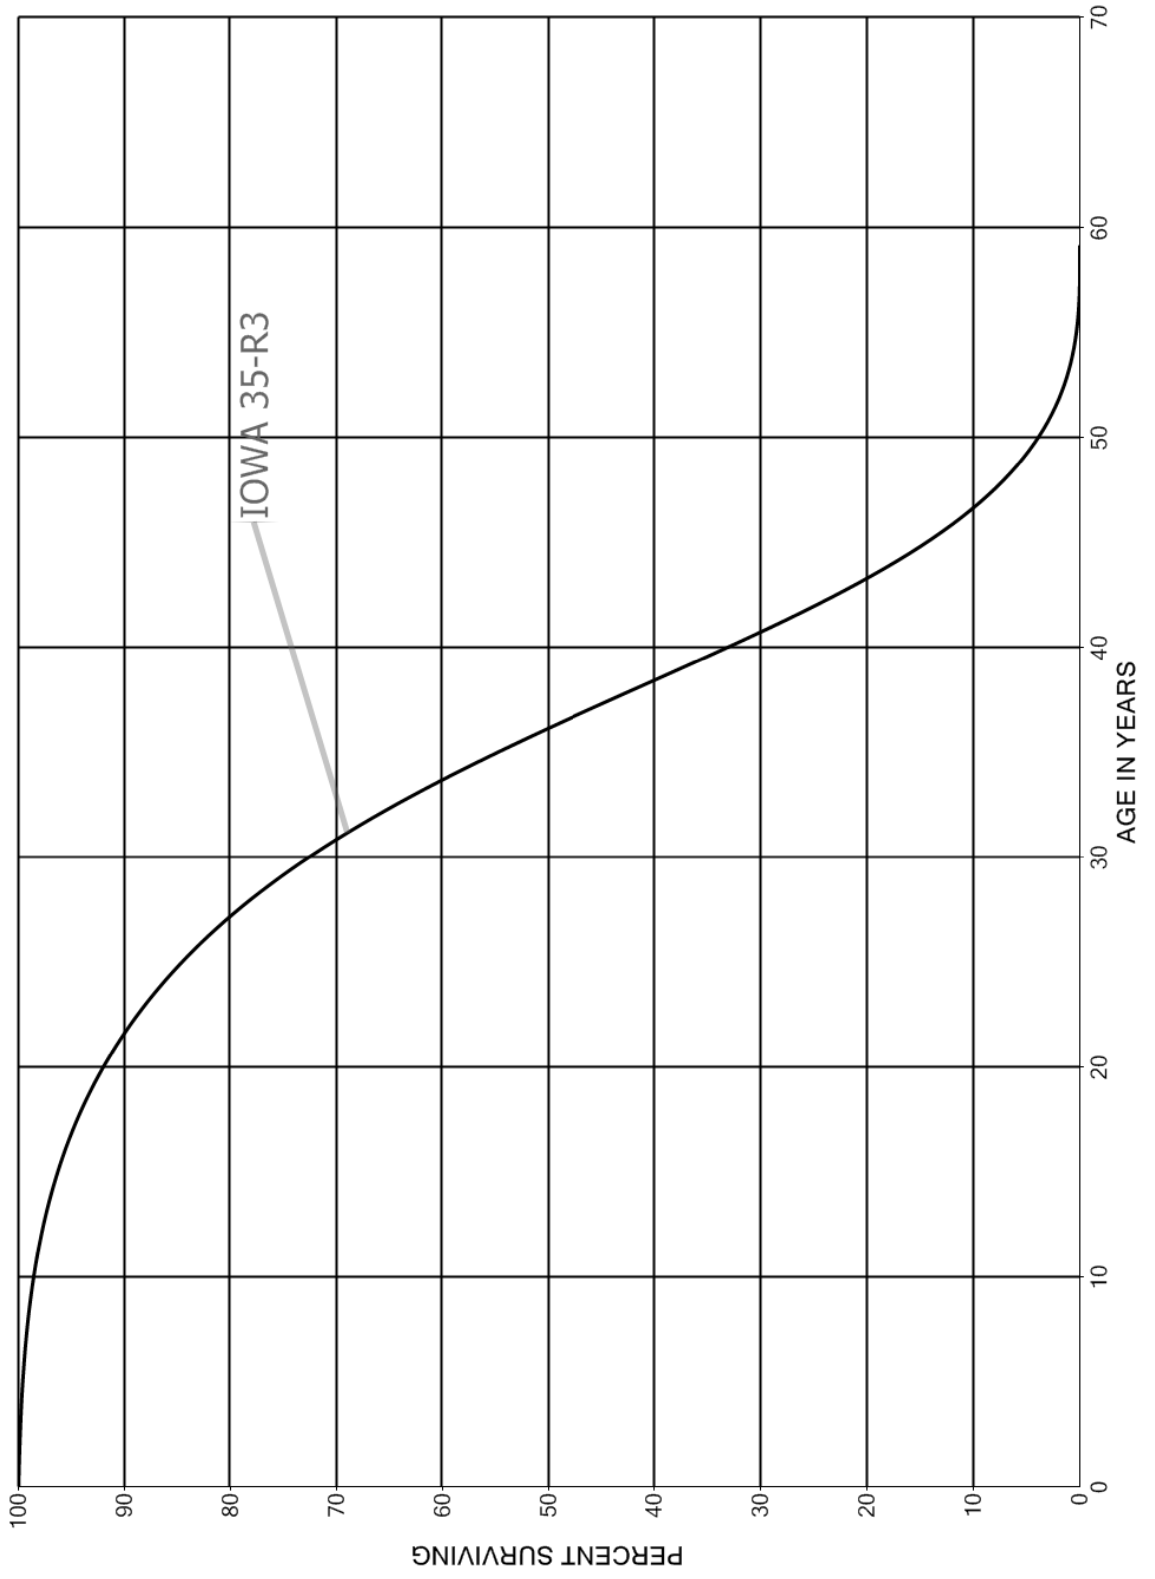


MANITOBA HYDRO
ACCOUNT 4000R - DSC - HIGH VOLTAGE TRANSFORMERS
SMOOTH SURVIVOR CURVE

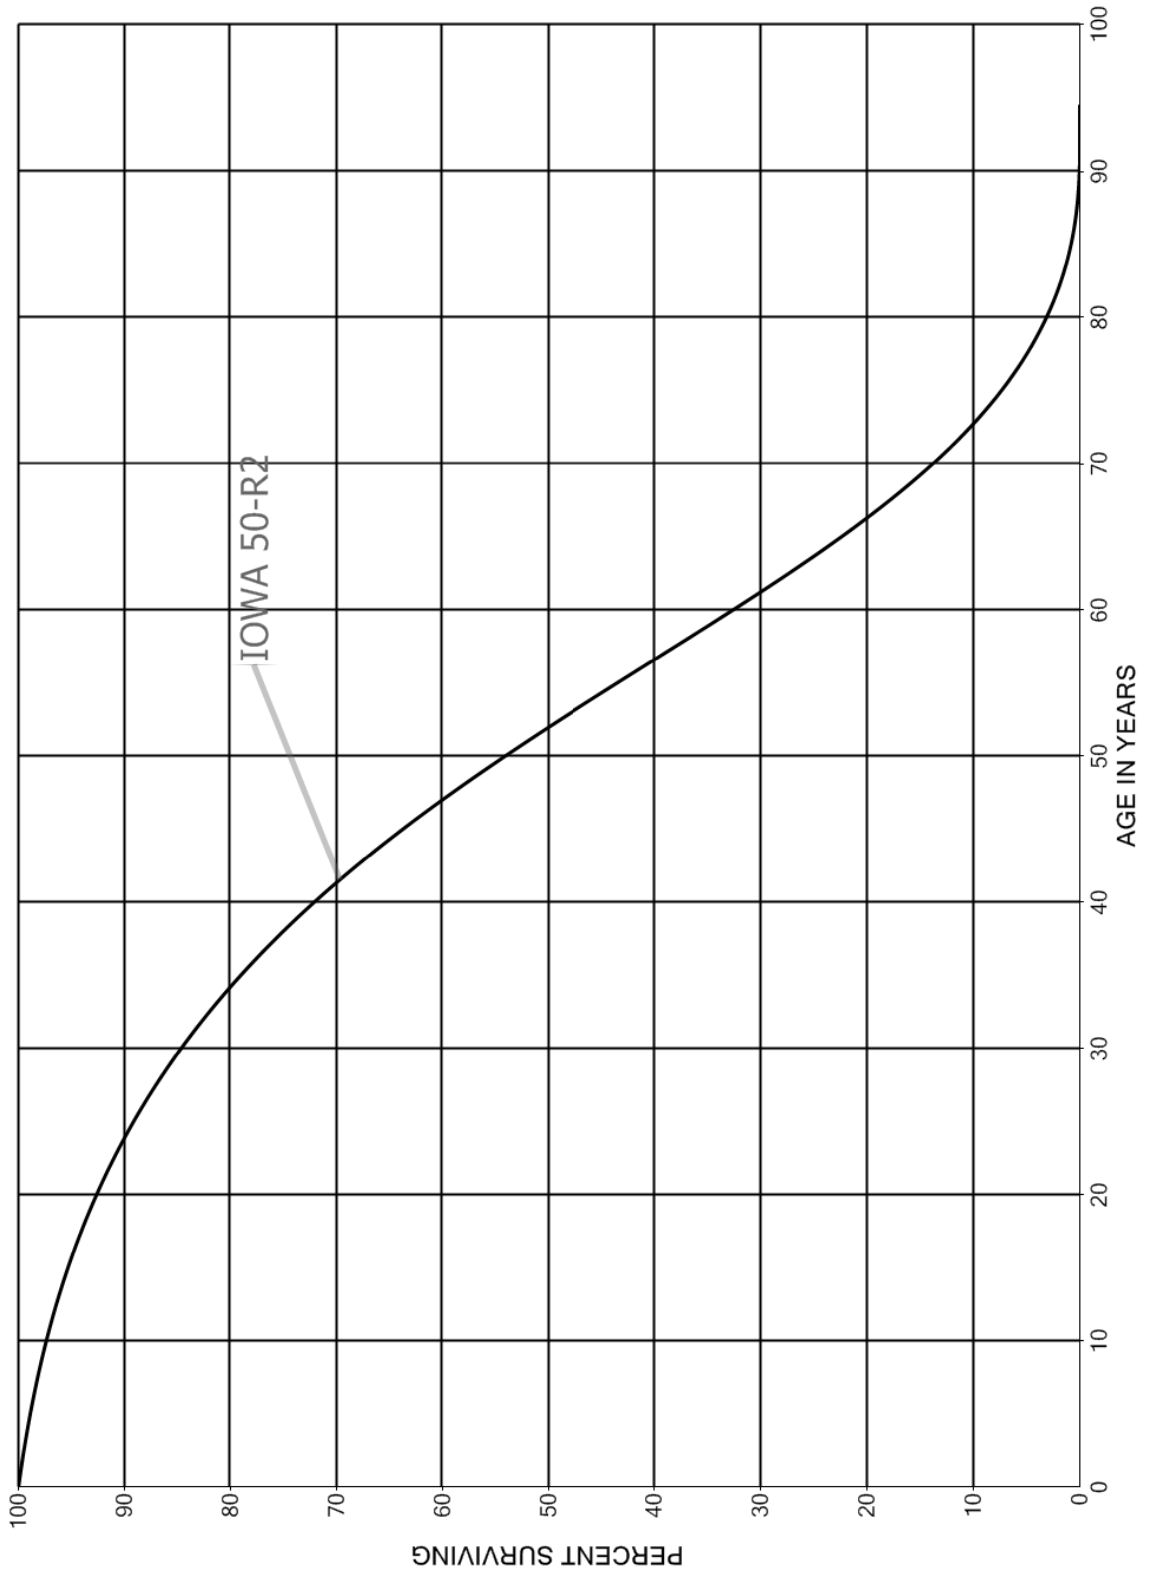

MANITOBA HYDRO
ACCOUNT 4000S - SERIALIZED EQUIPMENT - UNDERGROUND
SMOOTH SURVIVOR CURVE

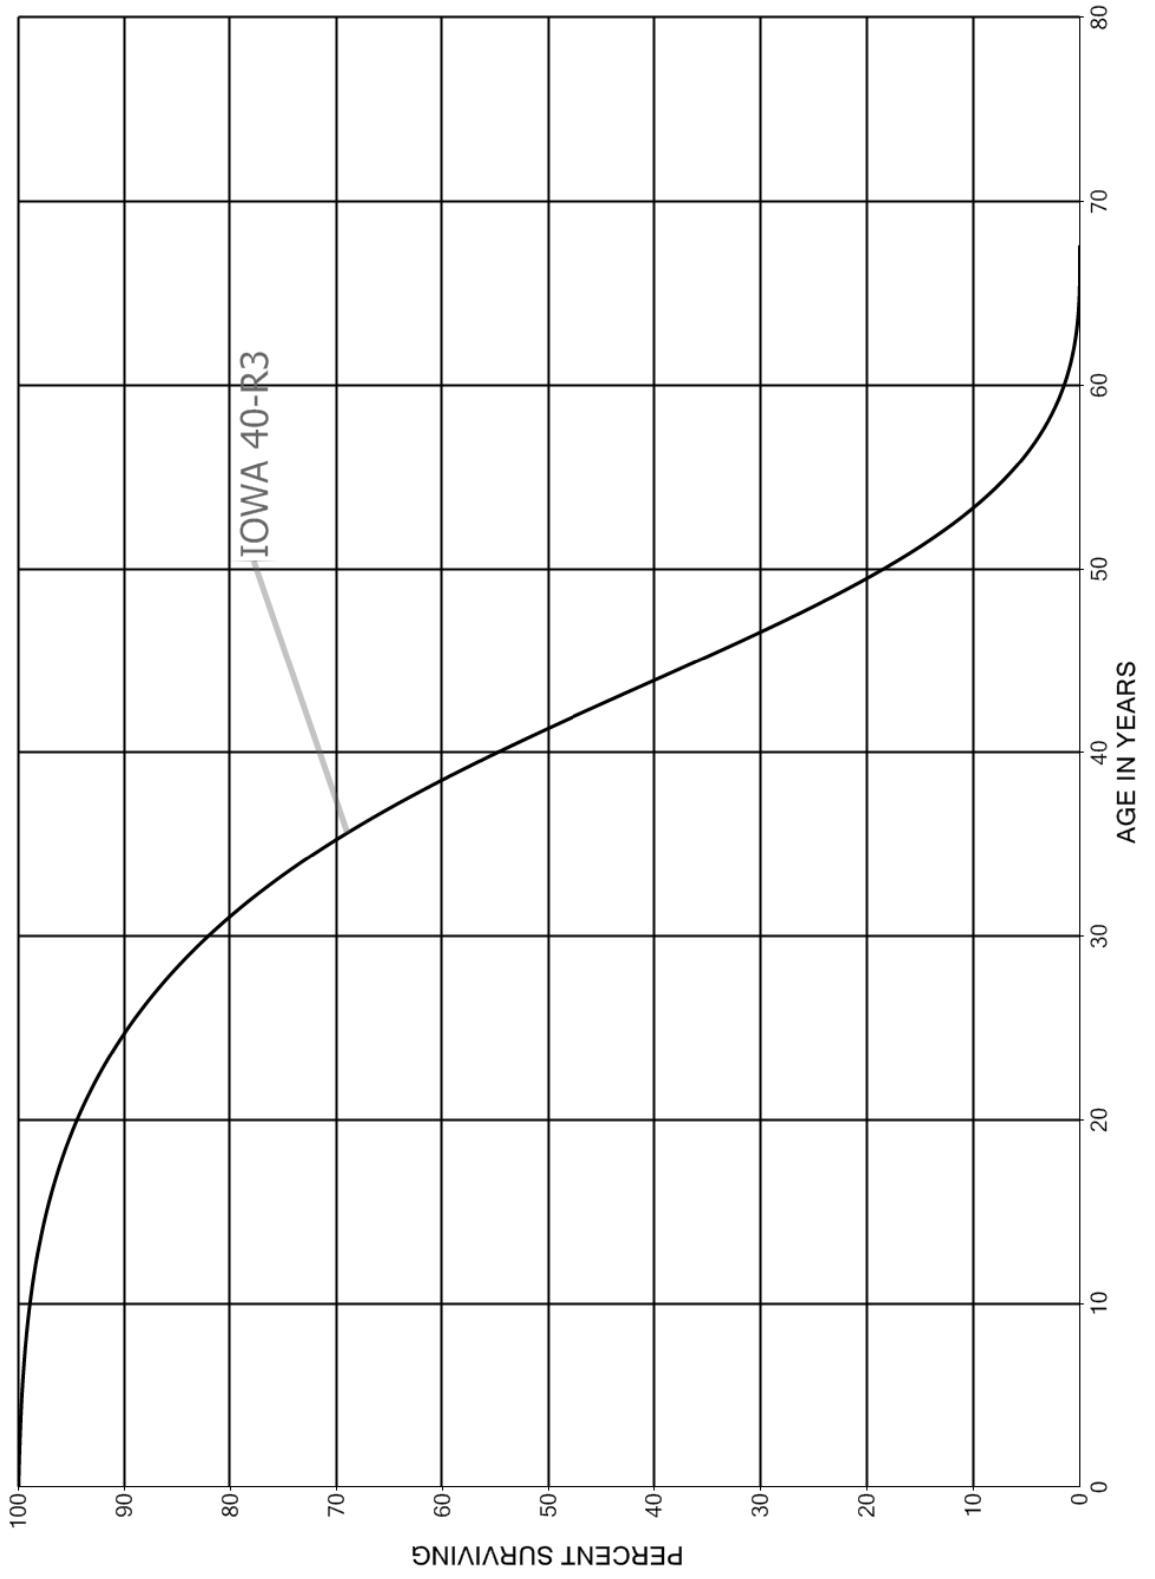

MANITOBA HYDRO
ACCOUNT 4000W - SERVICES
ORIGINAL AND SMOOTH SURVIVOR CURVES

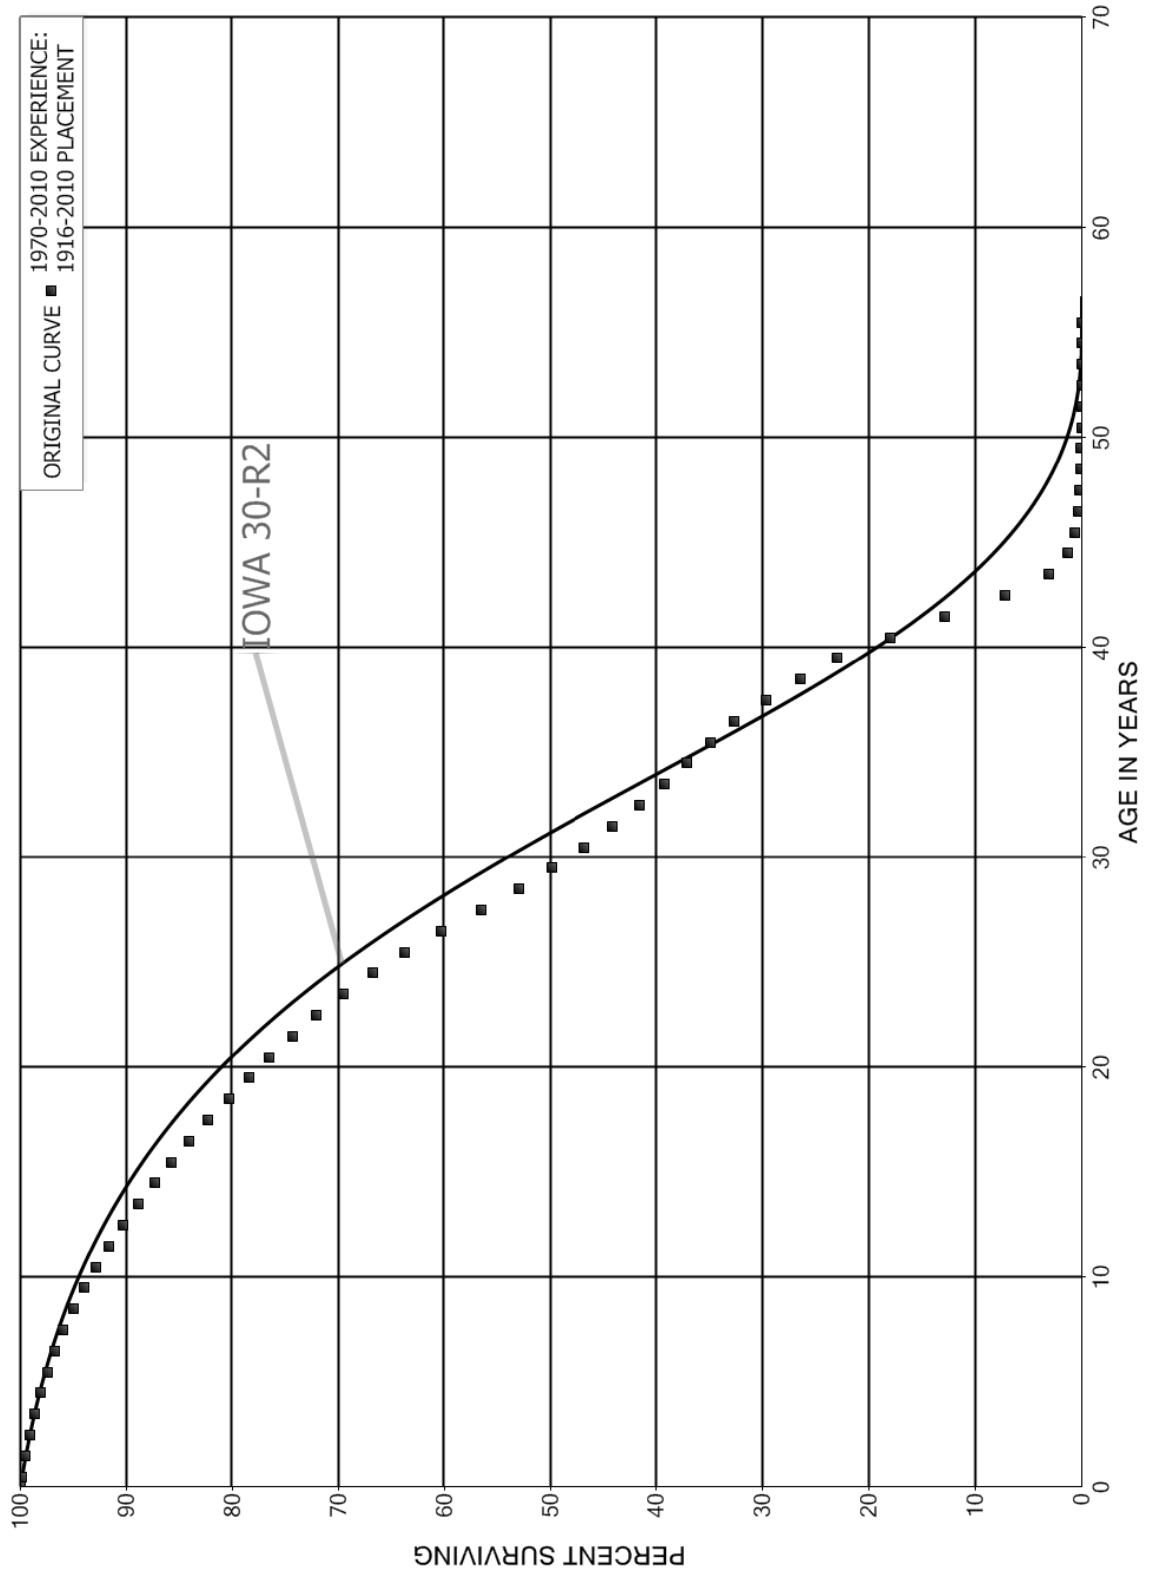

MANITOBA HYDRO

ACCOUNT 4000W - SERVICES

ORIGINAL LIFE TABLE

PLACEMENT BAND 1916-2010			EXPERIENCE BAND 1970-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
0.0	138,256,722	228,461	0.0017	0.9983	100.00	
0.5	132,536,278	477,950	0.0036	0.9964	99.83	
1.5	125,673,301	516,897	0.0041	0.9959	99.47	
2.5	118,730,288	563,602	0.0047	0.9953	99.07	
3.5	112,190,538	625,639	0.0056	0.9944	98.60	
4.5	105,025,762	668,755	0.0064	0.9936	98.05	
5.5	97,580,964	705,660	0.0072	0.9928	97.42	
6.5	87,297,082	716,055	0.0082	0.9918	96.72	
7.5	79,276,348	761,006	0.0096	0.9904	95.92	
8.5	70,840,781	763,080	0.0108	0.9892	95.00	
9.5	65,526,451	803,748	0.0123	0.9877	93.98	
10.5	59,882,049	791,897	0.0132	0.9868	92.83	
11.5	54,975,574	784,769	0.0143	0.9857	91.60	
12.5	50,110,813	808,414	0.0161	0.9839	90.29	
13.5	47,278,116	805,058	0.0170	0.9830	88.83	
14.5	43,770,336	798,221	0.0182	0.9818	87.32	
15.5	40,341,728	797,777	0.0198	0.9802	85.73	
16.5	36,765,092	785,094	0.0214	0.9786	84.03	
17.5	33,691,770	781,922	0.0232	0.9768	82.24	
18.5	30,302,150	729,540	0.0241	0.9759	80.33	
19.5	26,573,876	634,353	0.0239	0.9761	78.40	
20.5	23,771,537	706,208	0.0297	0.9703	76.53	
21.5	22,868,209	656,762	0.0287	0.9713	74.25	
22.5	18,824,832	685,851	0.0364	0.9636	72.12	
23.5	16,037,590	628,519	0.0392	0.9608	69.49	
24.5	12,385,528	574,378	0.0464	0.9536	66.77	
25.5	9,808,330	520,555	0.0531	0.9469	63.67	
26.5	7,729,937	483,399	0.0625	0.9375	60.29	
27.5	6,144,077	386,641	0.0629	0.9371	56.52	
28.5	4,728,299	282,449	0.0597	0.9403	52.97	
29.5	3,684,764	225,294	0.0611	0.9389	49.80	
30.5	2,918,070	169,800	0.0582	0.9418	46.76	
31.5	2,202,685	128,182	0.0582	0.9418	44.04	
32.5	1,589,917	88,754	0.0558	0.9442	41.47	
33.5	1,058,550	56,238	0.0531	0.9469	39.16	
34.5	673,723	40,811	0.0606	0.9394	37.08	
35.5	423,894	26,575	0.0627	0.9373	34.83	
36.5	248,865	23,251	0.0934	0.9066	32.65	
37.5	156,332	16,843	0.1077	0.8923	29.60	
38.5	92,899	12,201	0.1313	0.8687	26.41	


MANITOBA HYDRO

ACCOUNT 4000W - SERVICES

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1916-2010			EXPERIENCE BAND 1970-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
39.5	63,435	13,780	0.2172	0.7828	22.94	
40.5	49,210	13,909	0.2826	0.7174	17.96	
41.5	33,620	14,794	0.4400	0.5600	12.88	
42.5	20,791	11,930	0.5738	0.4262	7.21	
43.5	13,001	7,451	0.5732	0.4268	3.07	
44.5	10,103	5,329	0.5275	0.4725	1.31	
45.5	8,877	5,010	0.5644	0.4356	0.62	
46.5	8,061	4,124	0.5116	0.4884	0.27	
47.5	6,276	4,090	0.6517	0.3483	0.13	
48.5	3,621	2,286	0.6312	0.3688	0.05	
49.5	2,164	1,397	0.6455	0.3545	0.02	
50.5	892	777	0.8709	0.1291	0.01	
51.5	318	132	0.4152	0.5848	0.00	
52.5	229	190	0.8287	0.1713	0.00	
53.5	2,482	271	0.1091	0.8909	0.00	
54.5	2,211	2,211	1.0000		0.00	
55.5						

MANITOBA HYDRO
ACCOUNT 4000X - STREET LIGHTING
ORIGINAL AND SMOOTH SURVIVOR CURVES

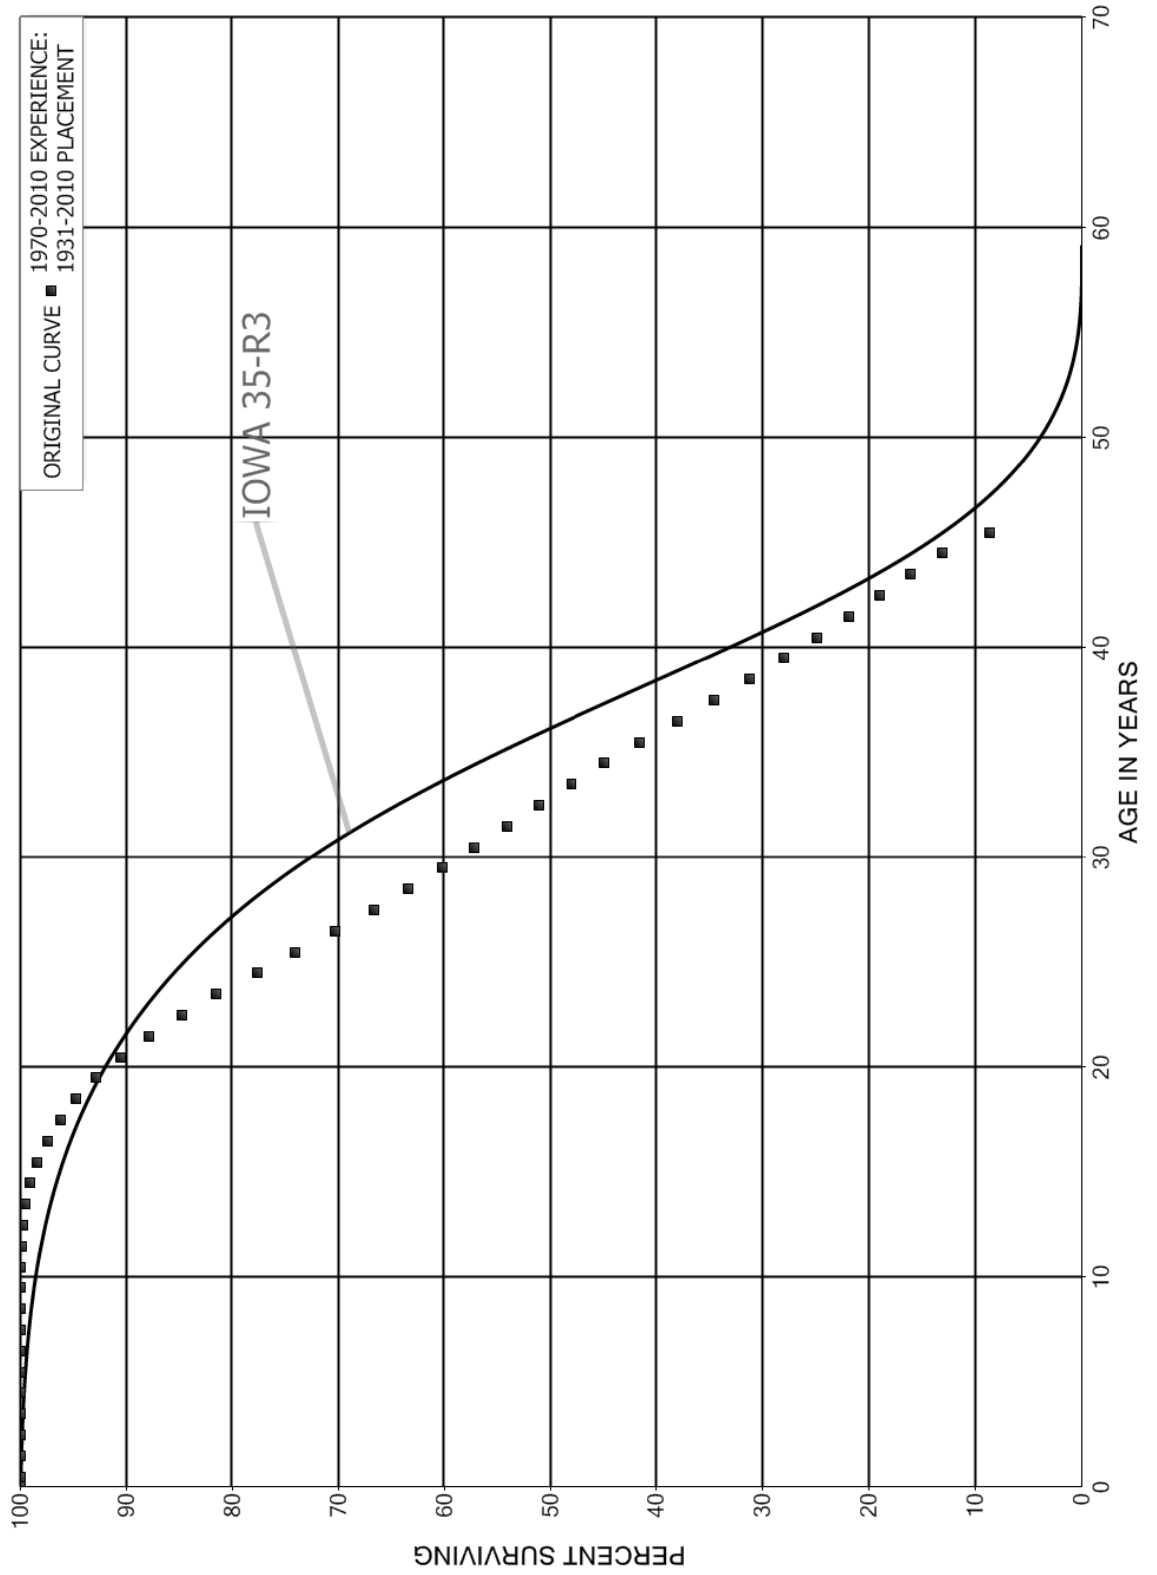

MANITOBA HYDRO

ACCOUNT 4000X - STREET LIGHTING

ORIGINAL LIFE TABLE

PLACEMENT BAND 1931-2010			EXPERIENCE BAND 1970-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	159,948,034		0.0000	1.0000	100.00
0.5	154,602,481		0.0000	1.0000	100.00
1.5	150,784,878		0.0000	1.0000	100.00
2.5	145,129,013		0.0000	1.0000	100.00
3.5	140,654,786		0.0000	1.0000	100.00
4.5	135,493,192	4	0.0000	1.0000	100.00
5.5	131,337,748	84	0.0000	1.0000	100.00
6.5	126,224,088	626	0.0000	1.0000	100.00
7.5	123,394,974	3,176	0.0000	1.0000	100.00
8.5	120,087,571	12,858	0.0001	0.9999	100.00
9.5	116,556,218	35,239	0.0003	0.9997	99.99
10.5	112,657,336	74,720	0.0007	0.9993	99.96
11.5	108,293,825	169,080	0.0016	0.9984	99.89
12.5	105,948,004	246,811	0.0023	0.9977	99.73
13.5	100,923,905	471,124	0.0047	0.9953	99.50
14.5	97,144,260	680,822	0.0070	0.9930	99.04
15.5	91,208,318	831,545	0.0091	0.9909	98.34
16.5	84,231,533	1,090,645	0.0129	0.9871	97.45
17.5	77,981,877	1,186,696	0.0152	0.9848	96.18
18.5	68,759,660	1,378,117	0.0200	0.9800	94.72
19.5	61,163,331	1,513,415	0.0247	0.9753	92.82
20.5	55,126,613	1,646,347	0.0299	0.9701	90.53
21.5	48,643,508	1,719,723	0.0354	0.9646	87.82
22.5	44,091,793	1,667,339	0.0378	0.9622	84.72
23.5	38,572,419	1,868,493	0.0484	0.9516	81.51
24.5	33,041,567	1,509,151	0.0457	0.9543	77.56
25.5	28,992,532	1,484,306	0.0512	0.9488	74.02
26.5	25,736,703	1,316,153	0.0511	0.9489	70.23
27.5	21,821,957	1,073,886	0.0492	0.9508	66.64
28.5	18,181,605	904,154	0.0497	0.9503	63.36
29.5	15,060,821	767,444	0.0510	0.9490	60.21
30.5	10,489,950	557,057	0.0531	0.9469	57.14
31.5	8,436,056	477,634	0.0566	0.9434	54.11
32.5	6,007,107	358,795	0.0597	0.9403	51.04
33.5	3,801,553	250,634	0.0659	0.9341	48.00
34.5	2,749,598	201,833	0.0734	0.9266	44.83
35.5	1,554,222	132,397	0.0852	0.9148	41.54
36.5	1,044,191	94,848	0.0908	0.9092	38.00
37.5	731,845	71,659	0.0979	0.9021	34.55
38.5	464,008	48,171	0.1038	0.8962	31.17


MANITOBA HYDRO

ACCOUNT 4000X - STREET LIGHTING


ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1931-2010			EXPERIENCE BAND 1970-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
39.5	300,414	33,887	0.1128	0.8872	27.93	
40.5	142,655	16,976	0.1190	0.8810	24.78	
41.5	85,112	11,302	0.1328	0.8672	21.83	
42.5	26,420	3,934	0.1489	0.8511	18.93	
43.5	9,780	1,833	0.1874	0.8126	16.11	
44.5	2,057	702	0.3411	0.6589	13.09	
45.5					8.63	


MANITOBA HYDRO
ACCOUNT 4900V - METERS - ELECTRONIC
SMOOTH SURVIVOR CURVE

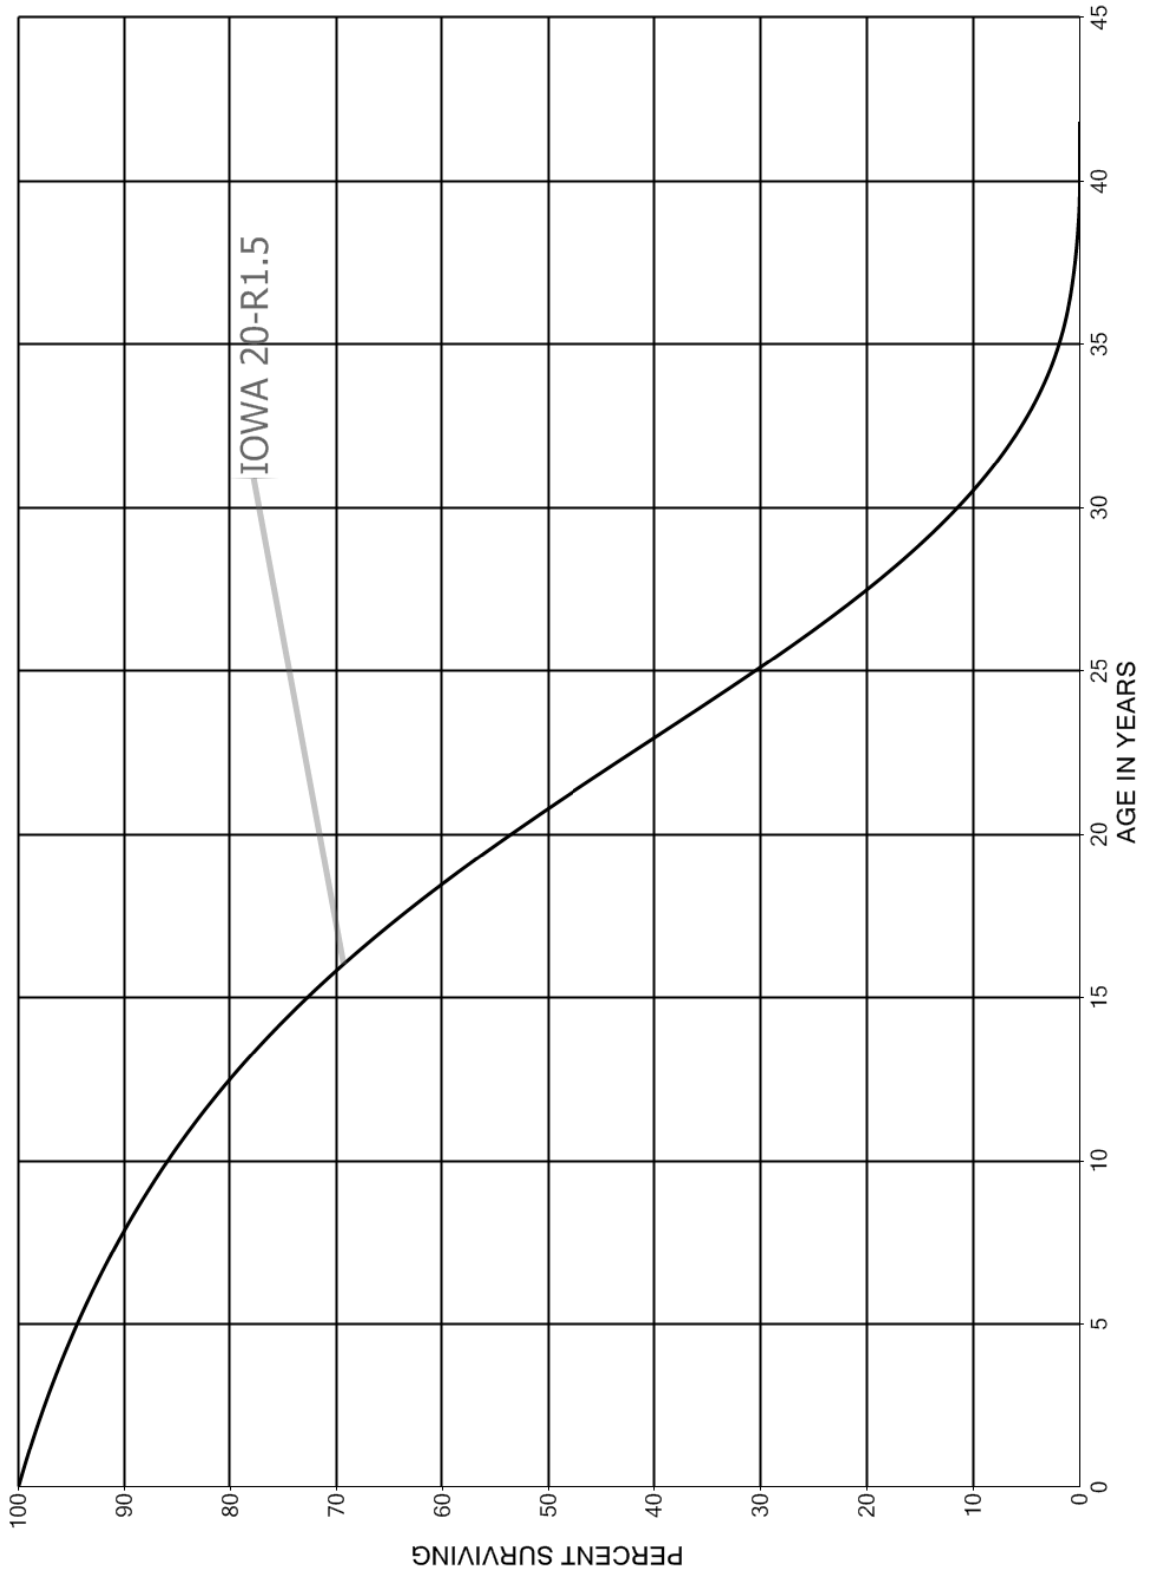


MANITOBA HYDRO
ACCOUNT 4900Y - METERS - ANALOG
SMOOTH SURVIVOR CURVE

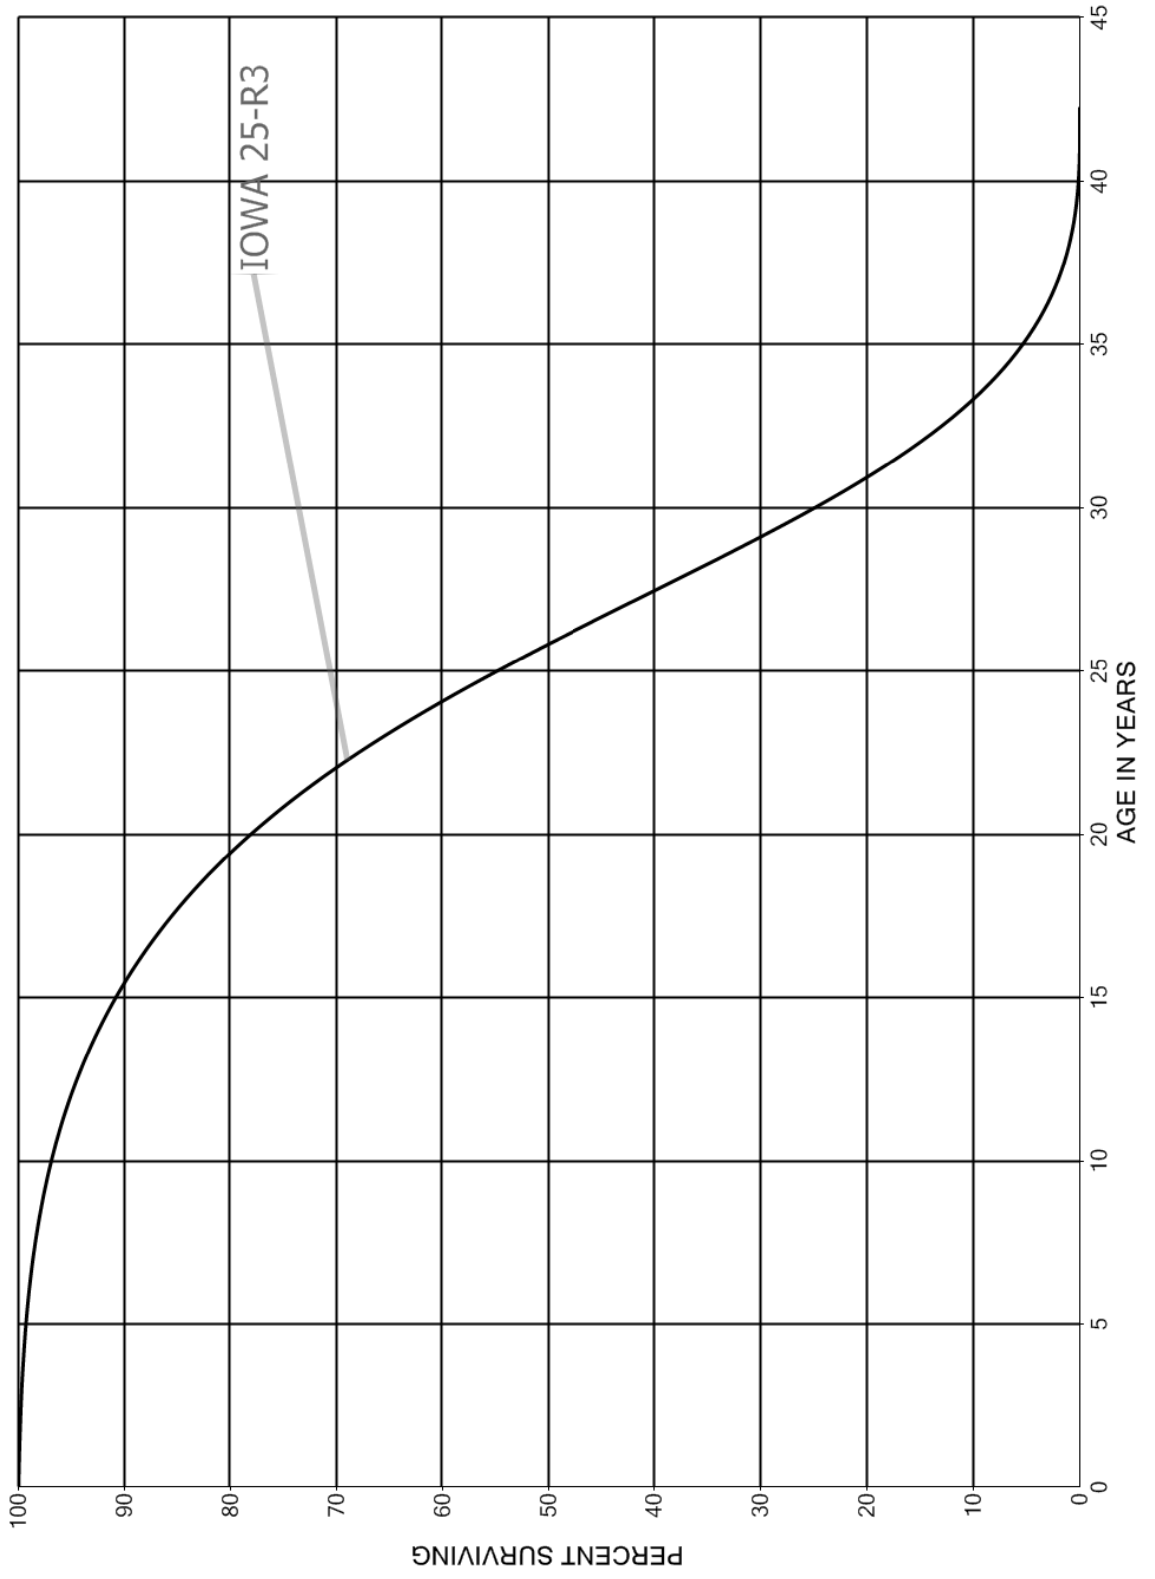

MANITOBA HYDRO
ACCOUNT 4900Z - METERING TRANSFORMERS
SMOOTH SURVIVOR CURVE

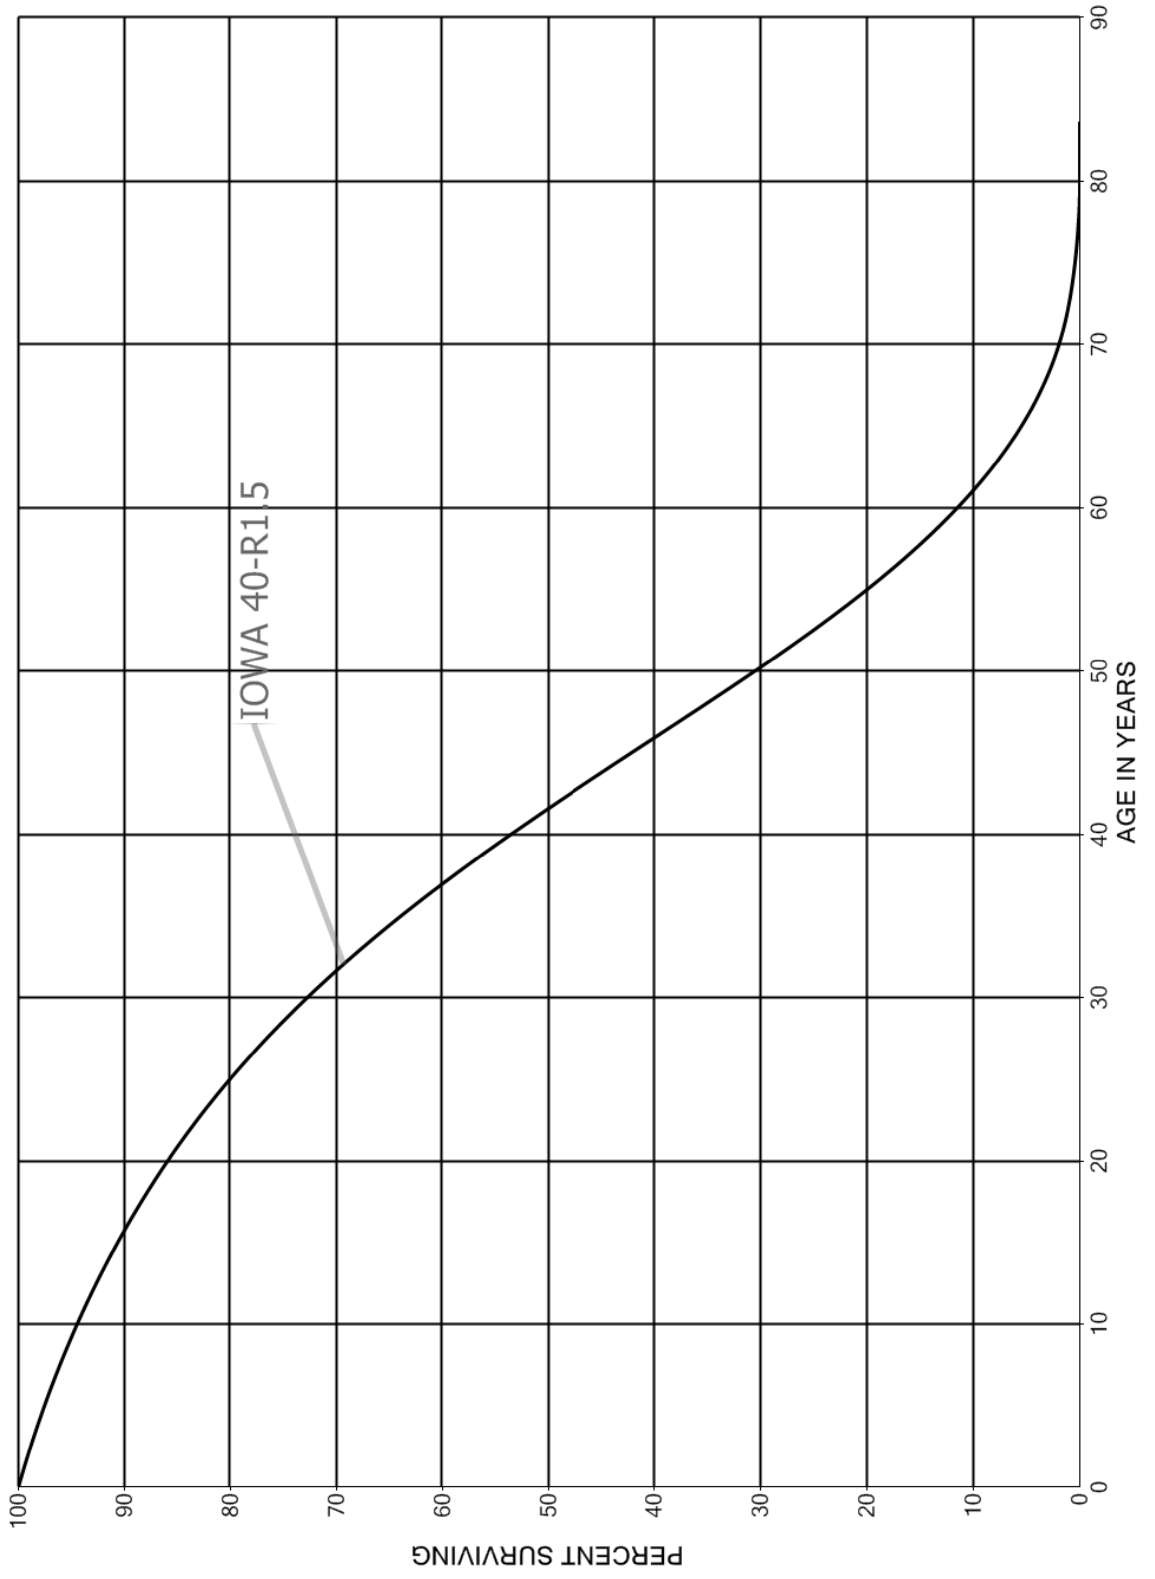

MANITOBA HYDRO
ACCOUNT 5000B - BUILDINGS
ORIGINAL AND SMOOTH SURVIVOR CURVES

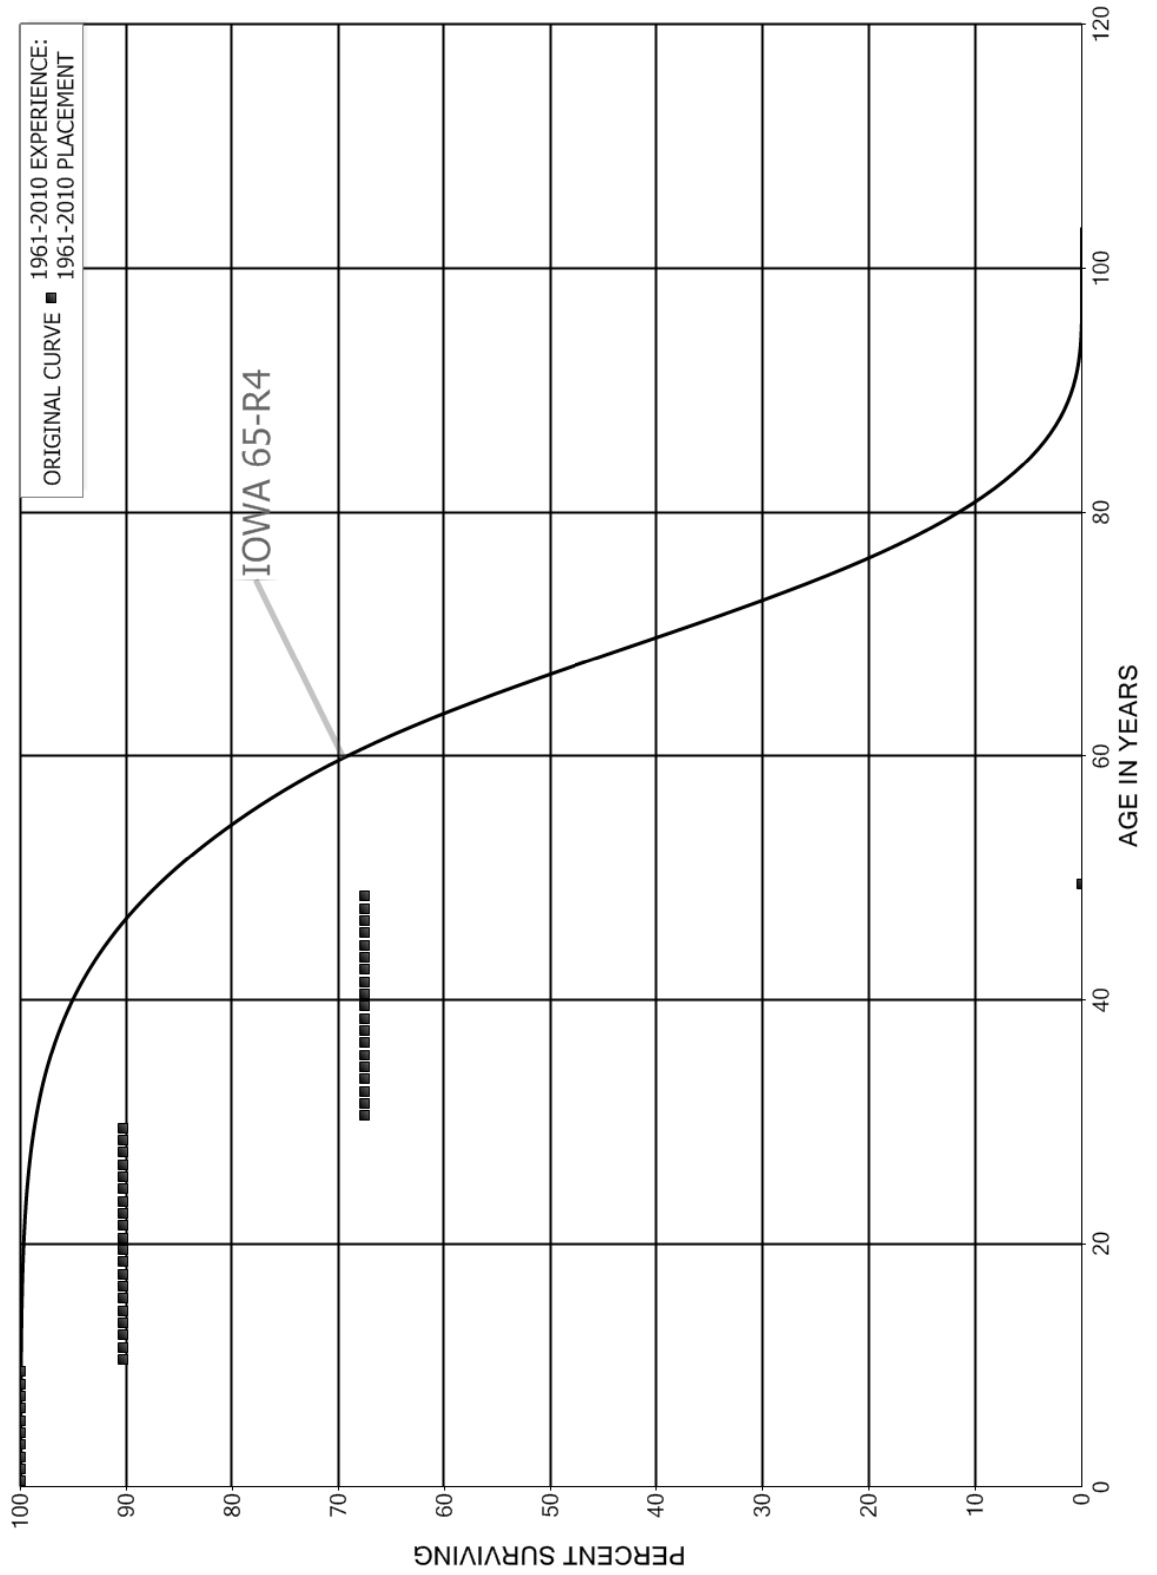

MANITOBA HYDRO

ACCOUNT 5000B - BUILDINGS

ORIGINAL LIFE TABLE

PLACEMENT BAND 1961-2010			EXPERIENCE BAND 1961-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	4,310,836		0.0000	1.0000	100.00
0.5	4,295,538		0.0000	1.0000	100.00
1.5	4,295,538		0.0000	1.0000	100.00
2.5	4,295,538		0.0000	1.0000	100.00
3.5	4,103,558		0.0000	1.0000	100.00
4.5	4,103,558		0.0000	1.0000	100.00
5.5	3,818,445		0.0000	1.0000	100.00
6.5	2,762,601		0.0000	1.0000	100.00
7.5	1,895,363		0.0000	1.0000	100.00
8.5	1,851,603		0.0000	1.0000	100.00
9.5	1,208,108	117,852	0.0976	0.9024	100.00
10.5	915,078		0.0000	1.0000	90.24
11.5	915,078		0.0000	1.0000	90.24
12.5	915,078		0.0000	1.0000	90.24
13.5	740,540		0.0000	1.0000	90.24
14.5	740,540		0.0000	1.0000	90.24
15.5	740,540		0.0000	1.0000	90.24
16.5	740,540		0.0000	1.0000	90.24
17.5	740,540		0.0000	1.0000	90.24
18.5	654,437		0.0000	1.0000	90.24
19.5	583,360		0.0000	1.0000	90.24
20.5	376,247		0.0000	1.0000	90.24
21.5	376,247		0.0000	1.0000	90.24
22.5	376,247		0.0000	1.0000	90.24
23.5	376,247		0.0000	1.0000	90.24
24.5	376,247		0.0000	1.0000	90.24
25.5	275,735		0.0000	1.0000	90.24
26.5	275,735		0.0000	1.0000	90.24
27.5	202,009		0.0000	1.0000	90.24
28.5	202,009		0.0000	1.0000	90.24
29.5	149,881	37,826	0.2524	0.7476	90.24
30.5	19,862		0.0000	1.0000	67.47
31.5	19,862		0.0000	1.0000	67.47
32.5	19,862		0.0000	1.0000	67.47
33.5	19,862		0.0000	1.0000	67.47
34.5	19,862		0.0000	1.0000	67.47
35.5	5,602		0.0000	1.0000	67.47
36.5	5,602		0.0000	1.0000	67.47
37.5	5,602		0.0000	1.0000	67.47
38.5	5,602		0.0000	1.0000	67.47


MANITOBA HYDRO

ACCOUNT 5000B - BUILDINGS


ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1961-2010			EXPERIENCE BAND 1961-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
39.5	5,602		0.0000	1.0000	67.47
40.5	5,602		0.0000	1.0000	67.47
41.5	5,602		0.0000	1.0000	67.47
42.5	5,602		0.0000	1.0000	67.47
43.5	5,602		0.0000	1.0000	67.47
44.5	5,602		0.0000	1.0000	67.47
45.5	701		0.0000	1.0000	67.47
46.5	701		0.0000	1.0000	67.47
47.5	701		0.0000	1.0000	67.47
48.5	701	701	1.0000		67.47
49.5					

MANITOBA HYDRO
ACCOUNT 5000D - BUILDING - SYSTEM CONTROL CENTRE
SMOOTH SURVIVOR CURVE

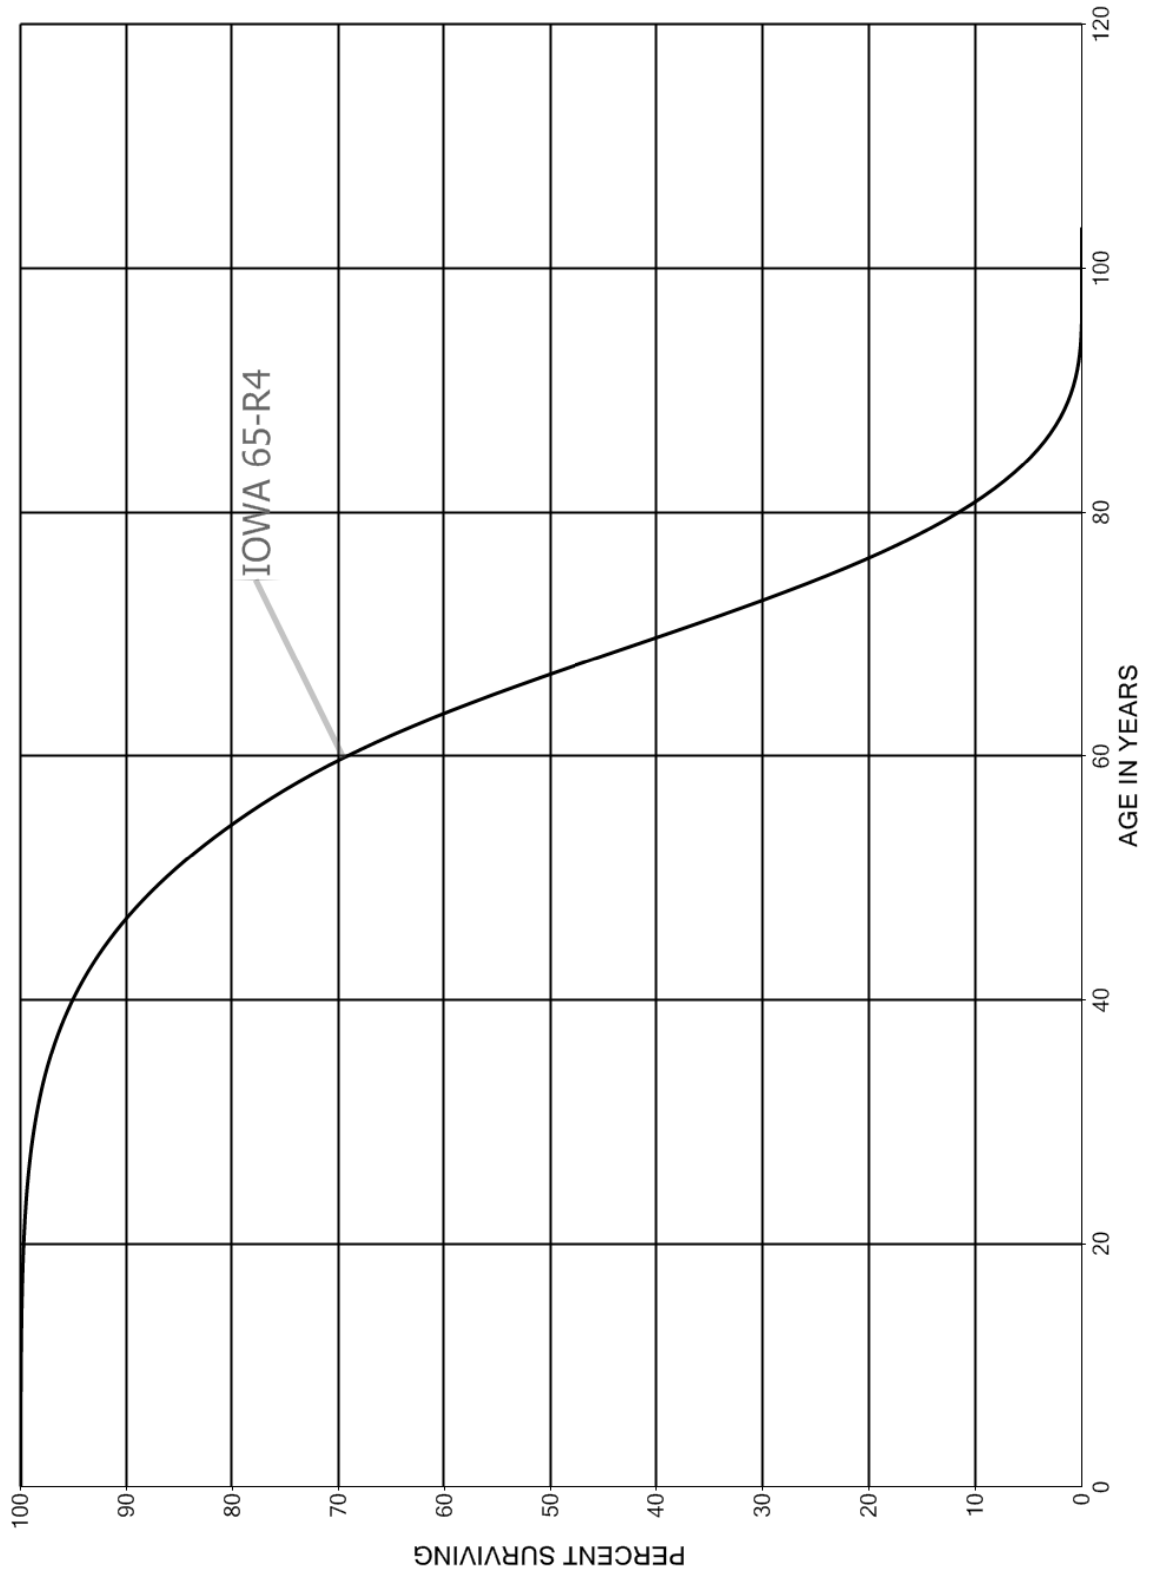

MANITOBA HYDRO
ACCOUNT 5000G - COMMUNICATION TOWERS
ORIGINAL AND SMOOTH SURVIVOR CURVES

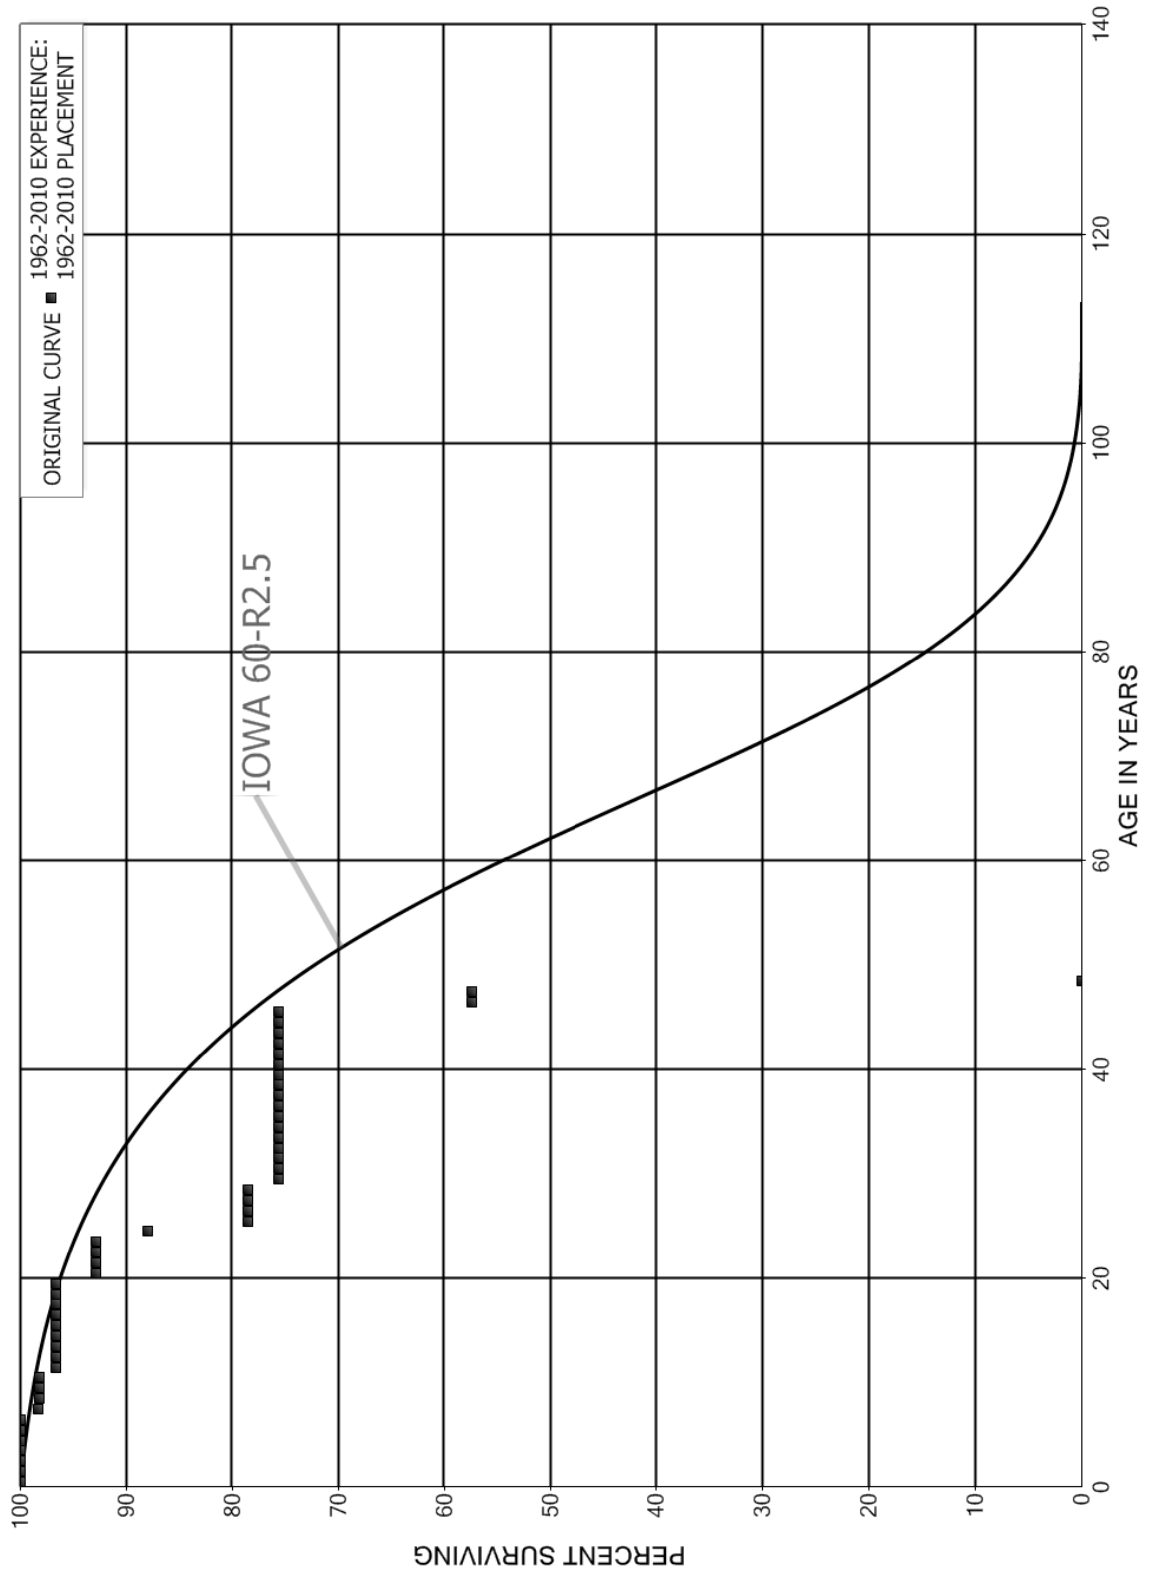

MANITOBA HYDRO

ACCOUNT 5000G - COMMUNICATION TOWERS

ORIGINAL LIFE TABLE

PLACEMENT BAND 1962-2010			EXPERIENCE BAND 1962-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	9,244,289		0.0000	1.0000	100.00
0.5	8,287,003		0.0000	1.0000	100.00
1.5	8,240,544	12	0.0000	1.0000	100.00
2.5	6,930,233	594	0.0001	0.9999	100.00
3.5	6,663,296		0.0000	1.0000	99.99
4.5	6,483,871		0.0000	1.0000	99.99
5.5	6,331,083		0.0000	1.0000	99.99
6.5	6,041,850	103,607	0.0171	0.9829	99.99
7.5	5,437,441	5,912	0.0011	0.9989	98.28
8.5	5,228,636		0.0000	1.0000	98.17
9.5	5,228,636		0.0000	1.0000	98.17
10.5	5,091,302	78,684	0.0155	0.9845	98.17
11.5	4,817,847		0.0000	1.0000	96.65
12.5	4,308,861		0.0000	1.0000	96.65
13.5	2,205,148		0.0000	1.0000	96.65
14.5	2,145,148		0.0000	1.0000	96.65
15.5	2,145,148		0.0000	1.0000	96.65
16.5	2,145,148		0.0000	1.0000	96.65
17.5	1,957,060		0.0000	1.0000	96.65
18.5	1,922,564		0.0000	1.0000	96.65
19.5	1,922,564	76,650	0.0399	0.9601	96.65
20.5	1,317,762		0.0000	1.0000	92.80
21.5	1,317,762		0.0000	1.0000	92.80
22.5	1,317,762		0.0000	1.0000	92.80
23.5	1,317,762	68,640	0.0521	0.9479	92.80
24.5	1,249,121	133,569	0.1069	0.8931	87.97
25.5	897,497		0.0000	1.0000	78.56
26.5	897,497		0.0000	1.0000	78.56
27.5	759,874		0.0000	1.0000	78.56
28.5	753,263	27,899	0.0370	0.9630	78.56
29.5	670,101		0.0000	1.0000	75.65
30.5	172,777		0.0000	1.0000	75.65
31.5	172,777		0.0000	1.0000	75.65
32.5	172,777		0.0000	1.0000	75.65
33.5	172,777		0.0000	1.0000	75.65
34.5	172,777		0.0000	1.0000	75.65
35.5	172,777		0.0000	1.0000	75.65
36.5	172,777		0.0000	1.0000	75.65
37.5	172,777		0.0000	1.0000	75.65
38.5	172,777		0.0000	1.0000	75.65


MANITOBA HYDRO

ACCOUNT 5000G - COMMUNICATION TOWERS

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1962-2010			EXPERIENCE BAND 1962-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
39.5	64,501		0.0000	1.0000	75.65
40.5	64,501		0.0000	1.0000	75.65
41.5	64,501		0.0000	1.0000	75.65
42.5	64,501		0.0000	1.0000	75.65
43.5	64,501		0.0000	1.0000	75.65
44.5	64,501		0.0000	1.0000	75.65
45.5	60,483	14,575	0.2410	0.7590	75.65
46.5	220		0.0000	1.0000	57.42
47.5	220	220	1.0000		57.42
48.5					

MANITOBA HYDRO
ACCOUNT 5000H - FIBRE OPTIC AND METALLIC CABLE
ORIGINAL AND SMOOTH SURVIVOR CURVES

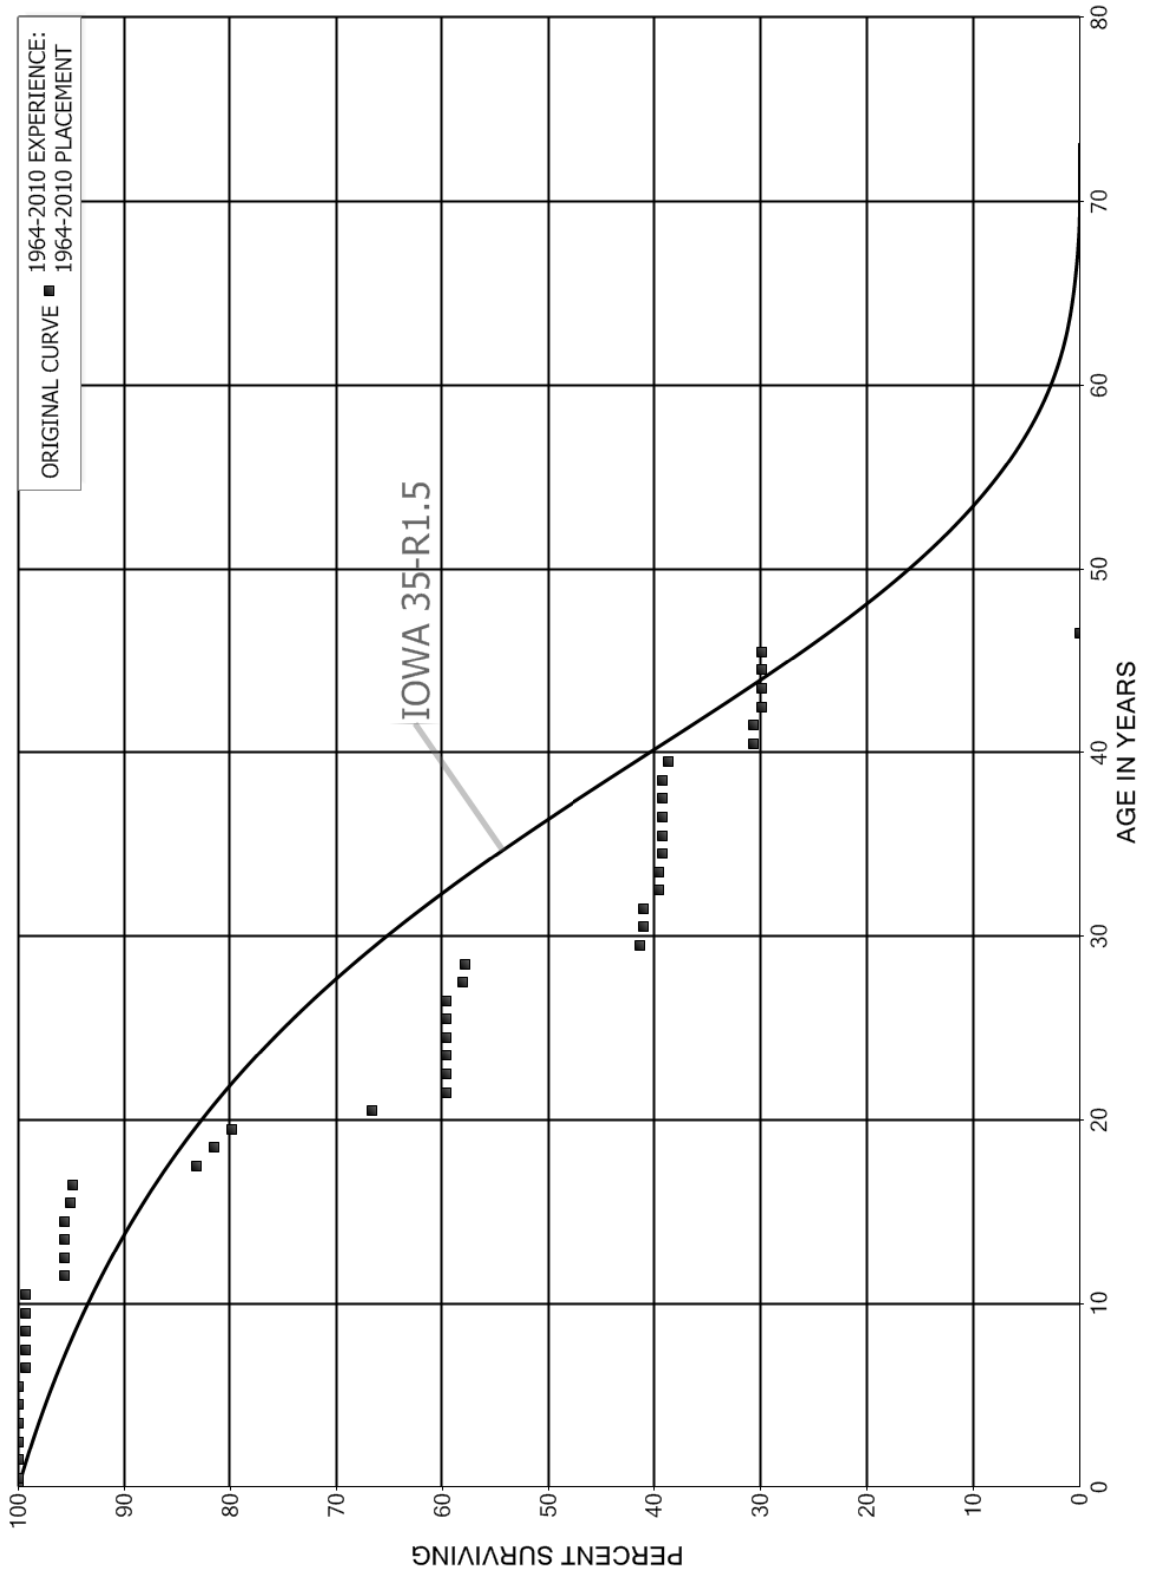

MANITOBA HYDRO

ACCOUNT 5000H - FIBRE OPTIC AND METALLIC CABLE

ORIGINAL LIFE TABLE

PLACEMENT BAND 1964-2010			EXPERIENCE BAND 1964-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	120,532,171		0.0000	1.0000	100.00
0.5	113,226,868		0.0000	1.0000	100.00
1.5	109,988,169		0.0000	1.0000	100.00
2.5	101,778,236		0.0000	1.0000	100.00
3.5	89,870,978	85,600	0.0010	0.9990	100.00
4.5	89,697,922	4,193	0.0000	1.0000	99.90
5.5	76,852,633	461,016	0.0060	0.9940	99.90
6.5	28,295,986		0.0000	1.0000	99.30
7.5	27,167,133	6,513	0.0002	0.9998	99.30
8.5	25,051,989		0.0000	1.0000	99.28
9.5	25,049,840		0.0000	1.0000	99.28
10.5	14,668,432	535,000	0.0365	0.9635	99.28
11.5	9,760,780		0.0000	1.0000	95.66
12.5	7,605,681		0.0000	1.0000	95.66
13.5	7,376,597		0.0000	1.0000	95.66
14.5	7,376,597	44,456	0.0060	0.9940	95.66
15.5	7,183,625	15,947	0.0022	0.9978	95.08
16.5	5,826,551	718,790	0.1234	0.8766	94.87
17.5	955,530	19,210	0.0201	0.9799	83.17
18.5	826,207	16,921	0.0205	0.9795	81.49
19.5	747,952	123,943	0.1657	0.8343	79.82
20.5	624,009	65,536	0.1050	0.8950	66.60
21.5	558,473		0.0000	1.0000	59.60
22.5	558,473		0.0000	1.0000	59.60
23.5	558,473		0.0000	1.0000	59.60
24.5	558,473		0.0000	1.0000	59.60
25.5	558,473		0.0000	1.0000	59.60
26.5	558,473	14,816	0.0265	0.9735	59.60
27.5	543,657	2,136	0.0039	0.9961	58.02
28.5	541,522	154,282	0.2849	0.7151	57.79
29.5	387,239	3,989	0.0103	0.9897	41.33
30.5	383,251		0.0000	1.0000	40.90
31.5	383,251	13,414	0.0350	0.9650	40.90
32.5	249,159		0.0000	1.0000	39.47
33.5	249,159	1,934	0.0078	0.9922	39.47
34.5	247,225		0.0000	1.0000	39.16
35.5	247,225		0.0000	1.0000	39.16
36.5	247,225		0.0000	1.0000	39.16
37.5	247,225		0.0000	1.0000	39.16
38.5	247,225	3,204	0.0130	0.9870	39.16


MANITOBA HYDRO

ACCOUNT 5000H - FIBRE OPTIC AND METALLIC CABLE

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1964-2010			EXPERIENCE BAND 1964-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
39.5	244,021	50,825	0.2083	0.7917	38.66	
40.5	193,196		0.0000	1.0000	30.60	
41.5	190,521	5,100	0.0268	0.9732	30.60	
42.5	185,421		0.0000	1.0000	29.79	
43.5	185,421		0.0000	1.0000	29.79	
44.5	185,421		0.0000	1.0000	29.79	
45.5	185,421	185,421	1.0000		29.79	
46.5						

MANITOBA HYDRO
ACCOUNT 5000J - CARRIER EQUIPMENT
ORIGINAL AND SMOOTH SURVIVOR CURVES

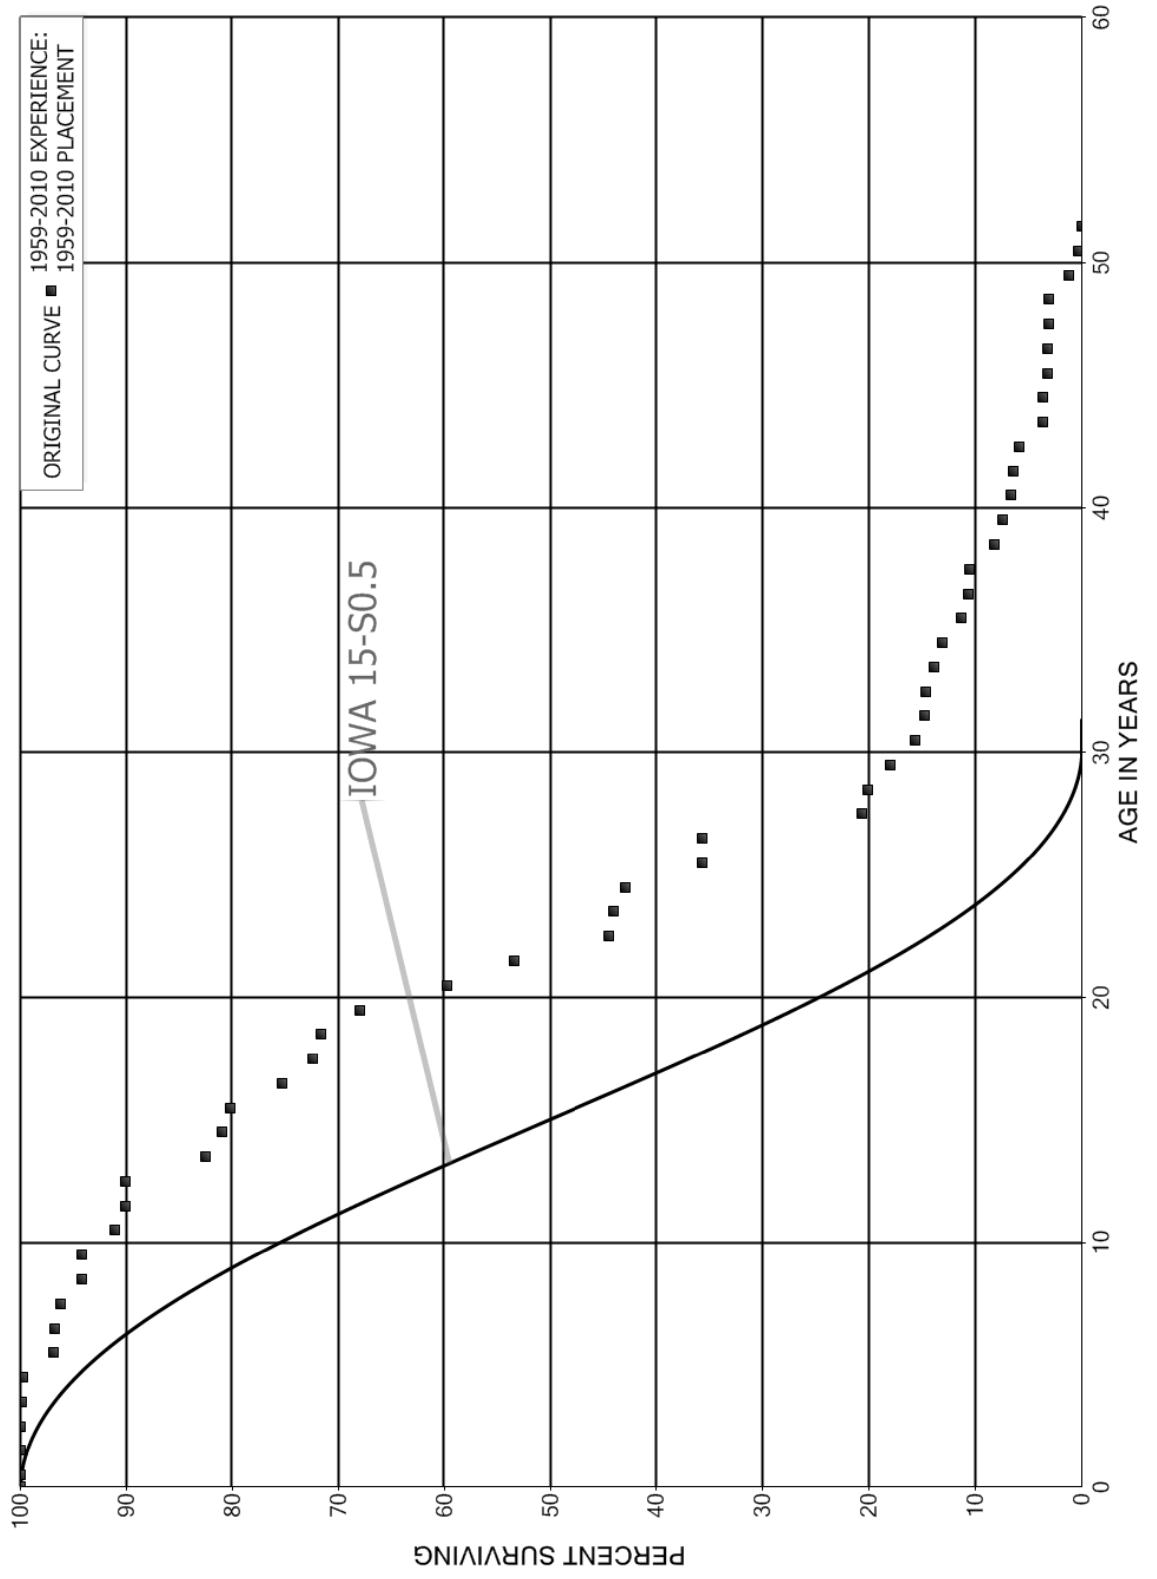

MANITOBA HYDRO

ACCOUNT 5000J - CARRIER EQUIPMENT

ORIGINAL LIFE TABLE

PLACEMENT BAND 1959-2010			EXPERIENCE BAND 1959-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	156,677,976	41,098	0.0003	0.9997	100.00
0.5	150,377,890		0.0000	1.0000	99.97
1.5	134,857,412	46,947	0.0003	0.9997	99.97
2.5	123,961,772	156,402	0.0013	0.9987	99.94
3.5	117,312,223	50,000	0.0004	0.9996	99.81
4.5	113,652,904	3,326,364	0.0293	0.9707	99.77
5.5	105,115,329	129,877	0.0012	0.9988	96.85
6.5	85,823,384	460,897	0.0054	0.9946	96.73
7.5	85,362,487	1,786,427	0.0209	0.9791	96.21
8.5	76,587,263	11,165	0.0001	0.9999	94.20
9.5	75,229,553	2,525,689	0.0336	0.9664	94.18
10.5	68,180,432	741,215	0.0109	0.9891	91.02
11.5	48,444,149	4,074	0.0001	0.9999	90.03
12.5	40,656,810	3,411,264	0.0839	0.9161	90.02
13.5	30,897,900	570,941	0.0185	0.9815	82.47
14.5	29,089,385	294,480	0.0101	0.9899	80.95
15.5	28,508,360	1,741,425	0.0611	0.9389	80.13
16.5	26,023,906	968,232	0.0372	0.9628	75.23
17.5	23,528,379	282,487	0.0120	0.9880	72.43
18.5	23,083,145	1,158,609	0.0502	0.9498	71.56
19.5	21,611,375	2,634,364	0.1219	0.8781	67.97
20.5	18,839,269	1,992,820	0.1058	0.8942	59.69
21.5	16,752,522	2,831,305	0.1690	0.8310	53.37
22.5	13,915,073	127,007	0.0091	0.9909	44.35
23.5	13,434,179	347,776	0.0259	0.9741	43.95
24.5	13,028,944	2,192,969	0.1683	0.8317	42.81
25.5	10,778,393	13,122	0.0012	0.9988	35.60
26.5	10,624,087	4,467,870	0.4205	0.5795	35.56
27.5	6,057,848	169,865	0.0280	0.9720	20.61
28.5	5,607,360	598,149	0.1067	0.8933	20.03
29.5	4,612,223	599,960	0.1301	0.8699	17.89
30.5	4,012,263	229,535	0.0572	0.9428	15.56
31.5	3,782,727	5,215	0.0014	0.9986	14.67
32.5	3,775,459	216,758	0.0574	0.9426	14.65
33.5	3,440,807	173,993	0.0506	0.9494	13.81
34.5	3,266,815	460,126	0.1408	0.8592	13.11
35.5	2,806,688	148,729	0.0530	0.9470	11.27
36.5	2,657,959	39,113	0.0147	0.9853	10.67
37.5	2,618,846	575,920	0.2199	0.7801	10.51
38.5	2,042,926	201,647	0.0987	0.9013	8.20


MANITOBA HYDRO

ACCOUNT 5000J - CARRIER EQUIPMENT

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1959-2010			EXPERIENCE BAND 1959-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
39.5	1,841,279	193,859	0.1053	0.8947	7.39	
40.5	1,647,420	47,733	0.0290	0.9710	6.61	
41.5	1,599,688	140,270	0.0877	0.9123	6.42	
42.5	1,459,418	550,776	0.3774	0.6226	5.86	
43.5	908,642	10,574	0.0116	0.9884	3.65	
44.5	898,068	111,033	0.1236	0.8764	3.61	
45.5	787,035	7,112	0.0090	0.9910	3.16	
46.5	779,924	26,691	0.0342	0.9658	3.13	
47.5	753,233	995	0.0013	0.9987	3.02	
48.5	752,238	469,663	0.6244	0.3756	3.02	
49.5	282,575	223,516	0.7910	0.2090	1.13	
50.5	59,058	59,058	1.0000		0.24	
51.5						

MANITOBA HYDRO
ACCOUNT 5000R - POWER SYSTEM CONTROL
ORIGINAL AND SMOOTH SURVIVOR CURVES

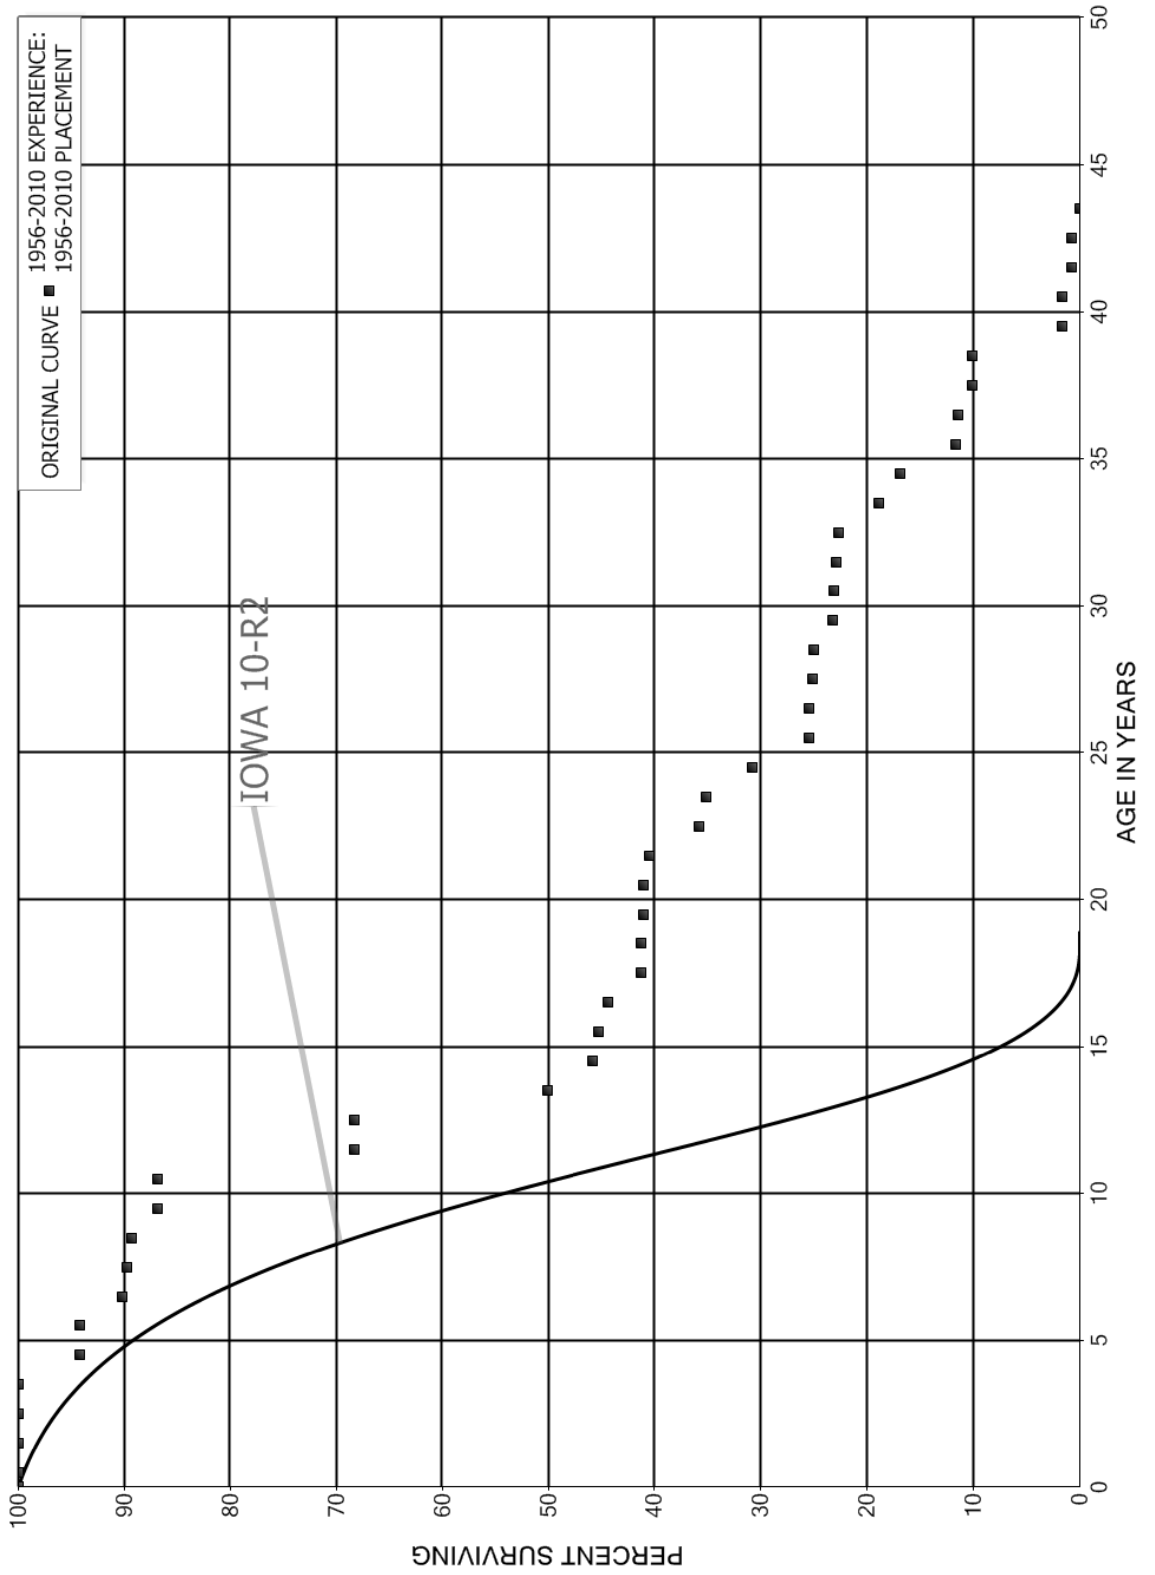

MANITOBA HYDRO

ACCOUNT 5000R - POWER SYSTEM CONTROL

ORIGINAL LIFE TABLE

PLACEMENT BAND 1956-2010			EXPERIENCE BAND 1956-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
0.0	16,656,718	365	0.0000	1.0000	100.00	
0.5	15,991,027		0.0000	1.0000	100.00	
1.5	15,734,744		0.0000	1.0000	100.00	
2.5	15,127,032	9,864	0.0007	0.9993	100.00	
3.5	14,844,099	848,075	0.0571	0.9429	99.93	
4.5	13,710,270		0.0000	1.0000	94.22	
5.5	13,309,451	566,783	0.0426	0.9574	94.22	
6.5	11,820,129	63,915	0.0054	0.9946	90.21	
7.5	11,198,876	59,653	0.0053	0.9947	89.72	
8.5	11,052,082	302,750	0.0274	0.9726	89.25	
9.5	10,534,973		0.0000	1.0000	86.80	
10.5	10,174,465	2,172,961	0.2136	0.7864	86.80	
11.5	7,321,775		0.0000	1.0000	68.26	
12.5	6,757,243	1,799,852	0.2664	0.7336	68.26	
13.5	4,626,376	401,514	0.0868	0.9132	50.08	
14.5	4,224,862	48,983	0.0116	0.9884	45.73	
15.5	4,151,799	85,343	0.0206	0.9794	45.20	
16.5	4,032,999	284,552	0.0706	0.9294	44.27	
17.5	3,729,473		0.0000	1.0000	41.15	
18.5	3,661,902	15,596	0.0043	0.9957	41.15	
19.5	3,565,486		0.0000	1.0000	40.98	
20.5	3,356,670	46,926	0.0140	0.9860	40.98	
21.5	3,154,775	365,163	0.1157	0.8843	40.40	
22.5	2,648,980	48,189	0.0182	0.9818	35.73	
23.5	2,600,792	318,681	0.1225	0.8775	35.08	
24.5	2,264,001	394,703	0.1743	0.8257	30.78	
25.5	1,447,080		0.0000	1.0000	25.41	
26.5	1,447,080	21,488	0.0148	0.9852	25.41	
27.5	1,425,592	3,593	0.0025	0.9975	25.03	
28.5	1,418,482	99,437	0.0701	0.9299	24.97	
29.5	1,292,148	5,781	0.0045	0.9955	23.22	
30.5	1,056,286	11,012	0.0104	0.9896	23.12	
31.5	792,555	8,163	0.0103	0.9897	22.88	
32.5	784,392	132,261	0.1686	0.8314	22.64	
33.5	652,131	69,681	0.1069	0.8931	18.82	
34.5	582,450	178,474	0.3064	0.6936	16.81	
35.5	392,636	9,074	0.0231	0.9769	11.66	
36.5	383,562	46,164	0.1204	0.8796	11.39	
37.5	337,398		0.0000	1.0000	10.02	
38.5	337,398	281,420	0.8341	0.1659	10.02	


MANITOBA HYDRO

ACCOUNT 5000R - POWER SYSTEM CONTROL

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1956-2010			EXPERIENCE BAND 1956-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
39.5	37,715	2,210	0.0586	0.9414	1.66	
40.5	35,505	19,194	0.5406	0.4594	1.56	
41.5	16,311	959	0.0588	0.9412	0.72	
42.5	15,353	15,353	1.0000		0.68	
43.5						

MANITOBA HYDRO
ACCOUNT 6000E - PASSENGER VEHICLES
ORIGINAL AND SMOOTH SURVIVOR CURVES

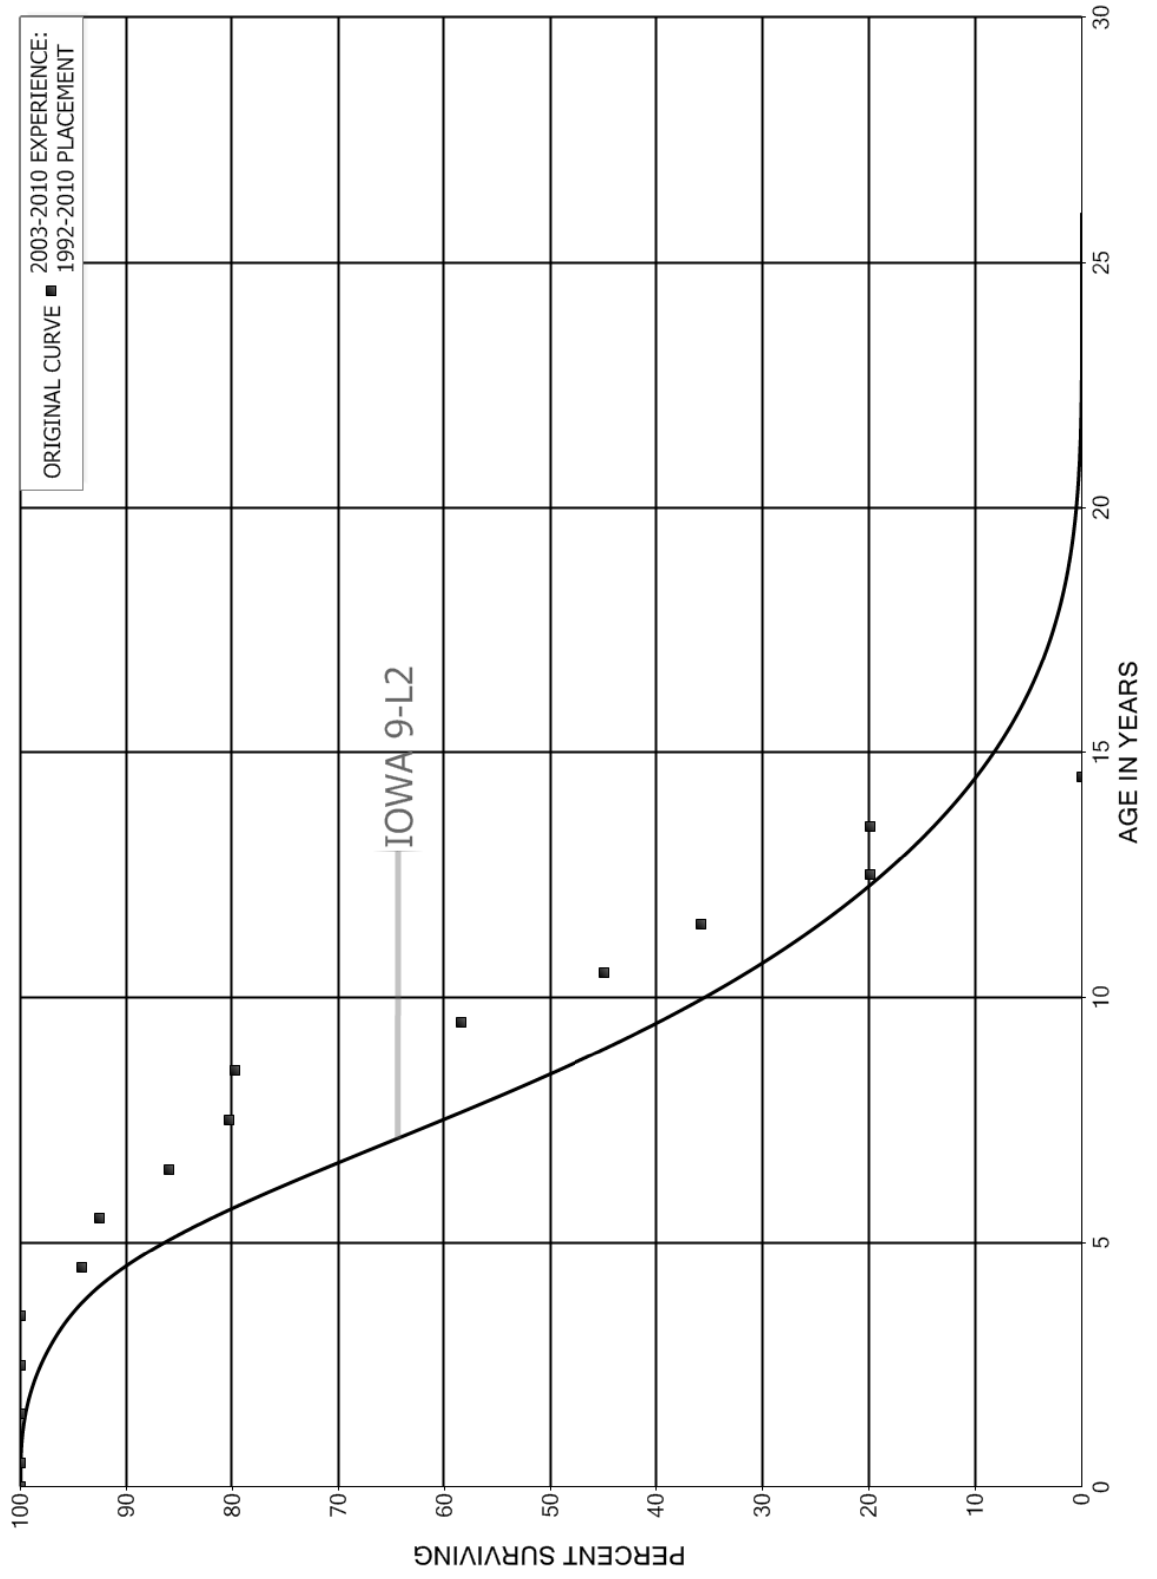


MANITOBA HYDRO

ACCOUNT 6000E - PASSENGER VEHICLES

ORIGINAL LIFE TABLE

PLACEMENT BAND 1992-2010			EXPERIENCE BAND 2003-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	1,144,629		0.0000	1.0000	100.00
0.5	1,292,518		0.0000	1.0000	100.00
1.5	1,045,247		0.0000	1.0000	100.00
2.5	883,784		0.0000	1.0000	100.00
3.5	878,809	51,672	0.0588	0.9412	100.00
4.5	924,009	15,408	0.0167	0.9833	94.12
5.5	859,782	61,826	0.0719	0.9281	92.55
6.5	816,118	53,584	0.0657	0.9343	85.90
7.5	604,785	3,959	0.0065	0.9935	80.26
8.5	483,953	129,577	0.2677	0.7323	79.73
9.5	365,180	84,830	0.2323	0.7677	58.38
10.5	290,852	59,235	0.2037	0.7963	44.82
11.5	149,083	66,226	0.4442	0.5558	35.69
12.5	59,727		0.0000	1.0000	19.84
13.5	37,144	37,144	1.0000		19.84
14.5					

MANITOBA HYDRO
ACCOUNT 6000F - LIGHT TRUCKS
ORIGINAL AND SMOOTH SURVIVOR CURVES

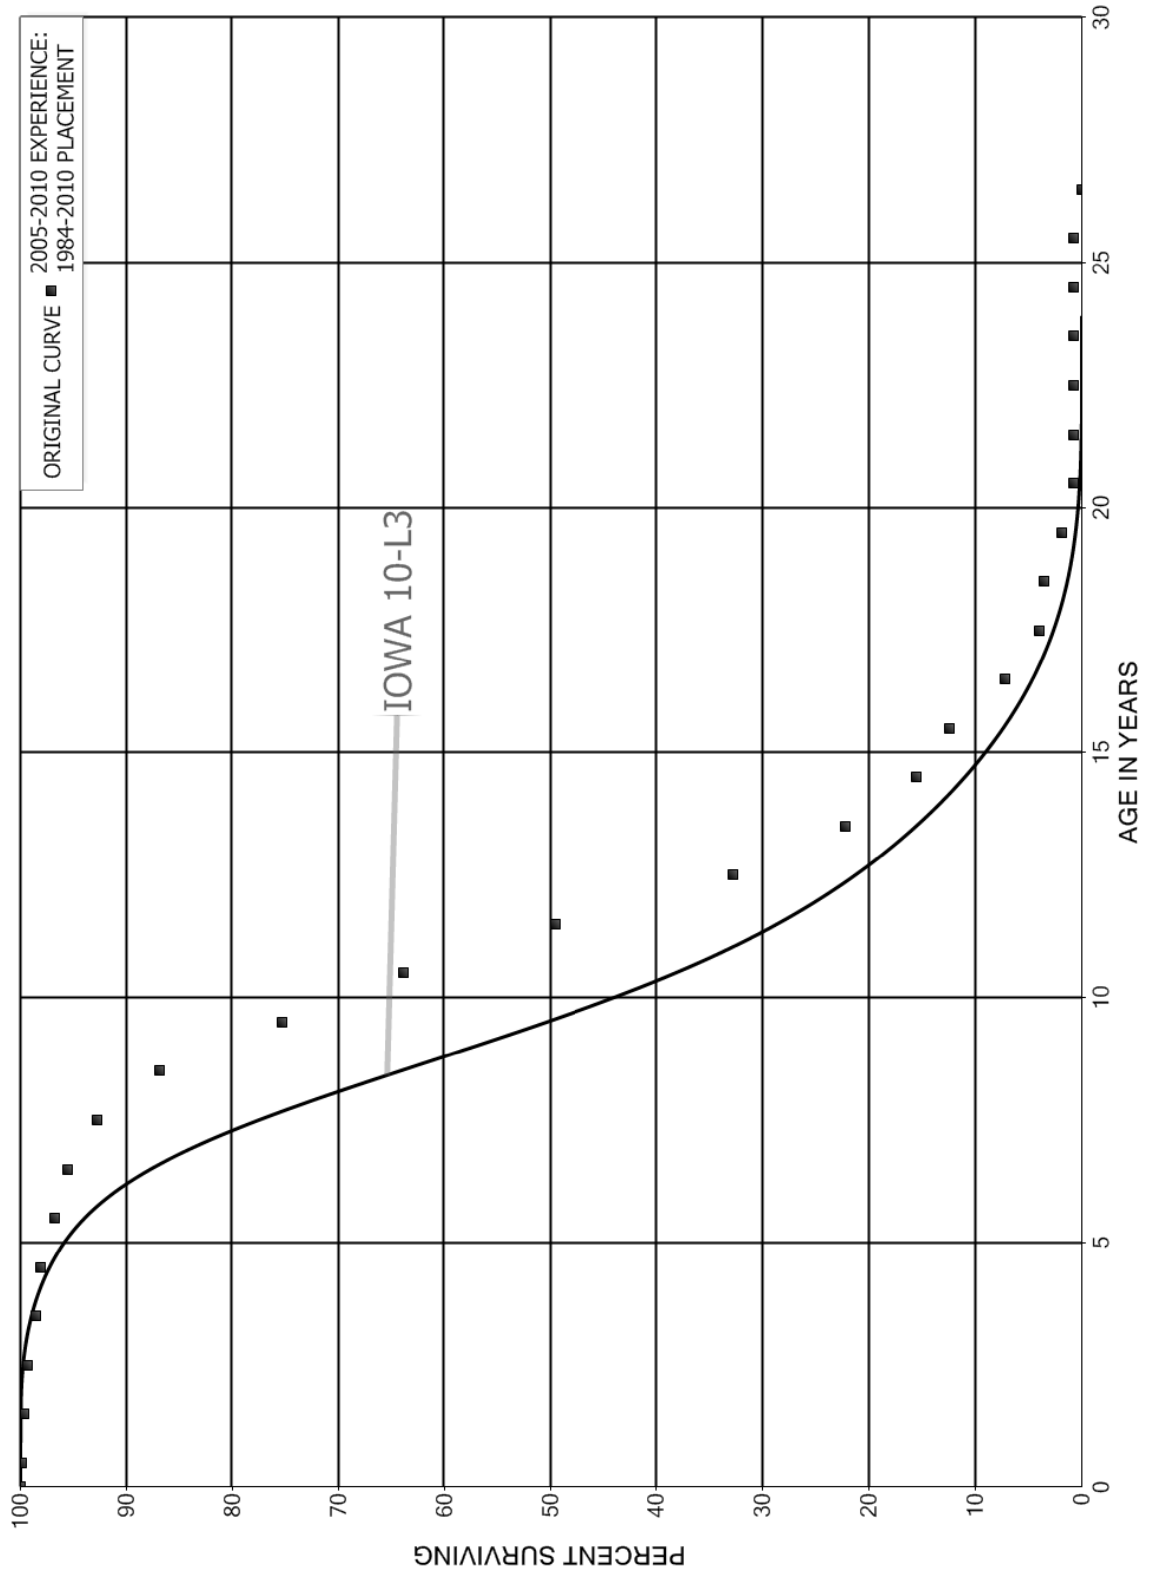


MANITOBA HYDRO

ACCOUNT 6000F - LIGHT TRUCKS

ORIGINAL LIFE TABLE

PLACEMENT BAND 1984-2010			EXPERIENCE BAND 2005-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	29,862,771	41,716	0.0014	0.9986	100.00
0.5	33,290,972	66,743	0.0020	0.9980	99.86
1.5	29,271,771	100,880	0.0034	0.9966	99.66
2.5	29,508,824	225,201	0.0076	0.9924	99.32
3.5	32,125,918	158,843	0.0049	0.9951	98.56
4.5	29,109,475	394,148	0.0135	0.9865	98.07
5.5	25,847,621	324,546	0.0126	0.9874	96.74
6.5	22,919,738	665,450	0.0290	0.9710	95.53
7.5	22,183,587	1,410,083	0.0636	0.9364	92.76
8.5	16,841,566	2,251,570	0.1337	0.8663	86.86
9.5	11,978,269	1,817,653	0.1517	0.8483	75.25
10.5	9,022,547	2,018,863	0.2238	0.7762	63.83
11.5	5,174,102	1,761,806	0.3405	0.6595	49.55
12.5	2,876,168	923,560	0.3211	0.6789	32.68
13.5	1,407,080	420,144	0.2986	0.7014	22.18
14.5	894,407	179,168	0.2003	0.7997	15.56
15.5	630,406	268,982	0.4267	0.5733	12.44
16.5	339,432	150,205	0.4425	0.5575	7.13
17.5	184,953	23,990	0.1297	0.8703	3.98
18.5	130,466	61,778	0.4735	0.5265	3.46
19.5	68,688	39,564	0.5760	0.4240	1.82
20.5	51,031		0.0000	1.0000	0.77
21.5	51,031		0.0000	1.0000	0.77
22.5	21,907		0.0000	1.0000	0.77
23.5	21,907		0.0000	1.0000	0.77
24.5	21,907		0.0000	1.0000	0.77
25.5	21,907	21,907	1.0000		0.77
26.5					

MANITOBA HYDRO
ACCOUNT 6000G - HEAVY TRUCKS
ORIGINAL AND SMOOTH SURVIVOR CURVES

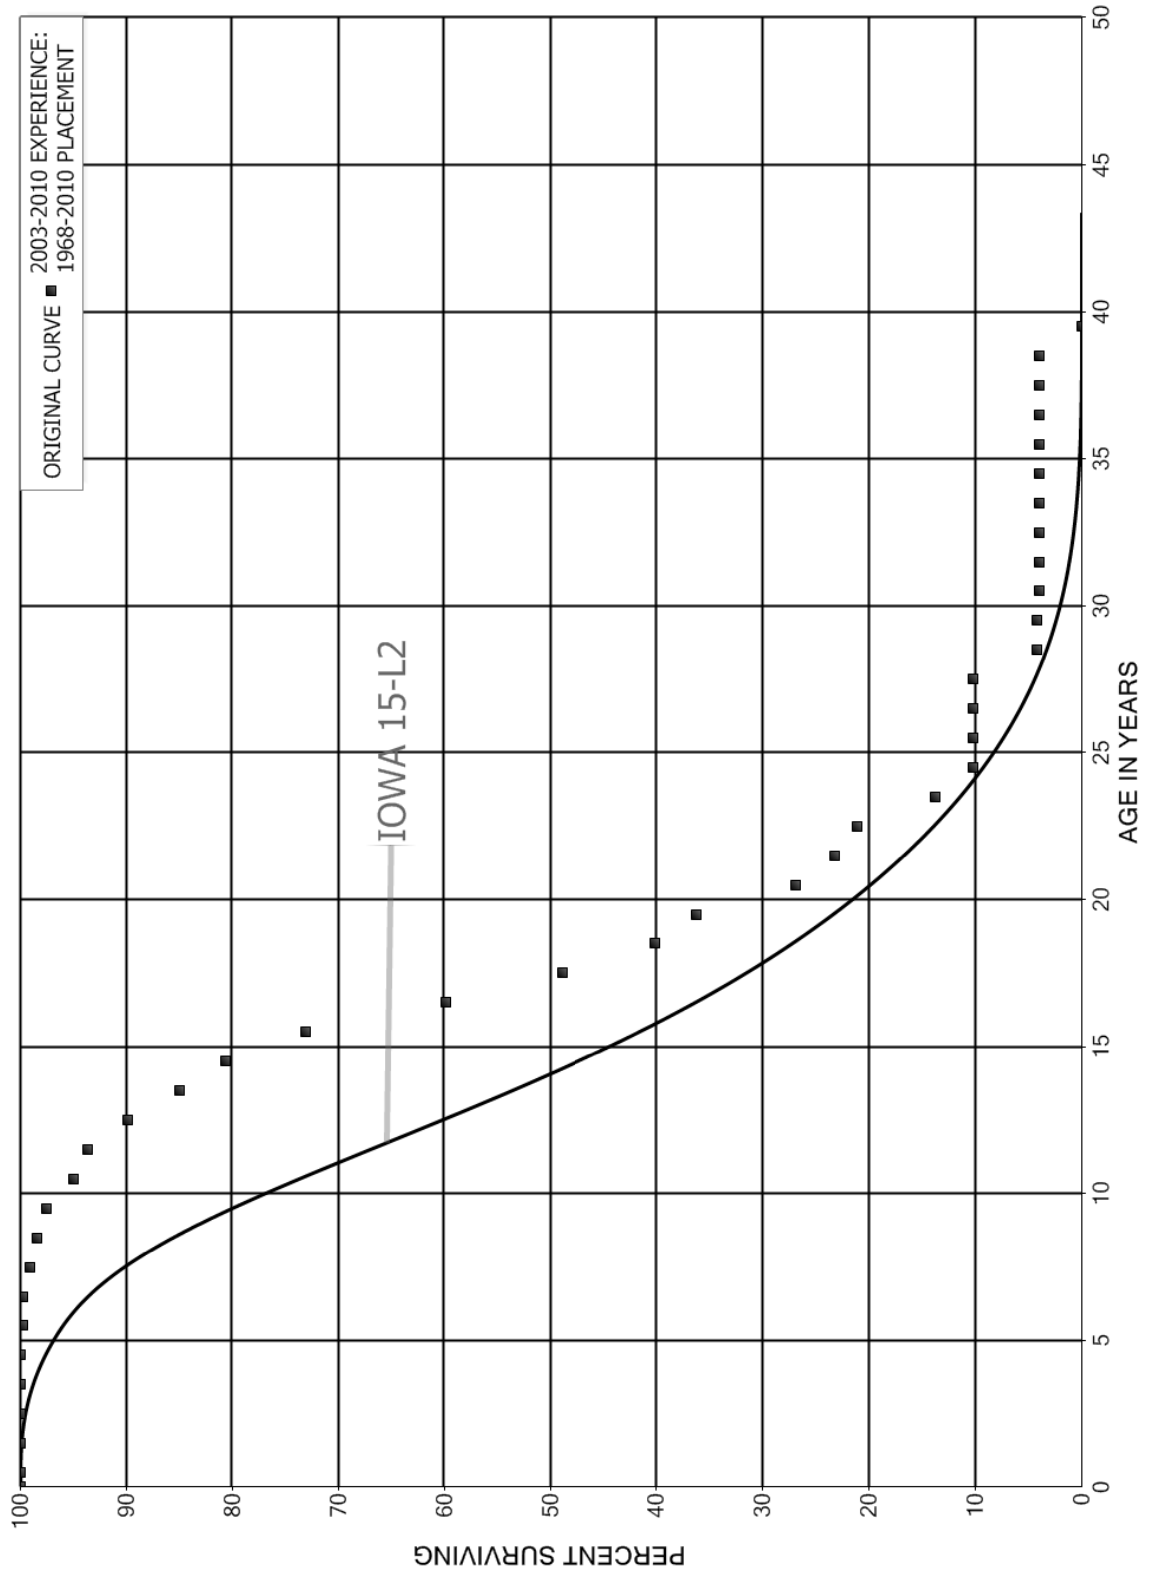


MANITOBA HYDRO

ACCOUNT 6000G - HEAVY TRUCKS

ORIGINAL LIFE TABLE

PLACEMENT BAND 1968-2010			EXPERIENCE BAND 2003-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
0.0	34,499,261	0	0.0000	1.0000	100.00	
0.5	39,807,536		0.0000	1.0000	100.00	
1.5	38,775,899		0.0000	1.0000	100.00	
2.5	36,839,357		0.0000	1.0000	100.00	
3.5	37,034,407	8,560	0.0002	0.9998	100.00	
4.5	33,072,522	89,666	0.0027	0.9973	99.98	
5.5	32,002,800		0.0000	1.0000	99.71	
6.5	29,490,072	174,934	0.0059	0.9941	99.71	
7.5	24,819,876	193,135	0.0078	0.9922	99.11	
8.5	18,221,992	153,461	0.0084	0.9916	98.34	
9.5	16,877,810	443,871	0.0263	0.9737	97.51	
10.5	11,275,074	156,411	0.0139	0.9861	94.95	
11.5	12,265,628	498,924	0.0407	0.9593	93.63	
12.5	9,546,133	515,540	0.0540	0.9460	89.82	
13.5	9,048,161	459,939	0.0508	0.9492	84.97	
14.5	8,192,878	769,126	0.0939	0.9061	80.65	
15.5	7,457,459	1,349,718	0.1810	0.8190	73.08	
16.5	6,031,662	1,107,345	0.1836	0.8164	59.86	
17.5	4,903,529	880,757	0.1796	0.8204	48.87	
18.5	3,672,155	361,963	0.0986	0.9014	40.09	
19.5	2,424,911	625,959	0.2581	0.7419	36.14	
20.5	1,988,859	266,971	0.1342	0.8658	26.81	
21.5	1,481,624	139,260	0.0940	0.9060	23.21	
22.5	1,093,427	379,737	0.3473	0.6527	21.03	
23.5	713,690	184,993	0.2592	0.7408	13.73	
24.5	325,525		0.0000	1.0000	10.17	
25.5	341,512		0.0000	1.0000	10.17	
26.5	344,512		0.0000	1.0000	10.17	
27.5	208,893	123,083	0.5892	0.4108	10.17	
28.5	64,437		0.0000	1.0000	4.18	
29.5	64,437	3,000	0.0466	0.9534	4.18	
30.5	61,437		0.0000	1.0000	3.98	
31.5	61,437		0.0000	1.0000	3.98	
32.5	61,437		0.0000	1.0000	3.98	
33.5	45,450		0.0000	1.0000	3.98	
34.5	60,426		0.0000	1.0000	3.98	
35.5	60,426		0.0000	1.0000	3.98	
36.5	14,976		0.0000	1.0000	3.98	
37.5	14,976		0.0000	1.0000	3.98	
38.5	14,976	14,976	1.0000		3.98	
39.5						

MANITOBA HYDRO
ACCOUNT 6000H - CONSTRUCTION EQUIPMENT
ORIGINAL AND SMOOTH SURVIVOR CURVES

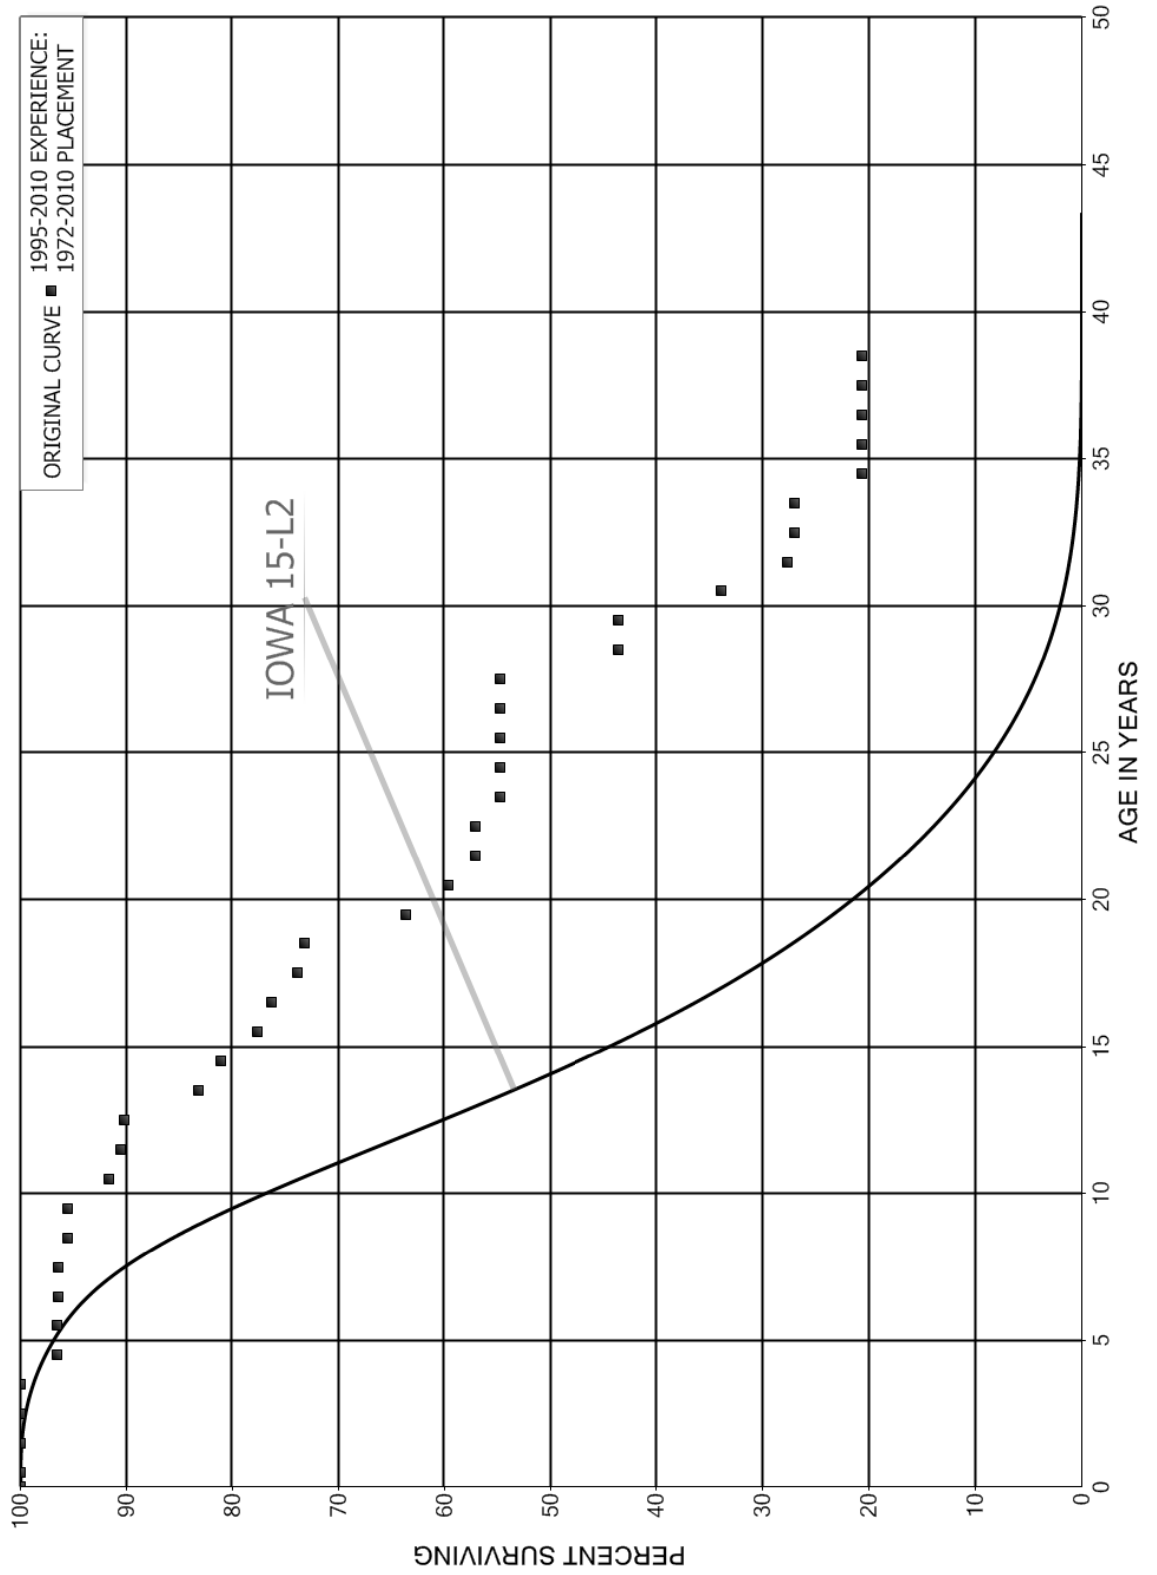


MANITOBA HYDRO

ACCOUNT 6000H - CONSTRUCTION EQUIPMENT

ORIGINAL LIFE TABLE

PLACEMENT BAND 1972-2010			EXPERIENCE BAND 1995-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	16,495,058		0.0000	1.0000	100.00
0.5	15,720,180	14,735	0.0009	0.9991	100.00
1.5	13,017,768		0.0000	1.0000	99.91
2.5	11,927,278		0.0000	1.0000	99.91
3.5	10,749,707	361,170	0.0336	0.9664	99.91
4.5	9,316,531		0.0000	1.0000	96.55
5.5	9,080,857	11,979	0.0013	0.9987	96.55
6.5	8,396,463		0.0000	1.0000	96.42
7.5	7,475,421	72,225	0.0097	0.9903	96.42
8.5	6,971,468		0.0000	1.0000	95.49
9.5	6,097,786	246,394	0.0404	0.9596	95.49
10.5	5,331,540	67,836	0.0127	0.9873	91.63
11.5	5,229,692	17,746	0.0034	0.9966	90.47
12.5	4,547,484	354,440	0.0779	0.9221	90.16
13.5	3,318,667	80,991	0.0244	0.9756	83.13
14.5	2,676,175	114,340	0.0427	0.9573	81.10
15.5	2,095,569	37,431	0.0179	0.9821	77.64
16.5	2,125,207	68,850	0.0324	0.9676	76.25
17.5	2,216,216	19,827	0.0089	0.9911	73.78
18.5	2,024,959	261,797	0.1293	0.8707	73.12
19.5	1,743,870	109,953	0.0631	0.9369	63.67
20.5	1,636,980	70,318	0.0430	0.9570	59.65
21.5	1,374,345		0.0000	1.0000	57.09
22.5	1,301,835	53,098	0.0408	0.9592	57.09
23.5	1,248,737		0.0000	1.0000	54.76
24.5	1,082,330		0.0000	1.0000	54.76
25.5	1,073,441		0.0000	1.0000	54.76
26.5	1,051,854		0.0000	1.0000	54.76
27.5	989,538	203,164	0.2053	0.7947	54.76
28.5	786,374		0.0000	1.0000	43.52
29.5	786,374	175,581	0.2233	0.7767	43.52
30.5	600,034	110,472	0.1841	0.8159	33.80
31.5	437,732	9,084	0.0208	0.9792	27.58
32.5	398,237		0.0000	1.0000	27.01
33.5	104,071	24,675	0.2371	0.7629	27.01
34.5	79,396		0.0000	1.0000	20.60
35.5	66,965		0.0000	1.0000	20.60
36.5	66,965		0.0000	1.0000	20.60
37.5	66,965		0.0000	1.0000	20.60
38.5					20.60

MANITOBA HYDRO
ACCOUNT 6000 I - LARGE SOFT-TRACK EQUIPMENT
ORIGINAL AND SMOOTH SURVIVOR CURVES

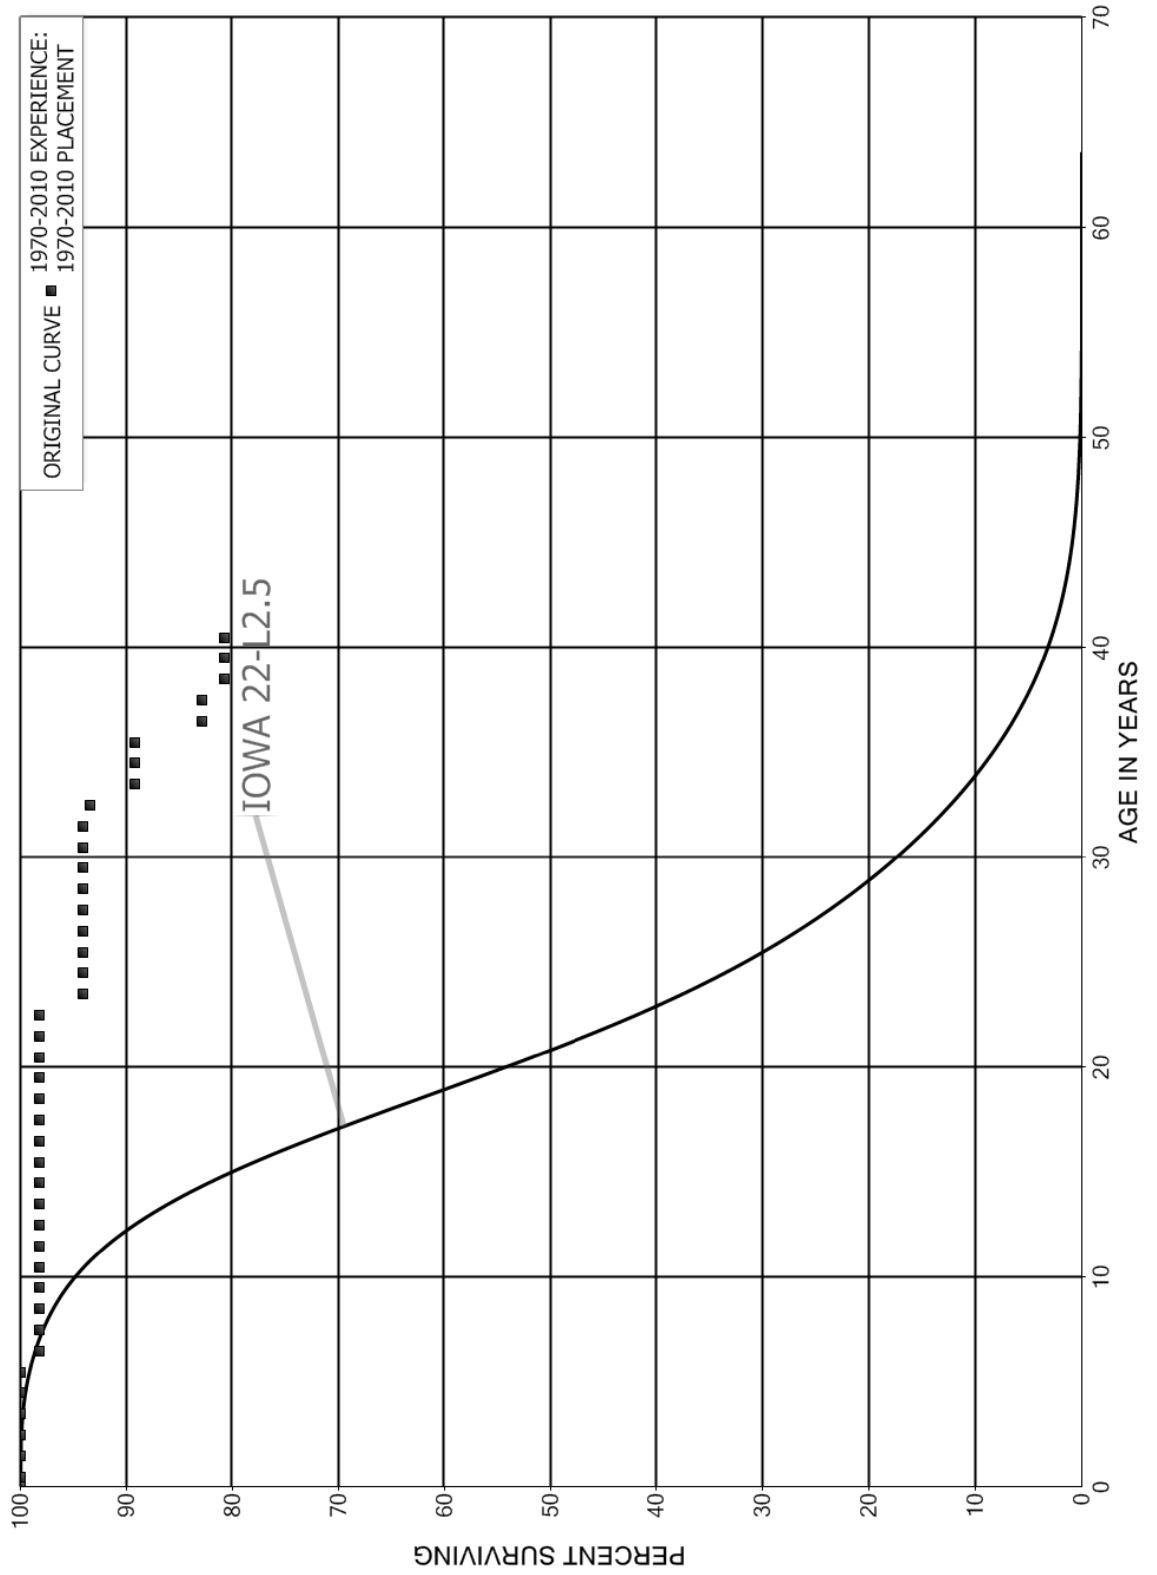


MANITOBA HYDRO

ACCOUNT 6000I - LARGE SOFT-TRACK EQUIPMENT

ORIGINAL LIFE TABLE

PLACEMENT BAND 1970-2010			EXPERIENCE BAND 1970-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	13,492,135		0.0000	1.0000	100.00
0.5	12,505,638		0.0000	1.0000	100.00
1.5	10,894,956		0.0000	1.0000	100.00
2.5	9,864,156		0.0000	1.0000	100.00
3.5	8,259,261	0	0.0000	1.0000	100.00
4.5	7,644,524		0.0000	1.0000	100.00
5.5	6,466,430	117,700	0.0182	0.9818	100.00
6.5	6,348,730		0.0000	1.0000	98.18
7.5	6,348,730		0.0000	1.0000	98.18
8.5	4,046,740		0.0000	1.0000	98.18
9.5	3,797,373		0.0000	1.0000	98.18
10.5	3,797,373		0.0000	1.0000	98.18
11.5	3,683,754		0.0000	1.0000	98.18
12.5	2,955,706	125	0.0000	1.0000	98.18
13.5	2,955,564		0.0000	1.0000	98.18
14.5	2,841,233	17	0.0000	1.0000	98.18
15.5	2,448,219		0.0000	1.0000	98.18
16.5	2,377,909		0.0000	1.0000	98.18
17.5	2,002,767		0.0000	1.0000	98.18
18.5	1,919,370		0.0000	1.0000	98.18
19.5	1,919,370		0.0000	1.0000	98.18
20.5	1,919,370		0.0000	1.0000	98.18
21.5	1,919,370		0.0000	1.0000	98.18
22.5	1,919,370	79,282	0.0413	0.9587	98.18
23.5	1,840,088		0.0000	1.0000	94.12
24.5	1,840,088		0.0000	1.0000	94.12
25.5	1,817,712		0.0000	1.0000	94.12
26.5	1,817,712		0.0000	1.0000	94.12
27.5	1,817,712		0.0000	1.0000	94.12
28.5	1,817,712		0.0000	1.0000	94.12
29.5	1,817,712		0.0000	1.0000	94.12
30.5	1,817,712		0.0000	1.0000	94.12
31.5	1,817,712	12,947	0.0071	0.9929	94.12
32.5	1,753,182	79,432	0.0453	0.9547	93.45
33.5	1,653,210		0.0000	1.0000	89.22
34.5	944,493		0.0000	1.0000	89.22
35.5	605,031	42,957	0.0710	0.9290	89.22
36.5	526,251		0.0000	1.0000	82.88
37.5	505,630	13,410	0.0265	0.9735	82.88
38.5	126,383		0.0000	1.0000	80.68
39.5	23,644		0.0000	1.0000	80.68
40.5					80.68

MANITOBA HYDRO
ACCOUNT 6000J - TRAILERS
ORIGINAL AND SMOOTH SURVIVOR CURVES

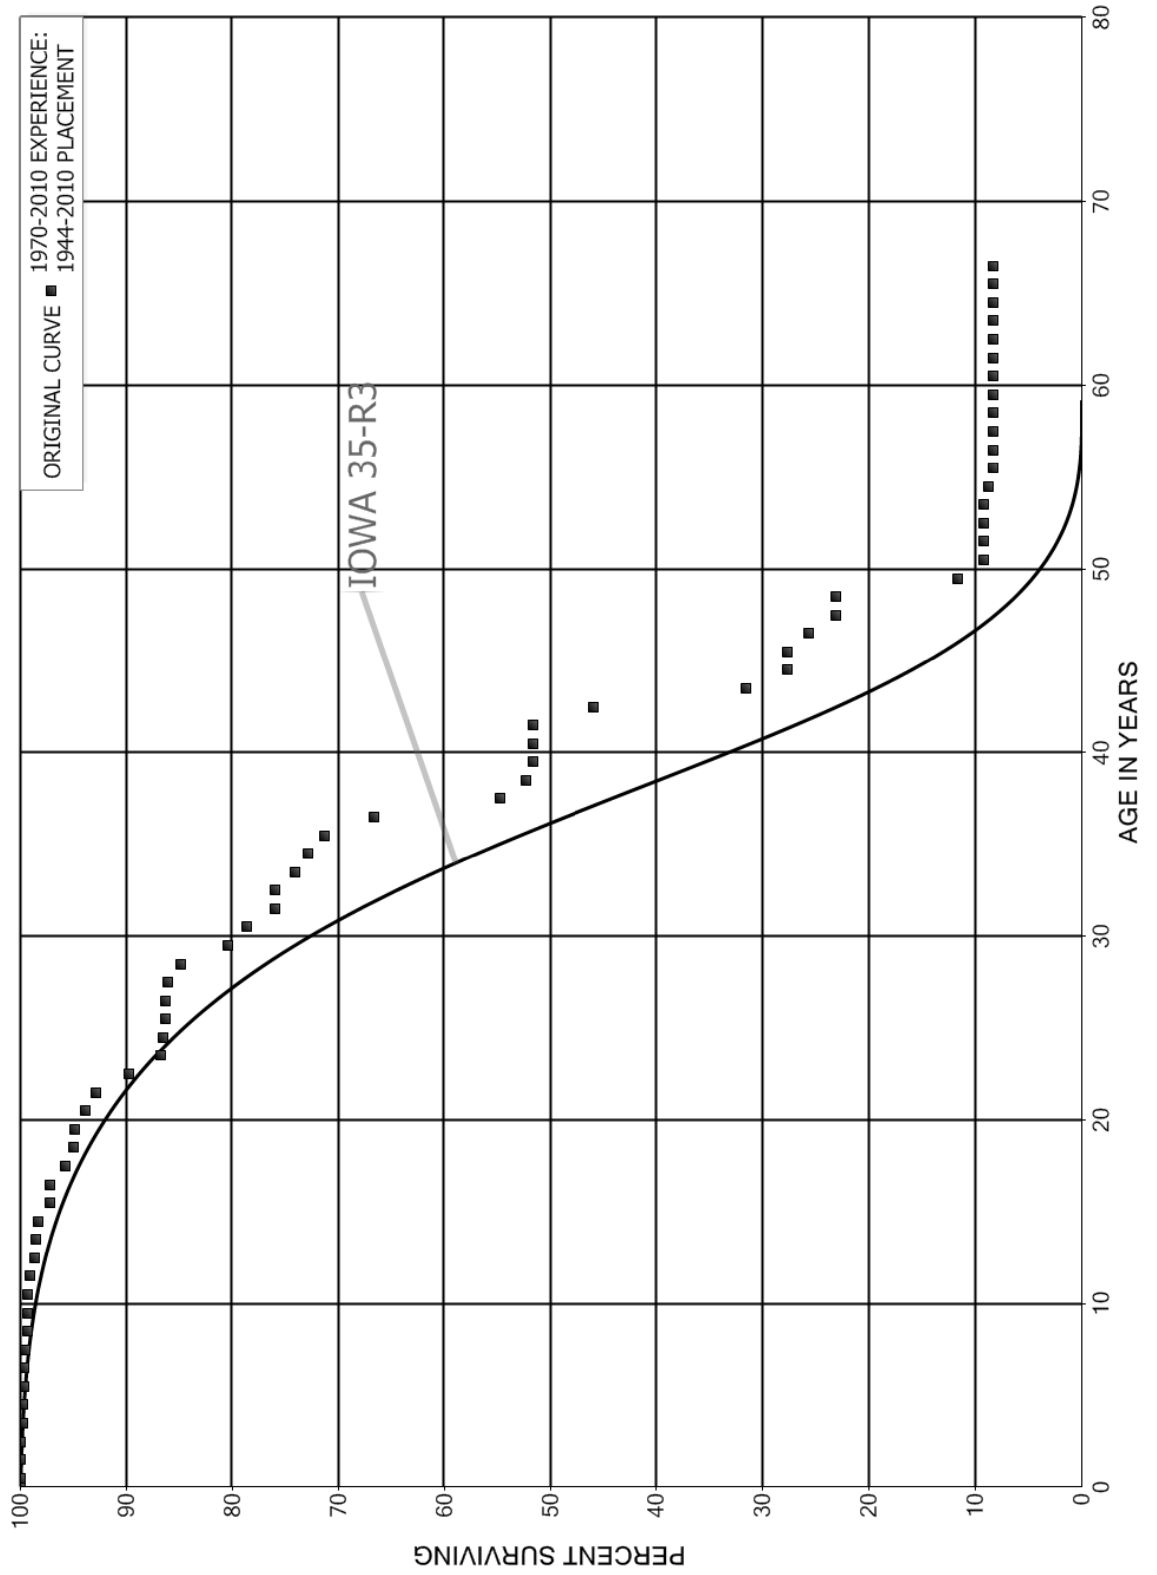

MANITOBA HYDRO

ACCOUNT 6000J - TRAILERS

ORIGINAL LIFE TABLE

PLACEMENT BAND 1944-2010			EXPERIENCE BAND 1970-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	16,559,528		0.0000	1.0000	100.00
0.5	15,762,536		0.0000	1.0000	100.00
1.5	14,005,344	6,987	0.0005	0.9995	100.00
2.5	13,421,315	35,163	0.0026	0.9974	99.95
3.5	12,098,467	214	0.0000	1.0000	99.69
4.5	11,164,855	4,601	0.0004	0.9996	99.69
5.5	10,600,193	1,284	0.0001	0.9999	99.65
6.5	9,783,454	8,604	0.0009	0.9991	99.63
7.5	9,215,836	19,526	0.0021	0.9979	99.55
8.5	8,672,363	7,753	0.0009	0.9991	99.33
9.5	6,958,308		0.0000	1.0000	99.25
10.5	5,789,993	10,450	0.0018	0.9982	99.25
11.5	5,226,763	23,771	0.0045	0.9955	99.07
12.5	5,098,993	5,351	0.0010	0.9990	98.62
13.5	4,437,087	10,224	0.0023	0.9977	98.51
14.5	3,853,971	44,159	0.0115	0.9885	98.29
15.5	3,452,116		0.0000	1.0000	97.16
16.5	3,137,816	47,297	0.0151	0.9849	97.16
17.5	2,976,522	22,383	0.0075	0.9925	95.70
18.5	2,496,909	3,424	0.0014	0.9986	94.98
19.5	2,114,355	23,505	0.0111	0.9889	94.85
20.5	1,952,440	19,539	0.0100	0.9900	93.79
21.5	1,484,785	49,197	0.0331	0.9669	92.85
22.5	1,368,661	46,750	0.0342	0.9658	89.78
23.5	1,290,184	2,934	0.0023	0.9977	86.71
24.5	1,141,470	3,025	0.0027	0.9973	86.51
25.5	1,092,277		0.0000	1.0000	86.28
26.5	1,066,183	3,025	0.0028	0.9972	86.28
27.5	1,046,415	14,395	0.0138	0.9862	86.04
28.5	1,032,020	53,740	0.0521	0.9479	84.85
29.5	925,585	21,232	0.0229	0.9771	80.44
30.5	848,815	28,204	0.0332	0.9668	78.59
31.5	805,089		0.0000	1.0000	75.98
32.5	741,555	19,130	0.0258	0.9742	75.98
33.5	435,755	6,896	0.0158	0.9842	74.02
34.5	310,906	6,775	0.0218	0.9782	72.85
35.5	236,831	15,387	0.0650	0.9350	71.26
36.5	180,530	32,381	0.1794	0.8206	66.63
37.5	127,395	5,555	0.0436	0.9564	54.68
38.5	113,210	1,359	0.0120	0.9880	52.30


MANITOBA HYDRO

ACCOUNT 6000J - TRAILERS

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1944-2010			EXPERIENCE BAND 1970-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
39.5	89,136		0.0000	1.0000	51.67
40.5	80,776		0.0000	1.0000	51.67
41.5	77,430	8,710	0.1125	0.8875	51.67
42.5	57,580	18,078	0.3140	0.6860	45.86
43.5	33,071	4,087	0.1236	0.8764	31.46
44.5	28,984		0.0000	1.0000	27.57
45.5	28,984	2,034	0.0702	0.9298	27.57
46.5	14,679	1,457	0.0993	0.9007	25.64
47.5	13,222		0.0000	1.0000	23.09
48.5	8,399	4,166	0.4960	0.5040	23.09
49.5	4,232	889	0.2101	0.7899	11.64
50.5	3,342		0.0000	1.0000	9.19
51.5	3,342		0.0000	1.0000	9.19
52.5	3,342		0.0000	1.0000	9.19
53.5	3,342	165	0.0494	0.9506	9.19
54.5	2,860	165	0.0577	0.9423	8.74
55.5	2,695		0.0000	1.0000	8.23
56.5	2,695		0.0000	1.0000	8.23
57.5	2,695		0.0000	1.0000	8.23
58.5	2,695		0.0000	1.0000	8.23
59.5	2,695		0.0000	1.0000	8.23
60.5	2,695		0.0000	1.0000	8.23
61.5	2,695		0.0000	1.0000	8.23
62.5	2,545		0.0000	1.0000	8.23
63.5	810		0.0000	1.0000	8.23
64.5	486		0.0000	1.0000	8.23
65.5	162		0.0000	1.0000	8.23
66.5					8.23

MANITOBA HYDRO
ACCOUNT 6000K - MISCELLANEOUS VEHICLES
ORIGINAL AND SMOOTH SURVIVOR CURVES

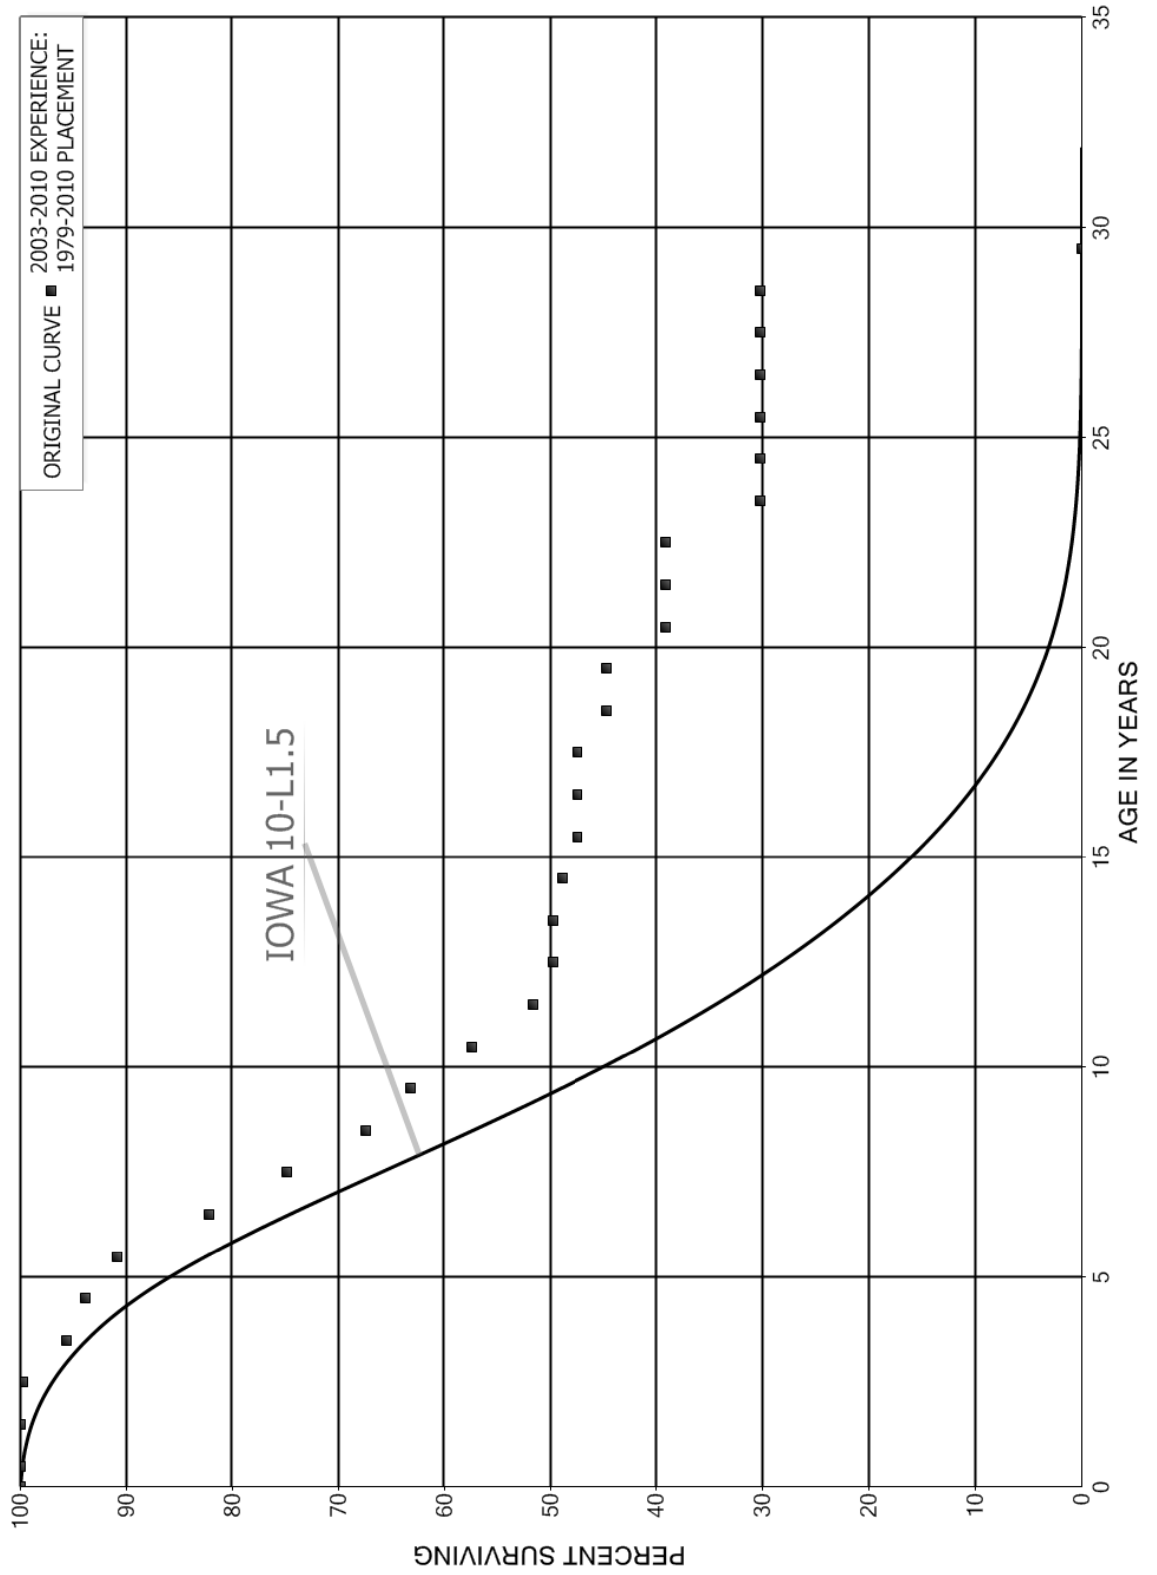


MANITOBA HYDRO

ACCOUNT 6000K - MISCELLANEOUS VEHICLES

ORIGINAL LIFE TABLE

PLACEMENT BAND 1979-2010			EXPERIENCE BAND 2003-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	4,578,879		0.0000	1.0000	100.00
0.5	4,773,684		0.0000	1.0000	100.00
1.5	5,570,061	13,821	0.0025	0.9975	100.00
2.5	5,246,933	217,087	0.0414	0.9586	99.75
3.5	4,564,324	84,805	0.0186	0.9814	95.62
4.5	4,056,485	128,840	0.0318	0.9682	93.85
5.5	3,368,221	321,903	0.0956	0.9044	90.87
6.5	2,416,392	215,055	0.0890	0.9110	82.18
7.5	1,963,518	195,594	0.0996	0.9004	74.87
8.5	1,348,731	85,753	0.0636	0.9364	67.41
9.5	533,513	48,809	0.0915	0.9085	63.12
10.5	339,774	33,723	0.0993	0.9007	57.35
11.5	322,194	11,986	0.0372	0.9628	51.66
12.5	298,367		0.0000	1.0000	49.74
13.5	286,229	5,420	0.0189	0.9811	49.74
14.5	224,262	6,281	0.0280	0.9720	48.79
15.5	169,103		0.0000	1.0000	47.43
16.5	129,350		0.0000	1.0000	47.43
17.5	122,696	7,318	0.0596	0.9404	47.43
18.5	115,378	0	0.0000	1.0000	44.60
19.5	89,029	10,987	0.1234	0.8766	44.60
20.5	42,646		0.0000	1.0000	39.09
21.5	26,489		0.0000	1.0000	39.09
22.5	20,837	4,762	0.2285	0.7715	39.09
23.5	81,978		0.0000	1.0000	30.16
24.5	73,430		0.0000	1.0000	30.16
25.5	65,902		0.0000	1.0000	30.16
26.5	65,902		0.0000	1.0000	30.16
27.5	65,902		0.0000	1.0000	30.16
28.5	65,902	65,902	1.0000		30.16
29.5					

MANITOBA HYDRO
ACCOUNT 8000B - BUILDINGS - GENERAL
ORIGINAL AND SMOOTH SURVIVOR CURVES

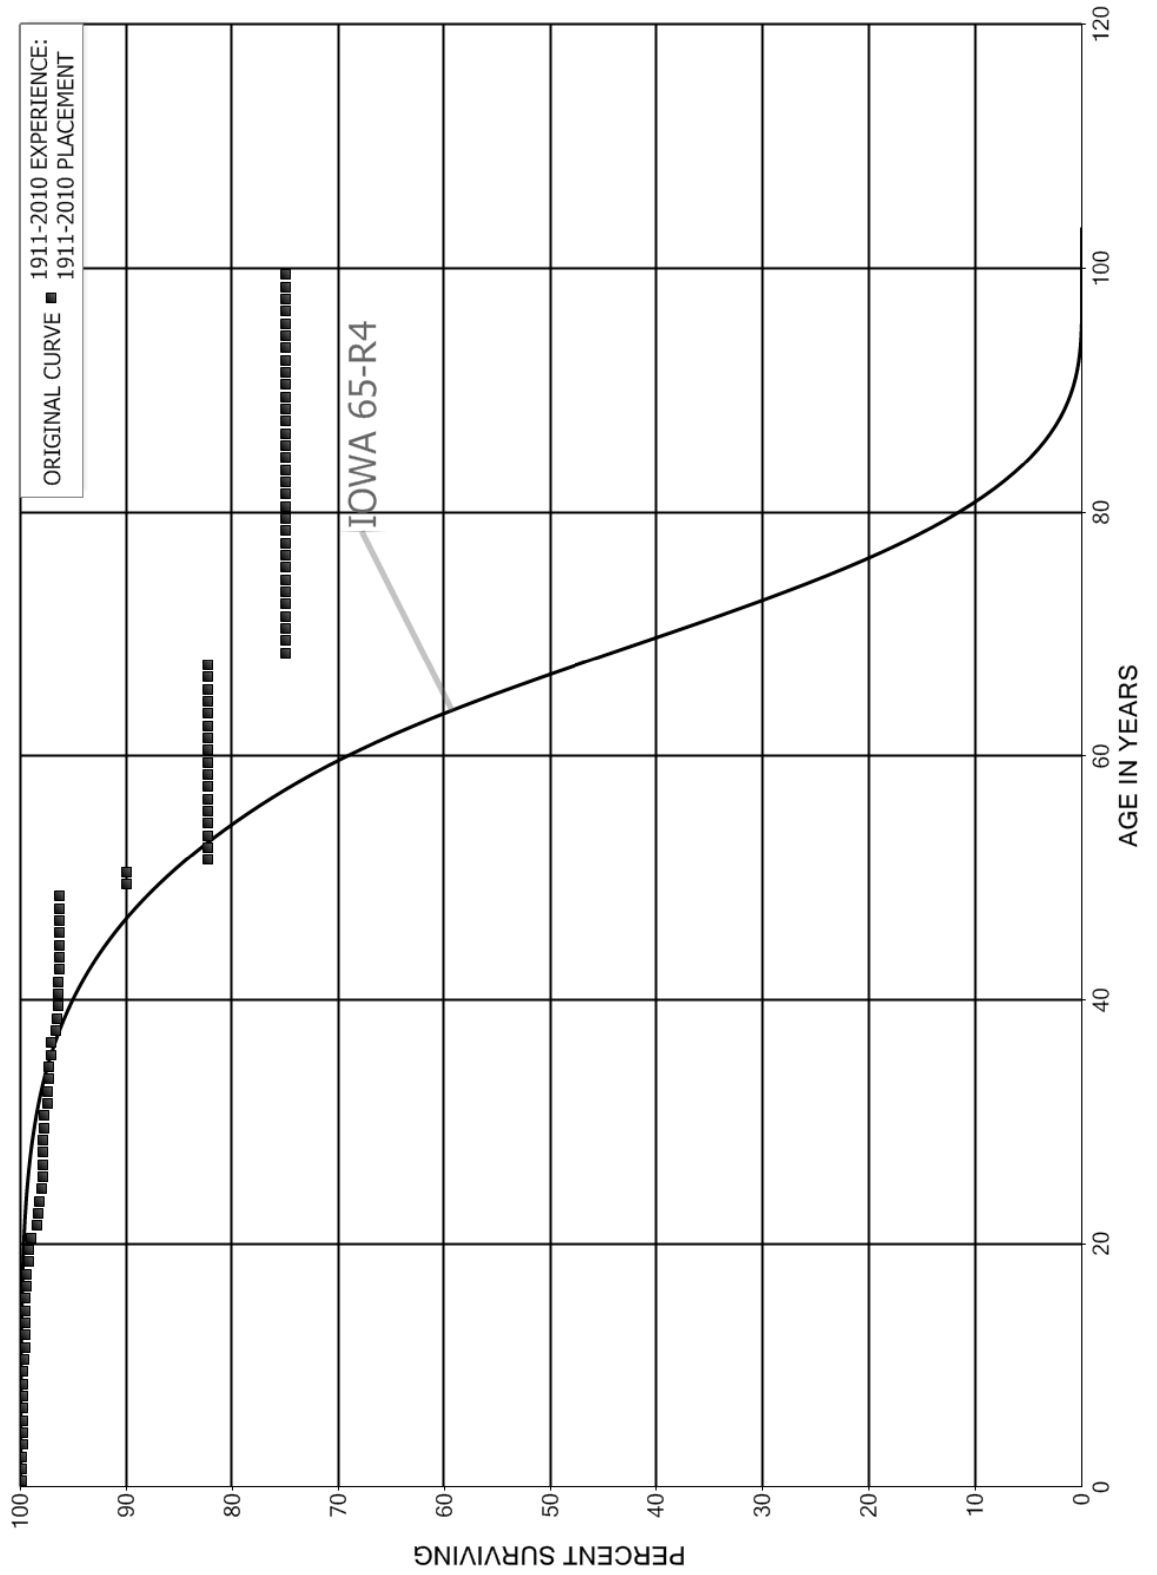

MANITOBA HYDRO

ACCOUNT 8000B - BUILDINGS - GENERAL

ORIGINAL LIFE TABLE

PLACEMENT BAND 1911-2010			EXPERIENCE BAND 1911-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	89,283,114	180,709	0.0020	0.9980	100.00
0.5	85,662,256		0.0000	1.0000	99.80
1.5	83,266,167	8,154	0.0001	0.9999	99.80
2.5	81,105,141	17,400	0.0002	0.9998	99.79
3.5	79,957,055	3,491	0.0000	1.0000	99.77
4.5	79,898,575	1,909	0.0000	1.0000	99.76
5.5	79,841,055	10,085	0.0001	0.9999	99.76
6.5	78,148,222	10,168	0.0001	0.9999	99.75
7.5	69,631,511	33,898	0.0005	0.9995	99.73
8.5	66,093,532		0.0000	1.0000	99.69
9.5	65,774,869	44,640	0.0007	0.9993	99.69
10.5	57,446,845	34,550	0.0006	0.9994	99.62
11.5	57,157,018	12,518	0.0002	0.9998	99.56
12.5	53,547,117	21,345	0.0004	0.9996	99.54
13.5	44,744,774	2,326	0.0001	0.9999	99.50
14.5	43,937,784	16,400	0.0004	0.9996	99.49
15.5	42,938,267	3,588	0.0001	0.9999	99.45
16.5	39,896,219	2,137	0.0001	0.9999	99.45
17.5	34,486,143	79,474	0.0023	0.9977	99.44
18.5	32,046,543	13,237	0.0004	0.9996	99.21
19.5	29,644,486	65,304	0.0022	0.9978	99.17
20.5	26,655,482	160,877	0.0060	0.9940	98.95
21.5	25,053,856	6,231	0.0002	0.9998	98.35
22.5	24,089,024	34,017	0.0014	0.9986	98.33
23.5	23,414,218	52,826	0.0023	0.9977	98.19
24.5	23,300,572	29,822	0.0013	0.9987	97.97
25.5	21,778,282		0.0000	1.0000	97.84
26.5	21,335,860		0.0000	1.0000	97.84
27.5	20,508,931	13,504	0.0007	0.9993	97.84
28.5	19,606,730	19,046	0.0010	0.9990	97.78
29.5	16,489,396	2,344	0.0001	0.9999	97.69
30.5	16,235,550	39,393	0.0024	0.9976	97.67
31.5	13,785,050		0.0000	1.0000	97.43
32.5	13,197,949	21,314	0.0016	0.9984	97.43
33.5	12,750,132		0.0000	1.0000	97.28
34.5	11,845,479	26,352	0.0022	0.9978	97.28
35.5	11,329,748		0.0000	1.0000	97.06
36.5	11,047,471	50,211	0.0045	0.9955	97.06
37.5	9,889,330	7,152	0.0007	0.9993	96.62
38.5	8,371,259	16,966	0.0020	0.9980	96.55

MANITOBA HYDRO

ACCOUNT 8000B - BUILDINGS - GENERAL

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1911-2010			EXPERIENCE BAND 1911-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
39.5	8,262,116		0.0000	1.0000	96.35
40.5	7,605,443		0.0000	1.0000	96.35
41.5	5,906,865	4,504	0.0008	0.9992	96.35
42.5	5,726,232		0.0000	1.0000	96.28
43.5	5,698,642		0.0000	1.0000	96.28
44.5	5,471,094		0.0000	1.0000	96.28
45.5	2,499,647		0.0000	1.0000	96.28
46.5	2,264,709		0.0000	1.0000	96.28
47.5	2,264,709		0.0000	1.0000	96.28
48.5	2,244,074	146,171	0.0651	0.9349	96.28
49.5	2,000,687	13	0.0000	1.0000	90.01
50.5	1,940,222	165,949	0.0855	0.9145	90.01
51.5	1,763,702		0.0000	1.0000	82.31
52.5	154,728		0.0000	1.0000	82.31
53.5	102,295		0.0000	1.0000	82.31
54.5	102,295		0.0000	1.0000	82.31
55.5	102,295		0.0000	1.0000	82.31
56.5	102,295		0.0000	1.0000	82.31
57.5	102,295		0.0000	1.0000	82.31
58.5	102,295		0.0000	1.0000	82.31
59.5	102,295		0.0000	1.0000	82.31
60.5	102,295		0.0000	1.0000	82.31
61.5	102,295		0.0000	1.0000	82.31
62.5	102,295		0.0000	1.0000	82.31
63.5	102,295		0.0000	1.0000	82.31
64.5	102,295		0.0000	1.0000	82.31
65.5	102,295		0.0000	1.0000	82.31
66.5	102,295		0.0000	1.0000	82.31
67.5	102,295	9,099	0.0889	0.9111	82.31
68.5	93,196		0.0000	1.0000	74.99
69.5	93,196		0.0000	1.0000	74.99
70.5	93,196		0.0000	1.0000	74.99
71.5	93,196		0.0000	1.0000	74.99
72.5	93,196		0.0000	1.0000	74.99
73.5	93,196		0.0000	1.0000	74.99
74.5	93,196		0.0000	1.0000	74.99
75.5	93,196		0.0000	1.0000	74.99
76.5	93,196		0.0000	1.0000	74.99
77.5	93,196		0.0000	1.0000	74.99
78.5	93,196		0.0000	1.0000	74.99


MANITOBA HYDRO

ACCOUNT 8000B - BUILDINGS - GENERAL

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1911-2010			EXPERIENCE BAND 1911-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
79.5	93,196		0.0000	1.0000	74.99
80.5	93,196		0.0000	1.0000	74.99
81.5	93,196		0.0000	1.0000	74.99
82.5	93,196		0.0000	1.0000	74.99
83.5	93,196		0.0000	1.0000	74.99
84.5	93,196		0.0000	1.0000	74.99
85.5	93,196		0.0000	1.0000	74.99
86.5	93,196		0.0000	1.0000	74.99
87.5	93,196		0.0000	1.0000	74.99
88.5	93,196		0.0000	1.0000	74.99
89.5	93,196		0.0000	1.0000	74.99
90.5	93,196		0.0000	1.0000	74.99
91.5	93,196		0.0000	1.0000	74.99
92.5	93,196		0.0000	1.0000	74.99
93.5	93,196		0.0000	1.0000	74.99
94.5	93,196		0.0000	1.0000	74.99
95.5	93,196		0.0000	1.0000	74.99
96.5	93,196		0.0000	1.0000	74.99
97.5	93,196		0.0000	1.0000	74.99
98.5	93,196		0.0000	1.0000	74.99
99.5					74.99

MANITOBA HYDRO
ACCOUNT 8000D - BUILDING - 360 PORTAGE - CIVIL
ORIGINAL AND SMOOTH SURVIVOR CURVES

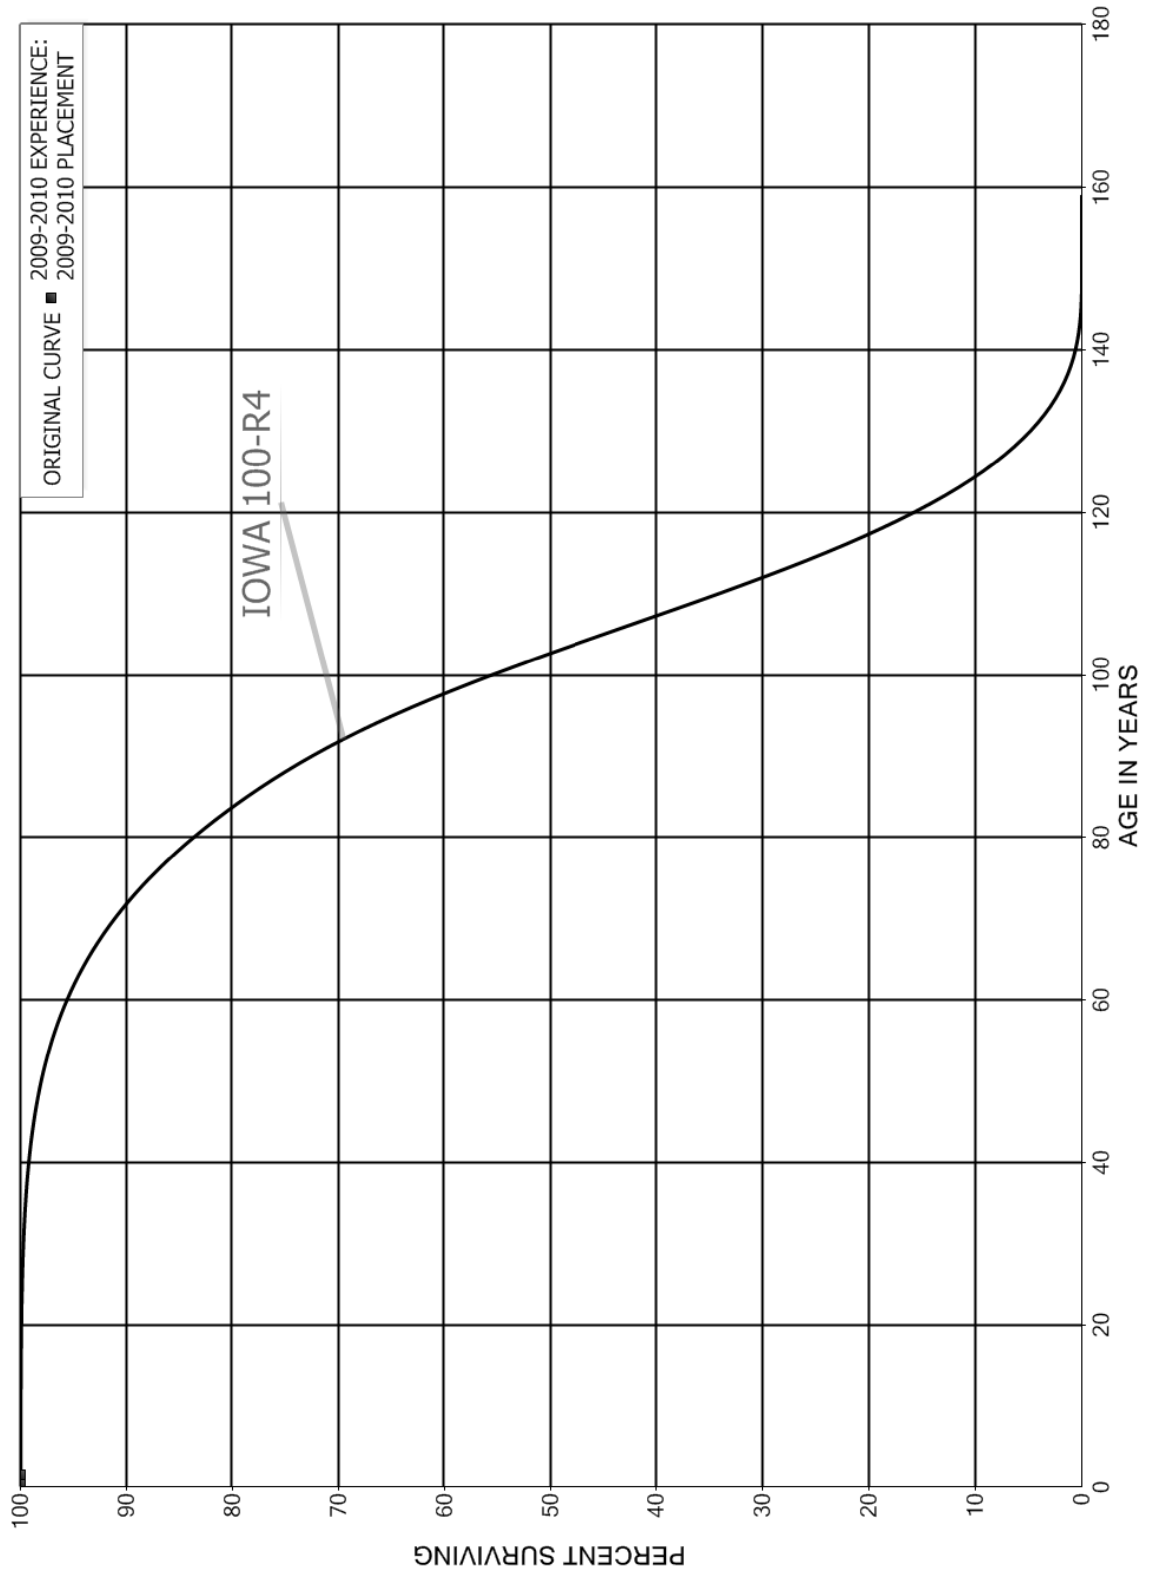


MANITOBA HYDRO

ACCOUNT 8000D - BUILDING - 360 PORTAGE - CIVIL

ORIGINAL LIFE TABLE

PLACEMENT BAND 2009-2010			EXPERIENCE BAND 2009-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	207,228,398		0.0000	1.0000	100.00
0.5	191,915,980		0.0000	1.0000	100.00
1.5					100.00

MANITOBA HYDRO
ACCOUNT 8000E - BUILDING - 360 PORTAGE - ELECTRO/MECHANICAL
ORIGINAL AND SMOOTH SURVIVOR CURVES

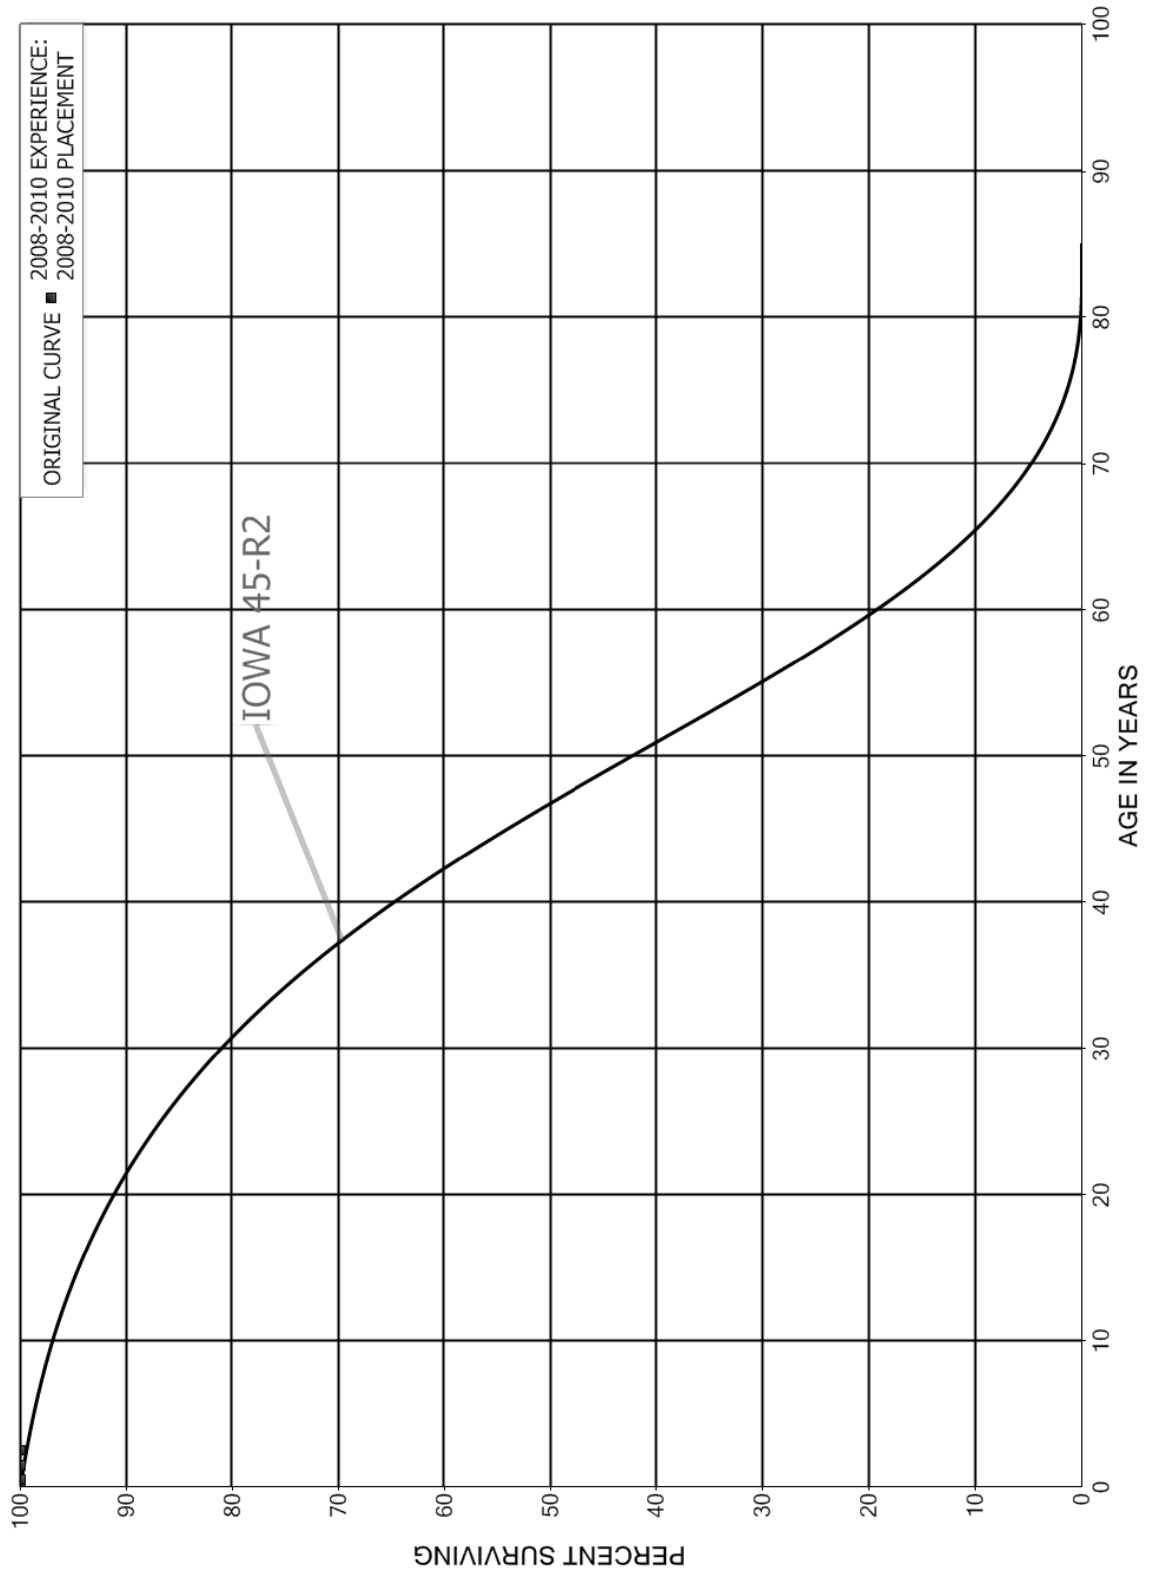


MANITOBA HYDRO

ACCOUNT 8000E - BUILDING - 360 PORTAGE - ELECTRO/MECHANICAL

ORIGINAL LIFE TABLE

PLACEMENT BAND 2008-2010			EXPERIENCE BAND 2008-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	65,888,581		0.0000	1.0000	100.00
0.5	61,004,879		0.0000	1.0000	100.00
1.5	70,386		0.0000	1.0000	100.00
2.5					100.00

MANITOBA HYDRO
ACCOUNT A100A - EASEMENTS
ORIGINAL AND SMOOTH SURVIVOR CURVES

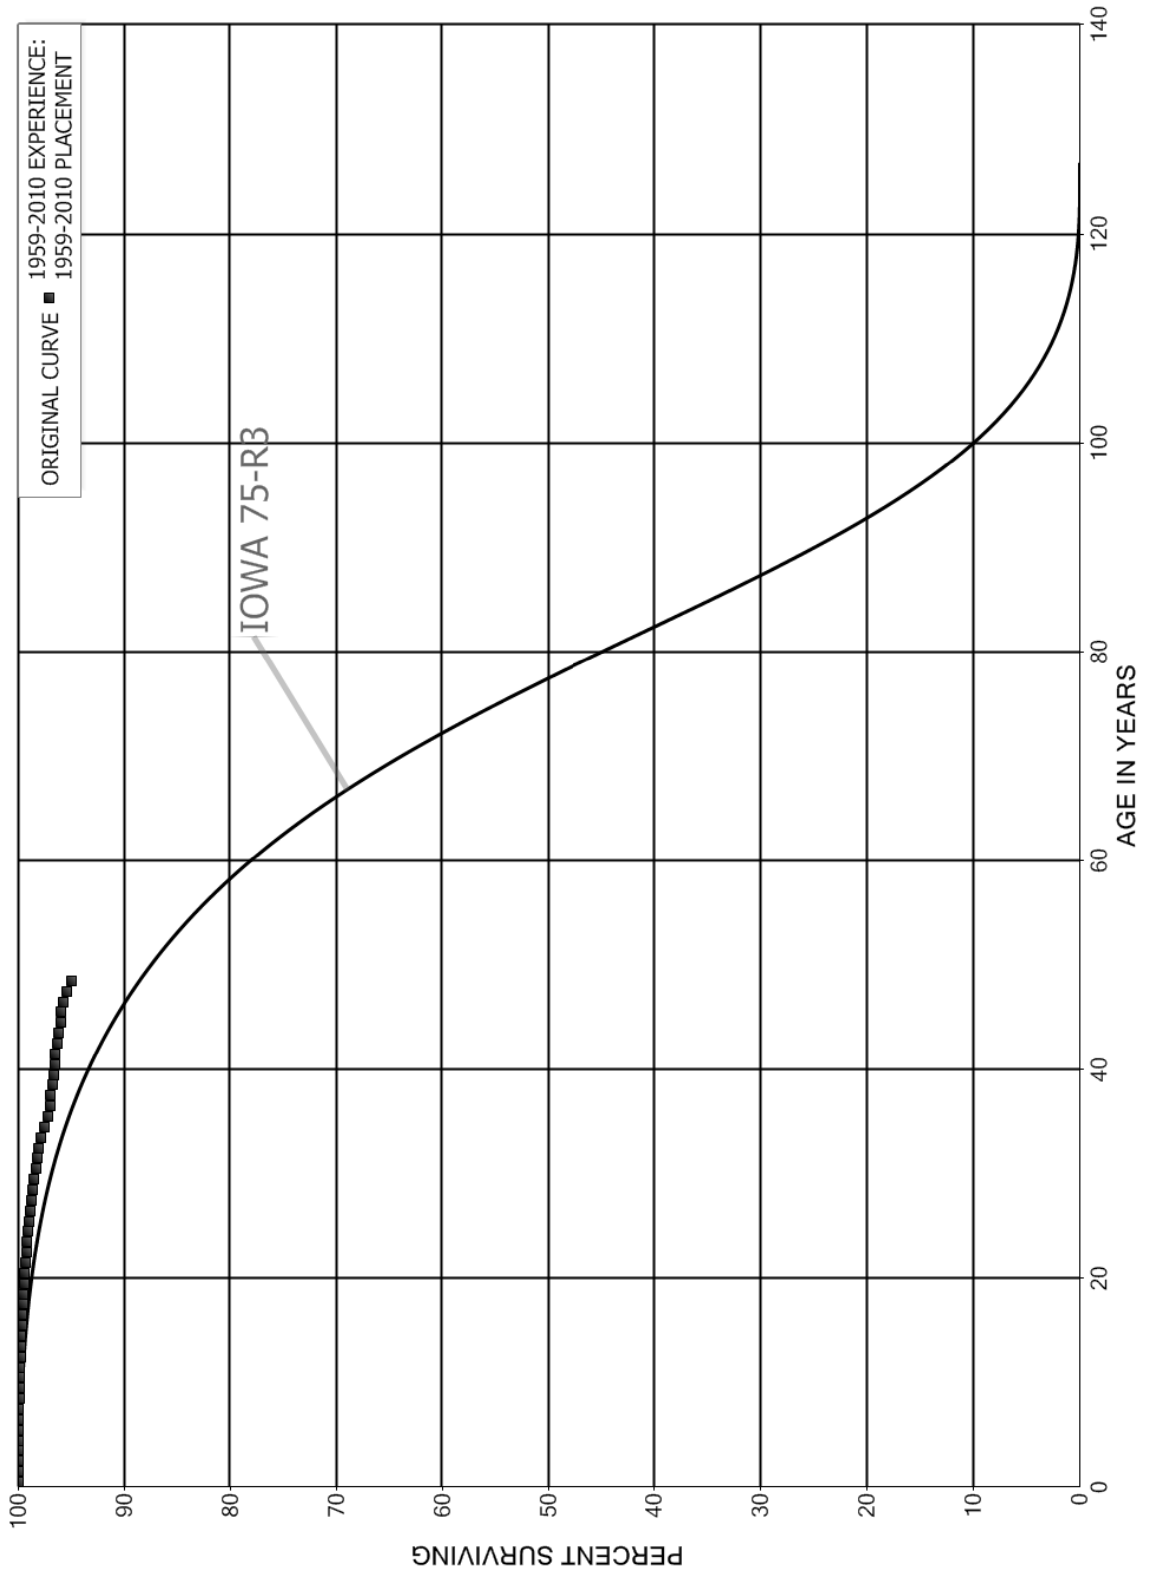

MANITOBA HYDRO

ACCOUNT A100A - EASEMENTS

ORIGINAL LIFE TABLE

PLACEMENT BAND 1959-2010			EXPERIENCE BAND 1959-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
0.0	50,862,824	3,167	0.0001	0.9999	100.00	
0.5	48,271,430	4,536	0.0001	0.9999	99.99	
1.5	47,744,959	4,742	0.0001	0.9999	99.98	
2.5	46,546,100	4,629	0.0001	0.9999	99.97	
3.5	44,846,404	4,913	0.0001	0.9999	99.96	
4.5	44,104,036	6,806	0.0002	0.9998	99.95	
5.5	43,148,181	6,621	0.0002	0.9998	99.94	
6.5	42,250,916	8,006	0.0002	0.9998	99.92	
7.5	41,691,845	9,456	0.0002	0.9998	99.90	
8.5	40,046,993	6,185	0.0002	0.9998	99.88	
9.5	29,101,775	7,507	0.0003	0.9997	99.87	
10.5	27,119,665	9,008	0.0003	0.9997	99.84	
11.5	25,209,382	7,984	0.0003	0.9997	99.81	
12.5	21,272,550	6,850	0.0003	0.9997	99.78	
13.5	17,755,167	7,280	0.0004	0.9996	99.74	
14.5	16,025,613	11,485	0.0007	0.9993	99.70	
15.5	15,055,169	8,934	0.0006	0.9994	99.63	
16.5	14,084,664	7,019	0.0005	0.9995	99.57	
17.5	13,165,288	6,784	0.0005	0.9995	99.52	
18.5	11,879,485	7,835	0.0007	0.9993	99.47	
19.5	10,884,858	7,110	0.0007	0.9993	99.41	
20.5	9,383,144	5,854	0.0006	0.9994	99.34	
21.5	8,603,855	5,623	0.0007	0.9993	99.28	
22.5	8,066,633	5,320	0.0007	0.9993	99.21	
23.5	7,583,275	8,218	0.0011	0.9989	99.15	
24.5	7,130,090	8,195	0.0011	0.9989	99.04	
25.5	5,938,250	7,548	0.0013	0.9987	98.93	
26.5	5,438,158	5,980	0.0011	0.9989	98.80	
27.5	5,043,678	5,333	0.0011	0.9989	98.69	
28.5	4,250,514	5,073	0.0012	0.9988	98.59	
29.5	3,318,321	5,141	0.0015	0.9985	98.47	
30.5	2,942,257	4,413	0.0015	0.9985	98.32	
31.5	2,723,343	3,792	0.0014	0.9986	98.17	
32.5	2,426,558	4,006	0.0017	0.9983	98.03	
33.5	2,212,876	8,120	0.0037	0.9963	97.87	
34.5	1,823,597	5,817	0.0032	0.9968	97.51	
35.5	1,680,838	3,341	0.0020	0.9980	97.20	
36.5	1,518,487	1,305	0.0009	0.9991	97.01	
37.5	1,388,453	3,189	0.0023	0.9977	96.92	
38.5	1,102,947	1,016	0.0009	0.9991	96.70	


MANITOBA HYDRO

ACCOUNT A100A - EASEMENTS

ORIGINAL LIFE TABLE, CONT.

PLACEMENT BAND 1959-2010			EXPERIENCE BAND 1959-2010			
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL	
39.5	811,693	636	0.0008	0.9992	96.61	
40.5	645,751	451	0.0007	0.9993	96.54	
41.5	601,798	1,119	0.0019	0.9981	96.47	
42.5	551,222	831	0.0015	0.9985	96.29	
43.5	451,557	727	0.0016	0.9984	96.15	
44.5	365,767	180	0.0005	0.9995	95.99	
45.5	290,587	508	0.0017	0.9983	95.94	
46.5	260,575	918	0.0035	0.9965	95.78	
47.5	244,384	1,179	0.0048	0.9952	95.44	
48.5					94.98	

MANITOBA HYDRO
ACCOUNT A200G - COMPUTER DEVELOPMENT - MAJOR SYSTEMS
ORIGINAL AND SMOOTH SURVIVOR CURVES

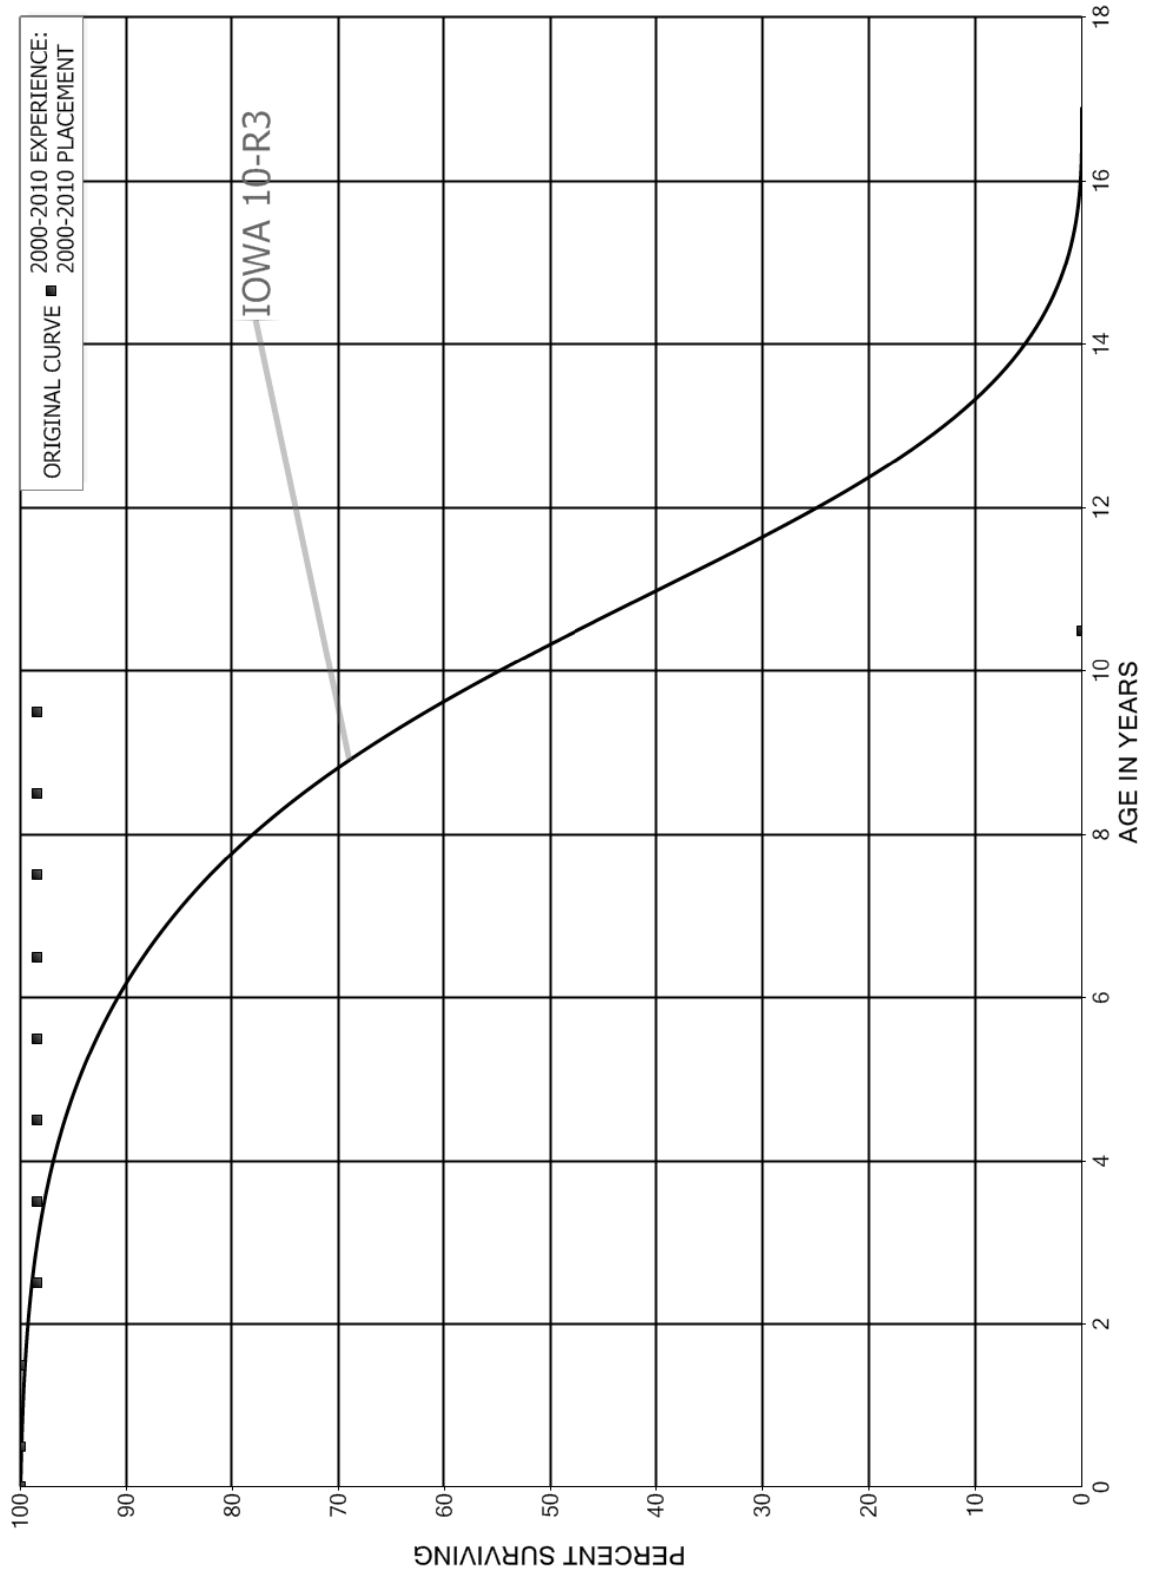


MANITOBA HYDRO

ACCOUNT A200G - COMPUTER DEVELOPMENT - MAJOR SYSTEMS

ORIGINAL LIFE TABLE

PLACEMENT BAND 2000-2010			EXPERIENCE BAND 2000-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	109,483,095	110,000	0.0010	0.9990	100.00
0.5	108,059,437		0.0000	1.0000	99.90
1.5	101,565,995	1,545,031	0.0152	0.9848	99.90
2.5	89,843,875	2,183	0.0000	1.0000	98.38
3.5	76,295,555		0.0000	1.0000	98.38
4.5	53,257,083		0.0000	1.0000	98.38
5.5	41,808,588		0.0000	1.0000	98.38
6.5	28,531,381		0.0000	1.0000	98.38
7.5	23,279,704		0.0000	1.0000	98.38
8.5	15,436,880		0.0000	1.0000	98.38
9.5	6,436,297	6,436,297	1.0000		98.38
10.5					

MANITOBA HYDRO
ACCOUNT A200L - OPERATIONAL SYSTEM MAJOR SOFTWARE (EMS/SCADA)
ORIGINAL AND SMOOTH SURVIVOR CURVES

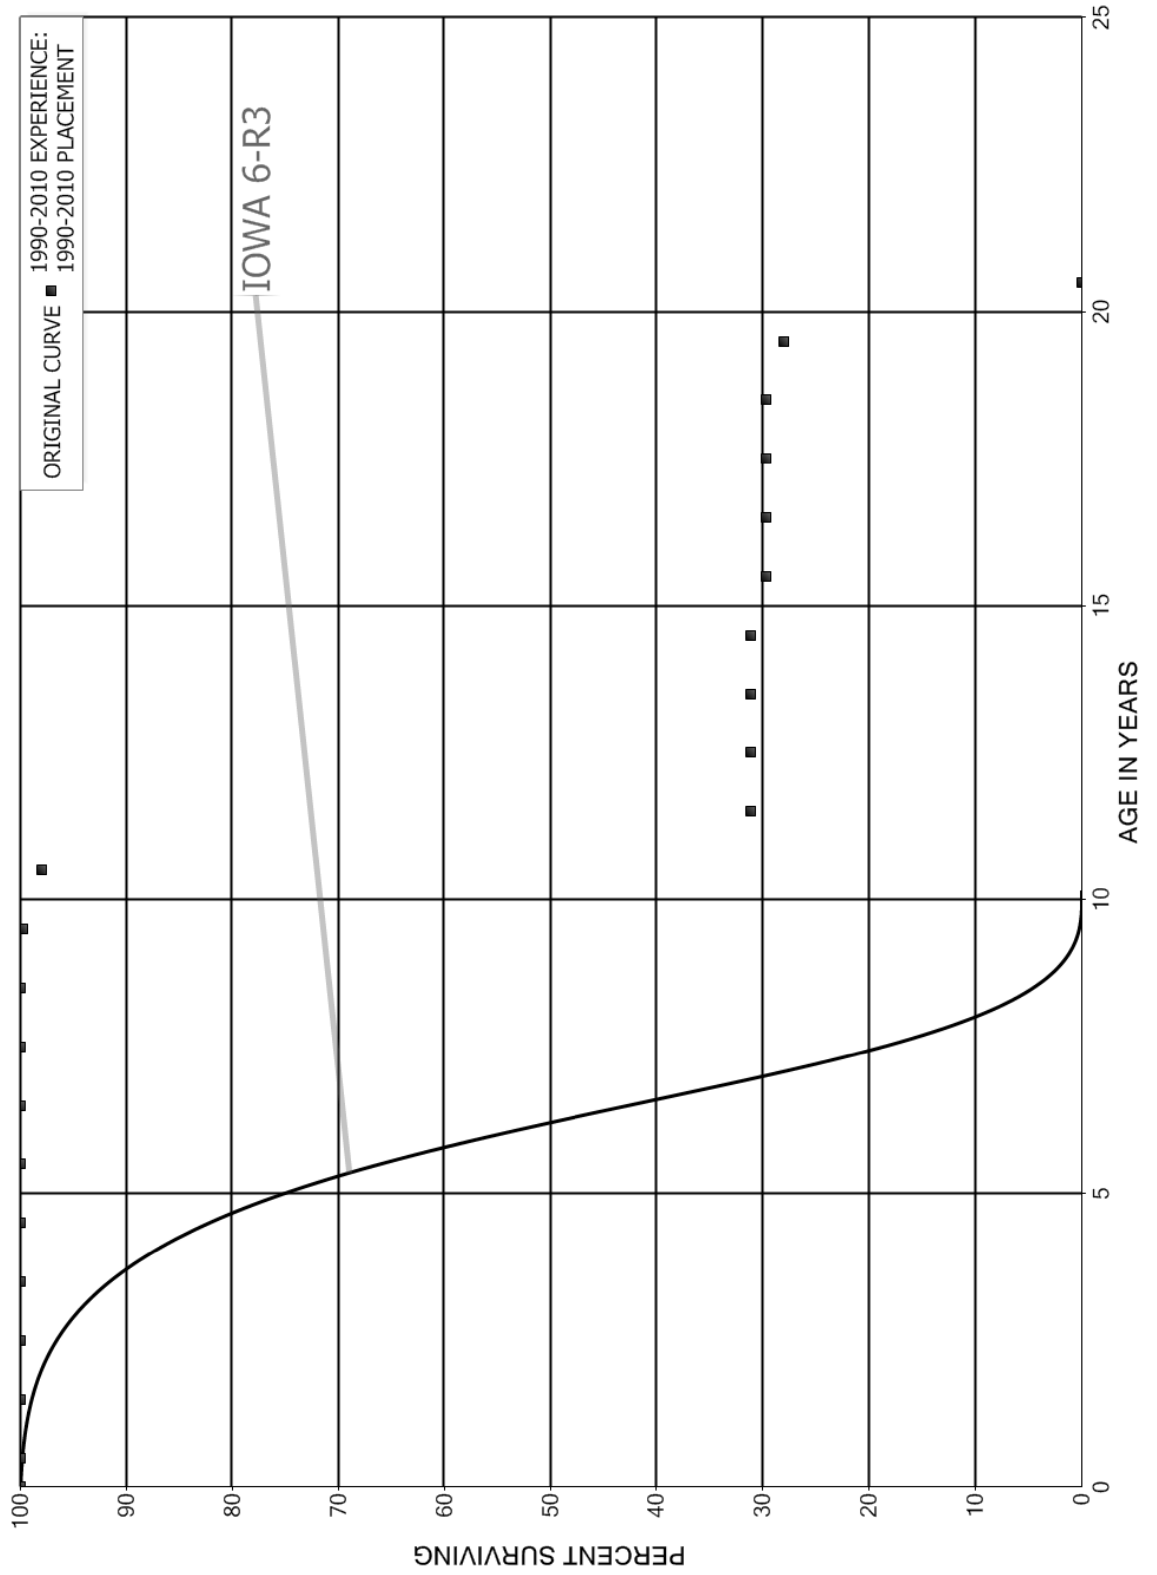

MANITOBA HYDRO

ACCOUNT A200L - OPERATIONAL SYSTEM MAJOR SOFTWARE (EMS/SCADA)

ORIGINAL LIFE TABLE

PLACEMENT BAND 1990-2010			EXPERIENCE BAND 1990-2010		
AGE AT BEGIN OF INTERVAL	EXPOSURES AT BEGINNING OF AGE INTERVAL	RETIREMENTS DURING AGE INTERVAL	RETMT RATIO	SURV RATIO	PCT SURV BEGIN OF INTERVAL
0.0	34,191,858		0.0000	1.0000	100.00
0.5	33,255,916		0.0000	1.0000	100.00
1.5	33,255,916		0.0000	1.0000	100.00
2.5	33,050,289		0.0000	1.0000	100.00
3.5	32,901,209		0.0000	1.0000	100.00
4.5	32,407,886		0.0000	1.0000	100.00
5.5	32,106,433		0.0000	1.0000	100.00
6.5	32,060,244		0.0000	1.0000	100.00
7.5	30,975,048		0.0000	1.0000	100.00
8.5	28,271,044	62,450	0.0022	0.9978	100.00
9.5	28,208,594	523,768	0.0186	0.9814	99.78
10.5	27,684,826	18,896,286	0.6826	0.3174	97.93
11.5	8,788,539		0.0000	1.0000	31.09
12.5	8,788,539		0.0000	1.0000	31.09
13.5	8,692,536		0.0000	1.0000	31.09
14.5	8,692,536	425,324	0.0489	0.9511	31.09
15.5	8,267,212		0.0000	1.0000	29.57
16.5	8,267,212		0.0000	1.0000	29.57
17.5	8,267,212		0.0000	1.0000	29.57
18.5	8,267,212	442,408	0.0535	0.9465	29.57
19.5	7,824,803	7,824,803	1.0000		27.98
20.5					